

Business Practice Manual for Direct Telemetry

Version ~~2019~~.0

Revised: ~~February 21, 2025~~ ~~October~~ ~~December 29, 2023~~ ~~1~~

Approval History

Approval Date : ~~August 2, 2011~~

Effective Date : ~~August 2, 2011~~

BPM Owner : ~~Tricia Johnstone~~ ~~Heather Kelley~~

BPM Owner's Title : Director, ~~Market Services~~ Operational Readiness

Revision History

Version	PRR	Date	Description
<u>20</u>	<u>1599</u>	<u>2/21/2025</u>	<u>Review and Revisions made. Removal of areas still referencing Dispersive. Clarification to definitions for VERMW and HSLMW points. Refinements to 6.1 Point Matrix; 12 PDRs. Updated sections 4.7.4, 5.5, 7.3.3, 8.4 (list of critical points and reporting requirements), 14.1, and 14.2. Updated CAISO website links</u>
19	<u>1390</u>	10/7/2021	Minor updates to Sections 6.2, 9.12, 11.2, 11.3, 11.4.1, 11.4.2, 11.5.1, 11.5.5 and 14.5
18	1380	8/10/2021	Sections 6.1, 8.4.2 and 14.1 have been updated to include new Telemetry requirements.
17	1369	4/22/2021	Section 14.1.3 has been updated to include the DCF requirement.
16	1327	2/19/2021	Section 6.1 has been updated to include requirements for Psuedo ties of Shared Resources.

Version	PRR	Date	Description
15	1318	1/11/2021	Sections 6.1, 14.1 and 14.2 have been updated to include new Telemetry requirements.
14	1310	11/17/2020	Section 4.7.4 has been updated to include the TLS communication requirements. Section 6 and 14 are updated to include the new Telemetry data point for Hybrid resources.
13	1229	2/19/2020	Removing Dispersive Technologies from Section 4, 5 and 9
12	1551	03/04/2019	Section 4 has been accommodated to include an Internet Service Provider Communication option. Section 8.4 Temporary Telemetry Exemption sections has been updated with new exemption requirements.
11	1054	05/02/2018	Removed ECN requirement for resources 400MW or greater. Clarified maximum of 1200MW per connection aggregating up to 25 resources. Consolidated descriptions of real-time communications options into a single section (5.3). Moved prior section 14 (ISO CAISO Security) into section 4.4 to consolidate all security topics under section 4 (Communications), including PKI and ECN agreements and Connected Entity Service Guides. Recharacterized RIG as any Real-Time Device that can meet ISO CAISO functional, operational, and security objectives. Added Dispersive™ CISDN communications option. Added table of acronyms. Added table of exhibits, figures, and diagrams. Modified multiple diagrams. Non-Spinning Reserve Logic and Testing

Version	PRR	Date	Description
			(previously section 11). Removed redundant Communication Technical Principles (previous section 13.4).
10	942	01/05/2017	Minor edits to section 3.2.2.1, changes to Section 6.7 DNP3 Variation type, 7.1 Point Matrix. In section 10.7 and 10.12 email address is updated. New section 10.9 RIG data validation is added. 10.12 RIG Generation Acceptance test and 10.13 Final RIG Documentation sections has been removed. Changes to 17.2.2 UCON definition. New section 17.5 Battery point definitions are added.
9	895	3/10/2016	PRR 895 - Changes to Section 6.2.2 and 6.2.3 regarding PDR requirements. Change to Section 6.9 to update EIR RIG limit to 1200MW. Change to Section 12.4 to include SPIN Reserve Testing. Complete replacement of Section 14 to provide updated PDR Direct Telemetry Requirements.
8	832	5/29/2015	PRR 832 – Changes to Section 6.2.2 to add language regarding PDR Timing Requirements.
7	821	3/26/2015	PRR 821 - Added deadline for Wind/Solar site information form to paragraphs 13.4.2 and 13.5.4. Corrected reference to solar in paragraph 13.5.4. Removed Tables 13.4.2 and 13.5.4. Updated link for Network Connectivity Security Requirements and ECN Agreement in Section 10.6.
6	770	8/06/2014	Added clarifying language and site information form links to section 13 Eligible Intermittent Resources (EIR), subsections 13.1 to 13.5 and combined sections 13.6 with 13.5. Added updated language to section 10. FNM Database Process and RIG Installation
5	726	4/03/2014	Added language to section 6.10 exempting DRP's from the RIG aggregation location limitation in the provision of

Version	PRR	Date	Description
			real-time telemetry data for Proxy Demand Resources (PDR) (PRR 726)
4	719/725	3/21/2014	Added clarifying language indicating that Reliability Demand Response Resources (RDRR) are not required to provide telemetry and therefore exempt from direct telemetry requirements to section 2.1 (PRR 725)
3	633	11/14/2012	Removal of the Full Network Model time line guide and changes to EIR less than 10MW.
2	489	12/14/2011	Added requirement for data quality flag propagation as new Section 6.8, added requirement for preliminary revenue metering package to Section 10.2, removed unnecessary definitions from Section 4, and made changes to ISP circuit exceptions in Section 5.3 per BPM PRR 489. Effective Date 12/01/11.
1		8/02/2011	Initial BPM submittal document

TABLE OF CONTENTS

1. Introduction..... 2417

1.1 Purpose of CAISO Business Practice Manuals..... 2417

1.2 Purpose of This Business Practice Manual..... 2417

1.3 Organization of This Business Practice Manual..... 2417

1.4 References..... 2518

2. CAISO Direct Telemetry..... 2924

2.1 Direct Telemetry Process..... 2924

2.2 Real-Time Device Defined..... 2924

2.2.1 Remote Intelligence Gateway (RIG) Historically..... 3022

2.2.2 Data Processing Gateway (DPG) Deprecated..... 3022

2.2.3 RIG Re-characterized as Real-Time Device..... 3022

2.3 Installation and Validation of Direct Telemetry..... 3223

2.4 Flow of Real-Time Data..... 3324

3. CAISO Responsibilities..... 3526

3.1 Overview of CAISO Responsibilities..... 3526

3.2 Exceptions to Direct Telemetry..... 3526

3.3 Direct Telemetry Validation..... 3627

3.3.1 Overview of Telemetry Installation Validation Process..... 3627

3.3.2 CAISO Certification Responsibilities..... 3929

3.3.3 Documentation Requirements..... 3929

3.3.4 CAISO Review of Documentation..... 4134

4. Communications..... 4232

4.1 Overview of Communications Objectives..... 4232

4.2 Choice of Connection Methods..... 4232

4.3 Communication Context Diagram..... 4333

4.4 Main Communication Options..... 4635

4.5 Detailed Communication Options..... 4635

4.6	Ruggedized Gateway Available	5039
4.7	CAISO Security for Direct Telemetry	5139
4.7.1	Data Confidentiality	5139
4.7.2	Network Security Principles and Best Practices	5140
4.7.3	Communication Security Characteristics	5241
4.7.4	Communication Security Protocols	5443
4.7.5	Communication and Network Documents	5544
4.7.6	Connected Entity Service Guides	5644
4.8	Reliability	5745
4.8.1	Redundant Circuits	5745
4.8.2	Data Validation	5745
4.8.3	Voice Communications	5746
4.8.4	Communications During Telemetry Failure	5746
5.	Operational Telemetry Requirements	5847
5.1	Unit Telemetry Visibility	5847
5.2	Performance Monitoring	5847
5.2.1	Direct Telemetry Timing Requirements	5847
5.2.2	PDR Timing Requirements	5948
5.2.3	PDR Reading Requirements	6049
5.3	CAISO Real-Time Communication Technical Design Options	6049
5.3.1	Functional Components of Real-Time Communication Options	6150
5.3.2	Transport Options	6251
5.3.3	Transport Conceptual Diagrams	6352
5.3.4	Direct Telemetry Hardware Options	6757
5.4	CAISO EMS Interrogations	7662
5.5	DNP3 Object and Variation Types for Real-Time Device Responses	7662
5.6	Quality Flag Propagation to DNP3	7864
5.7	Maximum MW Real-Time Device Limitation	7965

5.8 Real-Time Device Location Requirements 8065

5.9 Real-Time Device Market Resource Limitation 8066

5.10 Cost Responsibility..... 8066

6. Telemetry Data Points List 8167

6.1 Point Matrix 8167

6.2 Analog and Digital Notes 8975

7. Availability and Maintenance 9176

7.1 CAISO Reliability Requirements..... 9176

7.2 CAISO-Controlled Grid Operation and Market Availability Requirement..... 9176

7.3 Real-Time Device Operation and Maintenance 9277

7.3.1 Coordination of Changes to the Real-Time Device..... 9277

7.3.2 Database Configuration and Management Affecting the CAISO's EMS 9479

7.3.3 Routine Testing and Maintenance of Real-Time Devices..... 9579

8. Real-Time Device Implementation 9684

8.1 Engineering and Deployment 9684

8.2 Real-Time Device Database Development 9684

8.3 Telecommunication Circuit Installation and Power Requirements..... 9684

8.4 Temporary Telemetry Exemptions 9684

9. FNM Database Process and Real-Time Installation 10486

9.1 CAISO FNM Database Process 10486

9.2 New Database Submission..... 10486

9.2.1 Standards to Submit Real-Time Device Database for CAISO Database
Build 10486

9.3 Real-Time Database Submittal Timeline 10486

9.4 Network Physical Circuit Protection to the Resource 10486

9.5 Network Circuit Provisioning and Monitoring..... 10486

9.5.1 AT&T ECN or ANIRA IPsec VPN 10486

9.5.2 Self-Maintained Network and Circuit Monitoring 10587

9.6 Standards for Point-to-Point Testing with the CAISO	10587
9.7 Required Personnel for Point testing	10688
9.8 Real-Time Device Data Validation.....	10789
9.9 Upgrade or Replacement of a Real-Time Device	10789
9.10 Outage Management for Meter or Real-Time Device work	10789
9.11 Digital Certificates	10890
9.12 Wind and Solar FNM Documentation Required	11091
10. AGC Operational Requirements for Generating Units.....	11193
10.1 Required DNP3 and Telemetry Data Points for AGC	11193
10.2 AGC Control (Bumpless Transfer).....	11193
11. Eligible Intermittent Resources (EIR).....	11395
11.1 Applicability	11395
11.2 Power Reliability Requirements.....	11395
11.3 Basic Meteorological Data	11395
11.3.1 Meteorological Wind Speed	11395
11.3.2 Meteorological Wind Direction	11395
11.3.3 Meteorological Barometric Pressure	11395
11.3.4 Meteorological Ambient Temperature	11496
11.4 Wind Generation	11496
11.4.1 Meteorological Station Requirements.....	11496
11.4.2 Designated Turbines.....	11496
11.5 Solar Generation	11496
11.5.1 Meteorological Station Requirements.....	11496
11.5.2 Basic Solar Meteorological Data.....	11597
11.5.3 Participating Generator Irradiance Component Requirements	11597
11.5.4 Solar Technology Definitions	11597
11.5.5 Solar Site Information Form and Topographical Map	11698
12. Proxy Demand Resource (PDR).....	11799

12.1	PDR Point Requirements.....	11799
12.1.1	Real Load MW	11799
12.1.2	PDR Unit Connectivity Status (PDR UCON)	11799
12.1.3	Bias Load MW	11799
12.1.4	Pseudo Generation MW.....	11799
12.1.5	Statuses and Pseudo Generation Flow	118400
12.2	Timing and Configuration Requirements	120402
12.3	Analog Data Requirements.....	120402
12.3.1	Real Load (MW)	120402
12.3.2	Pseudo Generation (MW)	120402
12.4	Digital Data Requirements	124405
12.4.1	Load Unit Connectivity Status (LOAD UCON)	124405
12.5	PDR Unit Connectivity Status (PDR UCON)	125406
13.	Real-Time Device Aggregator	127408
13.1	Applicability	127408
13.2	Real-Time Device Aggregator Responsibility	127408
13.3	Real-Time Device Aggregator Authorization	127408
14.	Real-Time Point Definitions.....	128409
14.1	Analog Values	128409
14.1.1	Unit Gross Megawatts (Gross MW)	128409
14.1.2	Unit Net Megawatts (Net MW)	128409
14.1.3	Unit Point of Delivery Megawatts (POD MW)	129440
14.1.4	Unit Auxiliary Load Megawatts (Aux MW)	129440
14.1.5	Gross Reactive Power or Gross Mega VAR (MVAR)	130441
14.1.6	Point of Delivery Mega VAR (POD MVAR)	130441
14.1.7	Net Reactive Power (Net MVAR).....	131442
14.1.8	Auxiliary Load Reactive Power (Aux MVAR).....	131442
14.1.9	Generating Unit Terminal Voltage (KV)	131442

	14.1.10 Unit Operating High Limit (UOHL) [AGC Units Only]	132143
	14.1.11 Unit Operating Lower Limit (UOLL) [AGC Units Only]	132143
	14.1.12 Governor Droop Setting	133144
	14.1.13 Governor Dead band.....	133144
	14.1.14 Operating Ramp Rates	134145
	14.1.15 High Sustainable Limit (HSL).....	134145
	14.2 Digital Values	135146
	14.2.1 Unit Generator Breaker.....	135146
	14.2.2 Unit Connectivity Status (UCON).....	135146
	14.2.3 Unit Control Status (UCTL).....	136147
	14.2.4 CAISO Unit Authority Switch (UASW).....	136147
	14.2.5 Unit Automatic Generation Control (UAGC).....	137148
Status	14.2.6 Automatic Voltage Regulator (AVR) / Power System Stabilizer (PSS)	137148
	14.2.7 Governor Blocking status.....	138149
	14.3 Switchyard Values.....	139120
	14.3.1 Switchyard Line and Transformer MW and MVAR Values	139120
	14.3.2 Switchyard Bus Voltage	140120
	14.3.3 Switchyard Device Status	140121
	14.3.4 Aggregated Units	140121
	14.3.5 Aggregated Gross MW and MVAR.....	140121
	14.3.6 Aggregated Net MW and MVAR.....	141121
	14.3.7 Aggregated Aux MW and MVAR	141122
	14.3.8 Aggregated Point of Delivery MW	141122
	14.3.9 Aggregated Point of Delivery MVAR	141122
	14.3.10 Aggregated Unit Connectivity (UCON)	141122
	14.3.11 Aggregated Peaking Unit Start and Ready to Start.....	141122
	14.4 Wind and Solar Point Definitions	141122

14.4.1 Direct Irradiance (DIRD) 141122

14.4.2 Global Horizontal Irradiance (GHIRD/GHI) 142122

14.4.3 Global Irradiance / Plane of Array Irradiance (PAIRD)..... 142123

14.4.4 Diffused Irradiance 142123

14.4.5 Back Panel Temperature (BPTMP) 142123

14.4.6 VER Megawatts (VERMW)..... 142123

14.5 Battery Point Definitions..... 143124

14.5.1 Instantaneous State Of Charge (SOC)..... 143124

14.5.2 Maximum Continuous Energy limit 143124

14.5.3 Battery Energy Storage System (BESS) MW..... 143124

1. Introduction 16

1.1 Purpose of ISO Business Practice Manuals 16

1.2 Purpose of This Business Practice Manual 16

1.3 Organization of This Business Practice Manual..... 16

1.4 References 17

2. ISO Direct Telemetry 20

2.1 Direct Telemetry Process..... 20

2.2 Real Time Device Defined 20

2.2.1 Remote Intelligence Gateway (RIG) Historically 21

2.2.2 Data Processing Gateway (DPG) Deprecated 21

2.2.3 RIG Re-characterized as Real Time Device 21

2.3 Installation and Validation of Direct Telemetry 22

2.4 Flow of Real Time Data 23

3. ISO Responsibilities 25

3.1 Overview of ISO Responsibilities..... 25

3.2 Exceptions to Direct Telemetry..... 25

3.3 Direct Telemetry Validation..... 25

3.3.1 Overview of Telemetry Installation Validation Process 26

Formatted: Default Paragraph Font, Font: Bold

Formatted: Default Paragraph Font, Font: Bold

Formatted: Default Paragraph Font

Formatted: Default Paragraph Font

Formatted: Default Paragraph Font

Formatted: Default Paragraph Font

Formatted: Default Paragraph Font

Formatted: Default Paragraph Font

Formatted: Default Paragraph Font

Formatted: Default Paragraph Font

Formatted: Default Paragraph Font, Font: Bold

Formatted: Default Paragraph Font, Font: Bold

Formatted: Default Paragraph Font

Formatted: Default Paragraph Font

Formatted: Default Paragraph Font

Formatted: Default Paragraph Font

Formatted: Default Paragraph Font

Formatted: Default Paragraph Font

Formatted: Default Paragraph Font

Formatted: Default Paragraph Font

Formatted: Default Paragraph Font

Formatted: Default Paragraph Font

Formatted: Default Paragraph Font

Formatted: Default Paragraph Font

Formatted: Default Paragraph Font

Formatted: Default Paragraph Font, Font: Bold

Formatted: Default Paragraph Font, Font: Bold

Formatted: Default Paragraph Font

Formatted: Default Paragraph Font

Formatted: Default Paragraph Font

Formatted: Default Paragraph Font

Formatted: Default Paragraph Font

Formatted: Default Paragraph Font

Formatted: Default Paragraph Font

3.3.2	ISO Certification Responsibilities.....	28	Formatted	...
3.3.3	Documentation Requirements.....	28	Formatted	...
3.3.4	ISO Review of Documentation.....	30	Formatted	...
4.	Communications.....	31	Formatted	...
4.1	Overview of Communications Objectives.....	31	Formatted	...
4.2	Choice of Connection Methods.....	31	Formatted	...
4.3	Communication Context Diagram.....	32	Formatted	...
4.4	Main Communication Options.....	34	Formatted	...
4.5	Detailed Communication Options.....	34	Formatted	...
4.6	Ruggedized Gateway Available.....	38	Formatted	...
4.7	ISO Security for Direct Telemetry.....	39	Formatted	...
4.7.1	Data Confidentiality.....	39	Formatted	...
4.7.2	Network Security Principles and Best Practices.....	39	Formatted	...
4.7.3	Communication Security Characteristics.....	40	Formatted	...
4.7.4	Communication Security Protocols.....	42	Formatted	...
4.7.5	Communication and ECN Agreements.....	42	Formatted	...
4.7.6	Connected Entity Service Guides.....	43	Formatted	...
4.8	Reliability.....	44	Formatted	...
4.8.1	Redundant Circuits.....	44	Formatted	...
4.8.2	Data Validation.....	44	Formatted	...
4.8.3	Voice Communications.....	45	Formatted	...
4.8.4	Communications During Telemetry Failure.....	45	Formatted	...
5.	Operational Telemetry Requirements.....	46	Formatted	...
5.1	Unit Telemetry Visibility.....	46	Formatted	...
5.2	Performance Monitoring.....	46	Formatted	...
5.2.1	Direct Telemetry Timing Requirements.....	46	Formatted	...
5.2.2	PDR Timing Requirements.....	47	Formatted	...
5.2.3	PDR Reading Requirements.....	48	Formatted	...

5.3 ISO Real-Time Communication Technical Design Options	48	Formatted	...
5.3.1 Functional Components of Real-Time Communication Options	49	Formatted	...
5.3.2 Transport Options	50	Formatted	...
5.3.3 Transport Conceptual Diagrams	50	Formatted	...
5.3.4 Direct Telemetry Hardware Options	55	Formatted	...
5.4 ISO EMS Interrogations	59	Formatted	...
5.5 DNP3 Object and Variation Types for Real-Time Device Responses	60	Formatted	...
5.6 Quality Flag Propagation to DNP3	60	Formatted	...
5.7 Maximum MW Real-Time Device Limitation	64	Formatted	...
5.8 Real-Time Device Location Requirements	62	Formatted	...
5.9 Real-Time Device Market Resource Limitation	62	Formatted	...
5.10 Cost Responsibility	62	Formatted	...
6. Telemetry Data Points List	63	Formatted	...
6.1 Point Matrix	63	Formatted	...
6.2 Analog and Digital Notes	70	Formatted	...
7. Availability and Maintenance	74	Formatted	...
7.1 ISO Reliability Requirements	71	Formatted	...
7.2 ISO-Controlled Grid Operation and Market Availability Requirement	71	Formatted	...
7.3 Real-Time Device Operation and Maintenance	72	Formatted	...
7.3.1 Coordination of Changes to the Real-Time Device	72	Formatted	...
7.3.2 Database Configuration and Management Affecting the ISO's EMS	74	Formatted	...
7.3.3 Routine Testing and Maintenance of Real-Time Devices	74	Formatted	...
8. Real-Time Device Implementation	76	Formatted	...
8.1 Engineering and Deployment	76	Formatted	...
8.2 Real-Time Device Database Development	76	Formatted	...
8.3 Telecommunication Circuit Installation and Power Requirements	76	Formatted	...
8.4 Temporary Telemetry Exemptions	76	Formatted	...
9. FNM Database Process and Real-Time Installation	80	Formatted	...

9.1 ISO FNM Database Process	80	Formatted	...
9.2 New Database Submission.....	80	Formatted	...
9.2.1 Standards to Submit Real-Time Device Database for ISO Database Build ...	80	Formatted	...
9.3 Real-Time Database Submittal Timeline	80	Formatted	...
9.4 Network Physical Circuit Protection to the Resource.....	80	Formatted	...
9.5 Network Circuit Provisioning and Monitoring.....	80	Formatted	...
9.5.1 AT&T ECN or ANIRA IPsec VPN	80	Formatted	...
9.5.2 Dispersive™ CSDN.....	81	Formatted	...
9.5.3 Self-Maintained Network and Circuit Monitoring	81	Formatted	...
9.6 Standards for Point-to-Point Testing with the ISO	81	Formatted	...
9.7 Required Personnel for Point testing.....	83	Formatted	...
9.8 Real-Time Device Data Validation.....	83	Formatted	...
9.9 Upgrade or Replacement of a Real Time Device	83	Formatted	...
9.10 Outage Management for Meter or Real-Time Device work	84	Formatted	...
9.11 Digital Certificates	85	Formatted	...
9.12 Wind and Solar FNM Documentation Required	86	Formatted	...
10. AGC Operational Requirements for Generating Units.....	87	Formatted	...
10.1 Required DNP3 and Telemetry Data Points for AGC	87	Formatted	...
10.2 AGC Control (Bumpless Transfer).....	87	Formatted	...
11. Eligible Intermittent Resources (EIR).....	89	Formatted	...
11.1 Applicability	89	Formatted	...
11.2 Power Reliability Requirements.....	89	Formatted	...
11.3 Basic Meteorological Data	89	Formatted	...
11.3.1 Meteorological Wind Speed	89	Formatted	...
11.3.2 Meteorological Wind Direction.....	89	Formatted	...
11.3.3 Meteorological Barometric Pressure	89	Formatted	...
11.3.4 Meteorological Ambient Temperature	89	Formatted	...
11.4 Wind Generation	90	Formatted	...

11.4.1 Meteorological Station Requirements.....	90	Formatted	...
11.4.2 Designated Turbines.....	90	Formatted	...
11.5 Solar Generation.....	90	Formatted	...
11.5.1 Meteorological Station Requirements.....	90	Formatted	...
11.5.2 Basic Solar Meteorological Data.....	91	Formatted	...
11.5.3 Participating Generator Irradiance Component Requirements.....	91	Formatted	...
11.5.4 Solar Technology Definitions.....	91	Formatted	...
11.5.5 Solar Site Information Form and Topographical Map.....	92	Formatted	...
12. Proxy Demand Resource (PDR).....	93	Formatted	...
12.1 PDR Point Requirements.....	93	Formatted	...
12.1.1 Real Load MW.....	93	Formatted	...
12.1.2 PDR Unit Connectivity Status (PDR UCON).....	93	Formatted	...
12.1.3 Bias Load.....	93	Formatted	...
12.1.4 PDR Unit Ready to Start and Start Status.....	93	Formatted	...
12.1.5 Pseudo Generation MW.....	93	Formatted	...
12.1.6 Statuses and Pseudo Generation Flow.....	94	Formatted	...
12.2 Timing and Configuration Requirements.....	96	Formatted	...
12.3 Analog Data Requirements.....	96	Formatted	...
12.3.1 Instantaneous Load (MW).....	96	Formatted	...
12.3.2 Pseudo Generation (MW).....	96	Formatted	...
12.4 Digital Data Requirements.....	99	Formatted	...
12.4.1 Load Unit Connectivity Status (LOAD UCON).....	99	Formatted	...
12.5 PDR Unit Connectivity Status (PDR UCON).....	100	Formatted	...
13. Real-Time Device Aggregator.....	102	Formatted	...
13.1 Applicability.....	102	Formatted	...
13.2 Real-Time Device Aggregator Responsibility.....	102	Formatted	...
13.3 Real-Time Device Aggregator Authorization.....	102	Formatted	...
14. Real-Time Point Definitions.....	103	Formatted	...

14.1	Analog Values	103	Formatted	...
14.1.1	Unit Gross Megawatts (Gross MW)	103	Formatted	...
14.1.2	Unit Net Megawatts (Net MW)	103	Formatted	...
14.1.3	Unit Point of delivery Megawatts (POD MW)	104	Formatted	...
14.1.4	Unit Auxiliary Load Megawatts (Aux MW)	104	Formatted	...
14.1.5	Gross Reactive Power or Gross Mega VAR (MVAR)	105	Formatted	...
14.1.6	Point of delivery Mega VAR (POD MVAR)	105	Formatted	...
14.1.7	Net Reactive Power (Net MVAR)	105	Formatted	...
14.1.8	Auxiliary Load Reactive Power (Aux MVAR)	106	Formatted	...
14.1.9	Generating Unit Terminal Voltage (KV)	106	Formatted	...
14.1.10	Unit Operating High Limit (UOHL) [AGC Units Only]	107	Formatted	...
14.1.11	Unit Operating Lower Limit (UOLL) [AGC Units Only]	107	Formatted	...
14.2	Digital Values	107	Formatted	...
14.2.1	Unit Generator Breaker	107	Formatted	...
14.2.2	Unit Connectivity Status (UCON)	108	Formatted	...
14.2.3	Unit Control Status (UCTL)	108	Formatted	...
14.2.4	ISO Unit Authority Switch (UASW)	109	Formatted	...
14.2.5	Unit Automatic Generation Control (UAGC)	109	Formatted	...
14.2.6	Automatic Voltage Regulator (AVR) / Power System Stabilizer (PSS)		Formatted	...
Status	110			
14.2.7	Peaking Unit Ready to Start and Start Statuses	110	Formatted	...
14.3	Switchyard Values	110	Formatted	...
14.3.1	Switchyard Line and Transformer MW and MVAR Values	111	Formatted	...
14.3.2	Switchyard Bus Voltage	111	Formatted	...
14.3.3	Switchyard Device Status	111	Formatted	...
14.3.4	Aggregated Units	112	Formatted	...
14.3.5	Aggregated Gross MW and MVAR	112	Formatted	...
14.3.6	Aggregated Net MW and MVAR	112	Formatted	...

~~14.3.7 Aggregated Aux MW and MVAR 112~~

~~14.3.8 Aggregated Point of Delivery MW 112~~

~~14.3.9 Aggregated Point of Delivery MVAR 112~~

~~14.3.10 Aggregated Unit Connectivity (UCON) 112~~

~~14.3.11 Aggregated Peaking Unit Start and Ready to Start 112~~

~~14.4 Wind and Solar Point Definitions 113~~

~~14.4.1 Direct Irradiance (DIRD) 113~~

~~14.4.2 Global Horizontal Irradiance (GHIRD/GHI) 113~~

~~14.4.3 Global Irradiance / Plane of Array Irradiance (PAIRD) 113~~

~~14.4.4 Diffused Irradiance 113~~

~~14.4.5 Back Panel Temperature (BPTMP) 114~~

~~14.5 Battery Point Definitions 114~~

~~14.5.1 Instantaneous State Of Charge (SOC) 114~~

~~14.5.2 Maximum Continuous Energy limit 114~~

~~15. Sub-LAP Resource Names 115~~

- Formatted: Default Paragraph Font
- Formatted: Default Paragraph Font
- Formatted: Default Paragraph Font
- Formatted: Default Paragraph Font
- Formatted: Default Paragraph Font
- Formatted: Default Paragraph Font
- Formatted: Default Paragraph Font
- Formatted: Default Paragraph Font
- Formatted: Default Paragraph Font
- Formatted: Default Paragraph Font
- Formatted: Default Paragraph Font
- Formatted: Default Paragraph Font
- Formatted: Default Paragraph Font
- Formatted: Default Paragraph Font
- Formatted: Default Paragraph Font
- Formatted: Default Paragraph Font
- Formatted: Default Paragraph Font
- Formatted: Default Paragraph Font
- Formatted: Default Paragraph Font
- Formatted: Default Paragraph Font
- Formatted: Default Paragraph Font
- Formatted: Default Paragraph Font, Font: Bold
- Formatted: Default Paragraph Font, Font: Bold

EXHIBITS AND TABLES

Exhibit 2-1: Overview of Telemetry Installation and Validation..... 3224

Exhibit 2-2: Overview of Real-Time Telemetry Data Flow 3425

Exhibit 3-1: Telemetry Installation Validation Process..... 3728

Exhibit 4-1: Context Diagram for Communications Options for Direct Telemetry 4434

Table 4-2: Main Requirements for Each Communication Option for Direct Telemetry 4635

Table 4-3: Detailed Comparison of Communication Options for Direct Telemetry 4736

Exhibit 5-1: Timing of Telemetered Real-Time Data for Generators Providing Ancillary Services
or Energy Only through a Real-Time Device 5948

Exhibit 5-2: PDR Timing, 5- Minute Case 6049

Exhibit 5-3: Transport Option – ECN with T1 Leased Circuit..... 6453

Exhibit 5-4: Transport Option – Public Internet with ANIRA IPsec VPN Backhaul to ECN..... 6655

Exhibit 5-7: Plant Control System Hardware Option 6858

Exhibit 5-8: Plant Control System Hardware Option Functional Diagram 7059

Exhibit 5-9: Real-Time Device Hardware Option 7260

Exhibit 5-10: Real-Time Device Hardware Option Functional Diagram 7461

Exhibit 5-11: Upstream and Downstream Device Identification..... 7964

Table 6-1: Required Real-Time Points by Technology or Service..... 8267

Exhibit 7-1: Operation and Maintenance Boundaries 9276

Table 12-1: Sequence of ADS Signal for PDR..... 11898

Exhibit 12-2: Calculations for Pseudo Generation 11999

Exhibit 12-3: PDR UCON Status Flowchart 122102

Exhibit 12-4: Load UCON Status Flowchart..... 124103

Exhibit 12-5: PDR UCON Status Flowchart 126105

Table 15-1: Sub-LAP Resource Names..... 144123

~~Exhibit 2-1: Overview of Telemetry Installation and Validation..... 23~~

~~Exhibit 2-2: Overview of Real-Time Telemetry Data Flow..... 24~~

~~Exhibit 3-1: Telemetry Installation Validation Process..... 27~~

Formatted: Default Paragraph Font, Check spelling and grammar

Formatted: Default Paragraph Font, Check spelling and grammar

Formatted: Default Paragraph Font, Check spelling and grammar

Exhibit 4-1: Context Diagram for Communications Options for Direct Telemetry	33
Table 4-2: Main Requirements for Each Communication Option for Direct Telemetry	34
Table 4-3: Detailed Comparison of Communication Options for Direct Telemetry	35
Exhibit 5-1: Timing of Telemetered Real Time Data for Generators Providing Ancillary Services or Energy Only through a Real Time Device	47
Exhibit 5-2: PDR Timing, 5- Minute Case	48
Exhibit 5-3: Transport Option—ECN with T1 Leased Circuit.....	51
Exhibit 5-4: Transport Option—Public Internet with ANIRA IPsec VPN Backhaul to ECN.....	52
Exhibit 5-5: Transport Option—Public Internet with Dispersive™ CISDN	53
Exhibit 5-6: Dispersive™ CISDN Hardware Option	55
Exhibit 5-7: Plant Control System Hardware Option.....	56
Exhibit 5-8: Plant Control System Hardware Option Functional Diagram	57
Exhibit 5-9: Real Time Device Hardware Option	58
Exhibit 5-10: Real Time Device Hardware Option Functional Diagram	58
Exhibit 5-11: Upstream and Downstream Device Identification.....	61
Table 6-1: Required Real Time Points by Technology or Service.....	64
Exhibit 7-1: Operation and Maintenance Boundaries	72
Table 11-1: Meteorological Elements, Devices, Units, and Accuracy	Error! Bookmark not defined.
Table 11-2: Minimum Required (R) Measurement of Solar Irradiance and Backplane Temperature	Error! Bookmark not defined.
Table 12-1: Sequence of ADS Signal for PDR.....	94
Exhibit 12-2: Calculations for Pseudo Generation	95
Exhibit 12-3: PDR UCON Status Flowchart	98
Exhibit 12-4: Load UCON Status Flowchart.....	99
Exhibit 12-5: PDR UCON Status Flowchart	101
Table 15-1: Sub-LAP Resource Names	115

Formatted: Default Paragraph Font, Check spelling and grammar

Formatted: Default Paragraph Font, Check spelling and grammar

Formatted: Default Paragraph Font, Check spelling and grammar

Formatted: Default Paragraph Font, Check spelling and grammar

Formatted: Default Paragraph Font, Check spelling and grammar

Formatted: Default Paragraph Font, Check spelling and grammar

Formatted: Default Paragraph Font, Check spelling and grammar

Formatted: Default Paragraph Font, Check spelling and grammar

Formatted: Default Paragraph Font, Check spelling and grammar

Formatted: Default Paragraph Font, Check spelling and grammar

Formatted: Default Paragraph Font, Check spelling and grammar

Formatted: Default Paragraph Font, Check spelling and grammar

Formatted: Default Paragraph Font, Check spelling and grammar

Formatted: Default Paragraph Font, Check spelling and grammar

Formatted: Default Paragraph Font, Check spelling and grammar

Formatted: Default Paragraph Font, Check spelling and grammar

Formatted: Default Paragraph Font, Check spelling and grammar

Formatted: Default Paragraph Font, Check spelling and grammar

Formatted: Default Paragraph Font, Check spelling and grammar

Formatted: Default Paragraph Font, Check spelling and grammar

Formatted: Default Paragraph Font, Check spelling and grammar

Formatted: Default Paragraph Font, Check spelling and grammar

Formatted: Default Paragraph Font, Check spelling and grammar

Formatted: Default Paragraph Font, Check spelling and grammar

ACRONYMS

Refer to this table for acronyms used throughout this document.

ACRONYM	ACRONYM EXPANSION
ACL	Access Control List
ADS	Automated Dispatch System
AES	Advanced Encryption Standard
AGC	Automatic Generation Control
API	Application Programming Interface
AT&T	American Telephone and Telegraph
AVPN	AT&T Virtual Private Network
AVR	Automatic Voltage Regulator
BPM	Business Practice Manual
BPTEMP	Back Panel Temperature
CIP	Critical Infrastructure Protection
CISDN	Critical Infrastructure Software Defined Network
CSR	Certificate Signing Request
DDC	Direct Digital Control
DDoS	Distributed Denial of Service
DER	Distributed Energy Resource
DERA	Distributed Energy Resource Aggregate
DERP	Distributed Energy Resource Provider
DIFGH	Global Diffused Irradiance
DIRD	Direct Irradiance
DNI	Direct Normal Irradiance
DNP3	Distributed Network Protocol (Version 3)
DPOA	Diffused Plane of Array
DRP	Demand Response Provider
ECN	Energy Communication Network
EIR	Eligible Intermittent Resource
EIRP	Eligible Intermittent Resource Protocol
EMS	Energy Management System
FERC	Federal Energy Regulatory Commission

ACRONYM	ACRONYM EXPANSION
GHI	Global Horizontal Irradiance
GHIRD	Global Horizontal Irradiance
HVP	High Voltage Protection
IED	Intelligent Electronic Device
IEEE	Institute of Electrical and Electronics Engineers
IPSec	Internet Protocol Security
CAISO	California Independent System Operator
LAN	Local Area Network
LAP	Load Aggregation Point
LEC	Local Exchange Carrier
LIDAR	Light Detection and Ranging or Light Imaging, Detection, and Ranging
MitM	Machine in the Middle
MPLS	Multi-Protocol Label Switching
MOD	Motor Operated Disconnect
MPOE	Main Point of Entry
MWh	Megawatt Hours
NERC	North American Electric Reliability Corporation
NIST SP	National Institute of Standards and Technology Special Publication
O&M	Operation and Maintenance
OPC	Object Linking and Embedding for Process Control
PAIRD	Plane of Array Irradiance
PCMCIA	Personal Computer Memory Card International Association
PDR	Proxy Demand Resource
PKI	Public Key Infrastructure
PIR	Participating Intermittent Resource
POD	Point of Delivery
PSS	Power System Stabilizer
RDRR	Reliability Demand Response Resource
RFC	Request for Comment
RIG	Remote Intelligence Gateway
SaaS	Software as a Service
SCADA	Supervisory Control and Data Acquisition

ACRONYM	ACRONYM EXPANSION
SDN	Software-Defined Network
SD-WAN	Software-Defined Wide-Area Network
SOC	State Of Charge
SODAR	Sonic Detection And Ranging
SSL	Secure Sockets Layer
T1	Trunk Level 1
TCP	Transmission Control Protocol
TLS	Transport Layer Security
UAGC	Unit Automatic Generation Control
UASW	Unit Authority Switch
UCON	Unit Connectivity
UCTL	Unit Control Switch
UDP	User Datagram Protocol
UOHL	Unit Operating High Limit
UOLL	Unit Operating Lower Limit
VPN	Virtual Private Network
WAN	Wide Area Network
WECC	Western Electricity Coordinating Council
VER	Variable Energy Resource as defined by FERC
WON	WECC Operations Network
X.509	X.509 is not an acronym but refers to a format for digital certificates as described in RFC 5280

1. Introduction

The [CAISO](#)'s Business Practice Manual for Direct Telemetry provides implementation detail, consistent with the [CAISO](#) Tariff, for establishing Participating Generators to establish direct telemetry with the [CAISO](#)'s Energy Management System (EMS).

1.1 Purpose of [CAISO](#) Business Practice Manuals

The Business Practice Manuals (BPMs) developed by [ISOCAISO](#) are intended to contain implementation detail consistent with and supported by the [ISOCAISO](#) Tariff, including instructions, rules, procedures, examples, and guidelines for the administration, operation, planning, and accounting requirements of the [ISOCAISO](#) and [ISOCAISO](#) energy markets. See [ISOCAISO](#) Business Practice Manuals in References for a link to the BPM library. Updates to all BPMs are managed in accordance with [ISOCAISO](#) Change Management procedures.

1.2 Purpose of This Business Practice Manual

The BPM for Direct Telemetry covers the responsibilities of the [ISOCAISO](#), Participating Generators, Participating Loads, Proxy Demand Resources, and Scheduling Coordinators representing these entities for telemetry installation, validation, and maintenance, in addition to the telemetry data required.

The provisions of this BPM are intended to be consistent with the [ISOCAISO](#) Tariff. If any provisions of this BPM are found to be in conflict with the [ISOCAISO](#) Tariff, the [ISOCAISO](#) is nevertheless bound to operate in accordance with the [ISOCAISO](#) Tariff. Any summarization or repetition of any provision of the [ISOCAISO](#) Tariff in this BPM is intended only to aid understanding. Even though the [ISOCAISO](#) will make every effort to maintain the information contained in this BPM and to notify Market Participants of changes, it is the responsibility of every Market Participant to ensure compliance with the most recent version of this BPM and to comply with all applicable provisions of the [ISOCAISO](#) Tariff. Any reference in this BPM to the [ISOCAISO](#) Tariff, a given agreement, or any other BPM or instrument, is intended to refer to the [ISOCAISO](#) Tariff, that agreement, or BPM or instrument as modified, amended, supplemented, or restated.

The captions and headings in this BPM are intended solely to facilitate reference and not to have any bearing on the meaning of any of the terms and conditions.

1.3 Organization of This Business Practice Manual

This Business Practice Manual describes the responsibilities of the [ISOCAISO](#), Participating Generators, Participating Loads, Proxy Demand Resources, and Scheduling Coordinators representing these entities for provision of direct telemetry, including provisions for configuration, installation, and validation of telemetry facilities for resources providing Ancillary Services or Energy only, and for wind, solar, and Proxy Demand Resources.

1.4 References

The following table provides links and references used throughout this Business Practice Manual.

TOPIC	REFERENCE
AT&T Connected Entity Service Guide	https://www.aiso.com/Documents/EstablishECNConnectivity-ConnectedEntityServiceGuide.pdf
Acceptance Testing for Real- Time Devices	http://www.aiso.com/Documents/RIGAcceptanceTest_RAT_Procedures.pdf https://www.aiso.com/Documents/RIGAcceptanceTest_RAT_Procedures.pdf
Acceptance Testing for Real- Time Devices	http://www.aiso.com/Documents/RIGAcceptanceTest_RAT_Procedures.pdf
Certificate Practice Statement for Basic Assurance Certification Authority	http://www.aiso.com/Documents/CertificationPracticeStatement_BasicAssuranceCertificationAuthority.pdf https://www.aiso.com/Documents/CertificationPracticeStatement_BasicAssuranceCertificationAuthority.pdf
E-mail Addresses for Submitting a Certificate Signing Request	CertificateRequests@aiso.com EDAS@aiso.com
Fieldwork Appointment Request	http://www.aiso.com/fieldworksupport/Pages/default.aspx https://www.aiso.com/generation-transmission/metering-telemetry/fieldwork-support-requests http://www.aiso.com/Documents/FieldworkSupportRequests.pdf

Field Code Changed

Field Code Changed

Field Code Changed

Guide to Industrial Control Systems (ICS) Security	http://nvlpubs.nist.gov/nistpubs/SpecialPublications/NIST.SP.800-82r2.pdf https://nvlpubs.nist.gov/nistpubs/SpecialPublications/NIST.SP.800-82r2.pdf
ISO CAISO Business Practice Manuals	https://www.caiso.com/rules/Pages/BusinessPracticeManuals/Default.aspx https://www.caiso.com/legal-regulatory/business-practice-manuals
ISO CAISO Energy Data Acquisition Specialist E-mail Address	EDAS@caiso.com
ISO CAISO Energy Data Acquisition Specialist Phone Number	(916) 608-5826
ISO CAISO Tariff	https://www.caiso.com/rules/Pages/Regulatory/Default.aspx https://www.caiso.com/legal-regulatory/tariff
ISO CAISO documentation on Outage Coordination	http://www.caiso.com/market/Pages/OutageManagement/Default.aspx https://www.caiso.com/market-operations/outages
ISO CAISO Direct Telemetry Web Page	http://www.caiso.com/participate/Pages/MeteringTelemetry/Default.aspx https://www.caiso.com/generation-transmission/metering-telemetry
Information Security Requirements for the Energy Communication Network (ECN)	http://www.caiso.com/documents/californiaisoinformationsecurityrequirements-theenergycommunicationsnetwork.pdf

Field Code Changed

Field Code Changed

Field Code Changed

Field Code Changed

Field Code Changed

Network Connectivity Security Requirements and Agreement External Network Guidelines Document	https://www.caiso.com/Documents/EnergyCommunicationNetworkConnectivitySecurityRequirements-Agreement-RemoteIntelligentGatewayDevices.pdf http://www.caiso.com/Documents/ExternalNetworkGuidelines.docx https://www.caiso.com/Documents/ExternalNetworkGuidelines.docx
New Resource Implementation Contact	NewResourceImplementation@caiso.com
New Resource Implementation Timeline	http://www.caiso.com/participate/Pages/Generation/Default.aspx https://www.caiso.com/generation-transmission/generation/new-resource-implementation
Request Form for Digital Certificate for Real-Time Device	https://www.caiso.com/Documents/DeviceCertificateRequestForm.xls https://www.caiso.com/documents/device-certificate-request-form.xlsx
Solar Site Information Spreadsheet	http://www.caiso.com/Documents/SolarSiteInformation.xls https://www.caiso.com/Documents/solarsiteinformation.xlsx
Wind Site Information Spreadsheet	http://www.caiso.com/Documents/WindSiteInformation.xls https://www.caiso.com/documents/windsiteinformation.xlsx

Field Code Changed

Field Code Changed

2. ~~ISO~~CAISO Direct Telemetry

This section includes a description of the telemetry process, a diagram of the telemetry installation and validation process, and a diagram of the flow of telemetry data.

2.1 Direct Telemetry Process

This BPM sets forth requirements for the provision of real-time data to the ~~ISO~~CAISO applicable to all ~~Resources Generating Units of Participating Generators~~ providing Ancillary Services (including Regulation) or Energy in the ~~ISO~~CAISO's markets. This BPM describes the process and procedures used by the ~~ISO~~CAISO to obtain real-time data from the resources of Participating ~~Resources such as but not limited to:~~ Generators, ~~Storage~~, Participating Loads, Proxy Demand Resources, and Scheduling Coordinators representing these entities for operating the ~~ISO~~CAISO Balancing Authority Area reliably and balancing the ~~ISO~~CAISO's markets. This BPM does not apply to Reliability Demand Resources, which have no requirement to provide telemetry. This BPM does not apply to the Inter-Control Center Communications Protocol (ICCP – IEC60870-6 TASE.2) that utility Control Centers use exchange real-time data, schedule, and control commands.

~~A Generator with a Generating Unit~~Resource connected to the electric grid within the ~~ISO~~CAISO Balancing Authority Area that (1) has a capacity of ten (10) megawatts (MW) or greater and is not exempt pursuant to the ~~ISO~~CAISO Tariff, or (2) provides Ancillary Services, or (3) is an Eligible Intermittent Resource not exempt pursuant to the ~~ISO~~CAISO Tariff must install, in accordance with the requirements specified in this BPM, equipment and/or software that can interface with the ~~ISO~~CAISO's Energy Management System (EMS) to supply telemetered real-time data. Real-Time Devices, as defined below, will serve as the primary means for secure communications and direct control between the ~~Generator's Generating Unit~~Resource and the CAISO's EMS as a prerequisite for participation in any of the CAISO markets requiring real-time data. In some circumstances, the CAISO allows for aggregation of ~~Resources Generating Units~~ and the associated direct telemetry. While this BPM does not address all issues related to Aggregated Units, it does address the required points for Aggregated Units herein. The resources of Participating Loads and Proxy Demand Resources are also subject to these requirements for telemetry of real-time data.

2.2 Real-Time Device Defined

This Business Practice Manual uses the term Real-Time Device to refer to any DNP3-capable Intelligent Electronic Device (IED) that meets ~~ISO~~CAISO requirements for real-time data and has the ability to monitor processes, provide advanced local control intelligence, and communicate directly to a SCADA system or an EMS. DNP3 (Distributed Network Protocol, Version 3) refers to IEEE Standard 1815-2012 for Electric Power Systems Communications). A Real-Time Device

is a combination of software and ~~optionally~~ hardware that achieves ~~ISOCAISO~~ requirements for direct telemetry of a Participating ~~Generator~~ ~~Generator~~. -A Real-Time Device may also include power system protection functions. Types of Real-Time Devices include RTUs, Protection Systems, Load Profile Metering (Revenue Metering), PLCs, Load Balancers, SCADA systems, DNP3 protocol drivers, and database historians.

2.2.1 Remote Intelligence Gateway (RIG) Historically

Historically, the ~~ISOCAISO~~ has required a Participating ~~Generator-Resource~~ to install a Remote Intelligence Gateway (RIG) to provide direct telemetry. Conceptually, a RIG is a protocol converter and a security gateway to the ~~ISOCAISO~~'s EMS; for example, a RIG could convert DNP3 over serial to DNP3 over TCP/IP then encapsulate the result in an SSL/TLS tunnel. Some Participating ~~Generators-Resources~~ choose to provide their own RIGs and some choose to work with third parties that provide RIG engineering services. The ~~ISOCAISO~~ ~~had~~ ~~at one point~~ maintained on its Web site a list of third-party RIG engineering firms ~~and no longer does so~~. -The ~~ISOCAISO~~ does not endorse or certify any of the firms on this list, does not make any warranty or representation regarding these firms or their capability to provide engineering services related to a project, and has not restricted the Participating ~~Generator's-Resource's~~ selection of a firm to the firms on this list.

2.2.2 Data Processing Gateway (DPG) Deprecated

Historically, the ~~ISOCAISO~~ used a Data Processing Gateway (DPG) for non-AGC Generating Units and allowed DPG connections over both the ECN and the public Internet using SSL/TLS digital certificates issued by the ~~ISOCAISO~~. At the time, RIGs protected AGC Generating Units over the ECN only and used PCMCIA cards to provide the SSL channel.

Over time, RIGs adopted digital certificates instead of PCMCIA cards and the distinction between RIGs and DPGs blurred. RIG SCADA functionality also advanced compared to DPG SCADA functionality. Consequently, the ~~ISOCAISO~~ deprecated DPGs.

As participation in the ~~ISOCAISO~~ grew, branded RIGs served a valuable purpose in connecting more Participating ~~Generators-Resources~~ to the ~~ISOCAISO~~. - Now, with advances in technology, Participating ~~Generators-Resources~~ have more flexibility to implement a variety of devices that meet ~~ISOCAISO~~ security and operational objectives.

2.2.3 RIG Re-characterized as Real-Time Device

The ~~ISOCAISO~~ would like to provide Participating ~~Generators-Resources~~ as much flexibility as possible in connecting to the ~~ISOCAISO~~ EMS securely while meeting operational objectives for real-time telemetry. The ~~ISOCAISO~~ is also determined to lower barriers to entry for participation in ~~ISOCAISO~~ energy markets while ensuring the collection of accurate data. Accordingly, the ~~ISOCAISO~~ has re-characterized a RIG as any Real-Time Device that meets the security and operational objectives for direct telemetry.

The Real-Time Device is a system for collection and transmission of data between the [ISOCAISO](#)'s EMS and Participating [GeneratorsResources](#). These devices provide the ability, in real time, to collect data and distribute supervisory control commands to and from generators as well as transfer this data to and from multiple central monitoring and supervisory control sites. Data encryption assures confidentiality of participant data and also provides assurance that a Participating [Generator-Resource](#) reliably receives [ISOCAISO](#) SCADA instructions according to their participation agreements. Device security has typically relied on the [ISOCAISO](#)'s PKI and ECN, ~~but secure options are now available to Participating Generators over the public Internet without requirement for ISO-issued digital certificates that Participating Generators need to manage at installation, periodical renewal, or replacement.~~ Upon major changes in risk level such as SSL3 deprecation, the compromise of 1024-bit certificates, or the weakness of certificates signed using the SHA1 algorithm (all of which can be very impactful to Participating Generators). Historically, the [ISOCAISO](#) has required that Real-Time Devices communicate with the [ISOCAISO](#)'s EMS over the ECN. ~~With equivalent and even superior~~ security and reliability options now available over the public Internet, the [ISOCAISO](#) has expanded telemetry options, as described in this BPM.

With this recharacterization of RIG as a Real-Time Device:

- The [ISOCAISO](#) no longer maintains a list of validated RIGs that use standard real-time telemetry components.
- The [ISOCAISO](#) will accept any Real-Time Device that can connect through a TCP/IP connection to the [ISOCAISO](#)'s EMS using DNP3 Level 1 communications.
- The [ISOCAISO](#) no longer maintains a list of third-party RIG engineering firms.
- The [ISOCAISO](#) does not limit Participating [ResourcesGenerators](#) to a specific list of vendors.
- The [ISOCAISO](#) is open to any way of connecting to a Participating [Generator's Resource's](#) current control system and communication infrastructure to communicate to the [ISOCAISO](#) EMS as long as the Participating [Generator-Resource](#) meets the security and operational objectives for direct telemetry.

This BPM provides information regarding:


- The [ISOCAISO](#) installation requirements for Participating Generator facilities;
- How the [ISOCAISO](#) validates direct telemetry facilities for Participating [GeneratorsResources](#), Participating Loads, PDRs, and the SCs representing these entities; and


- Validation, testing, and maintenance requirements for direct telemetry for Participating [Generators' Resource](#) facilities participating in the [ISO-CAISO](#) markets.

2.3 Installation and Validation of Direct Telemetry

Exhibit 2-1 illustrates the process for telemetry installation and validation for a Participating [Generator Resource](#) that is required to provide real-time direct telemetry to the [ISO-CAISO](#).


Exhibit 2-1: Overview of Telemetry Installation and Validation

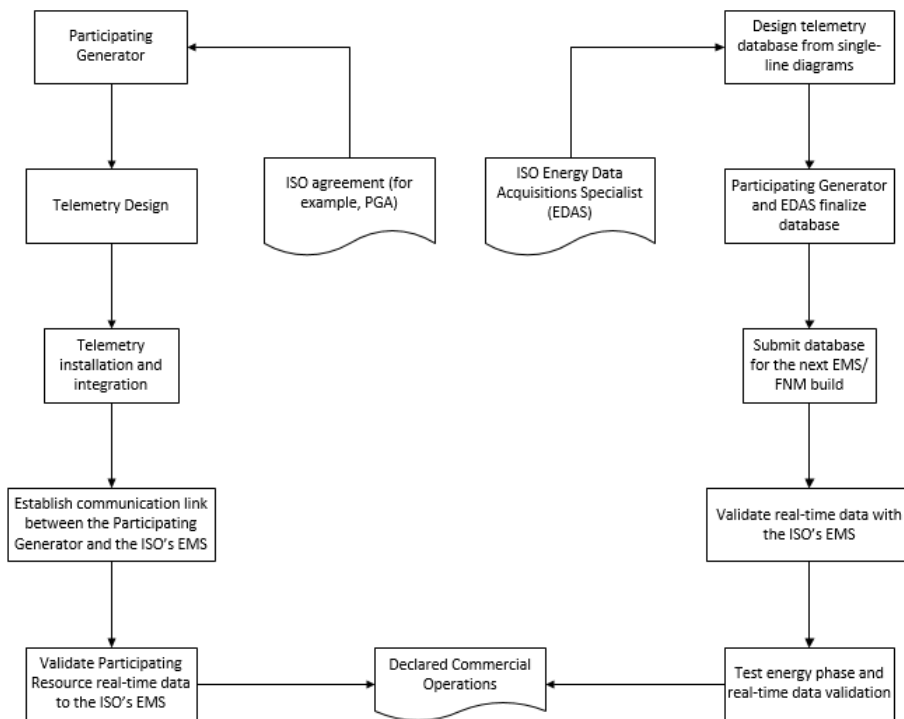

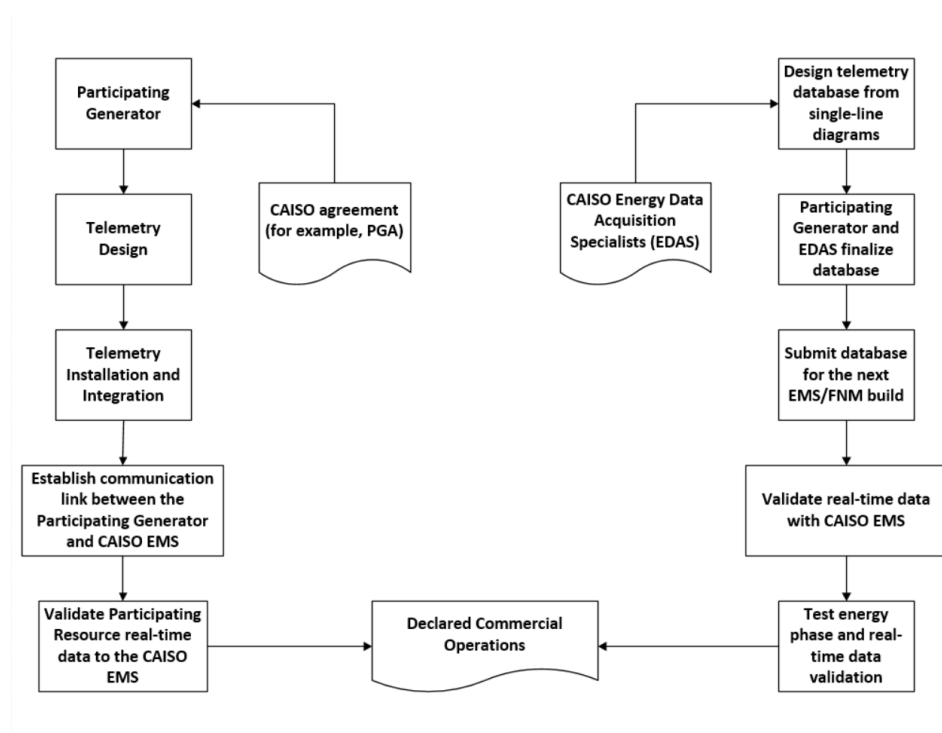

2.4 Flow of Real-Time Data

Exhibit 2-2 illustrates the flow of real-time telemetry data between resources and the [ISO CAISO](#)'s EMS and from the [ISO CAISO](#)'s EMS to other [ISO CAISO](#) systems.

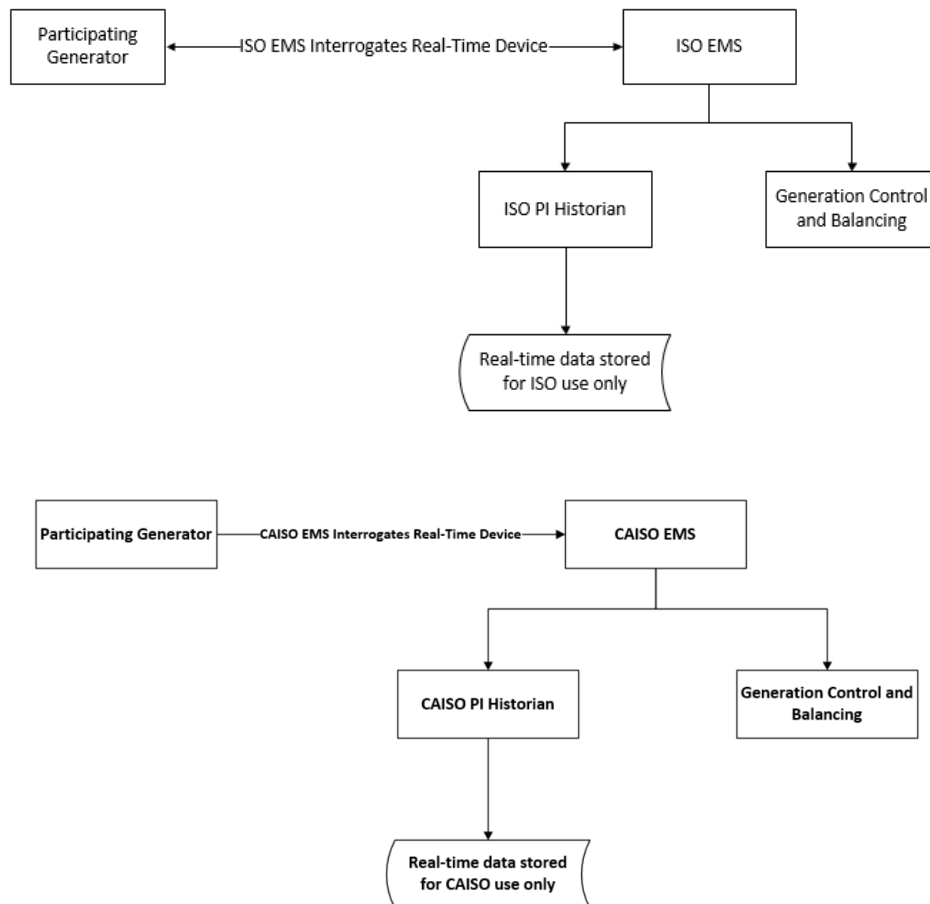Exhibit 2-2: Overview of Real-Time Telemetry Data Flow

3. **ISOCAISO Responsibilities**

This section provides an overview of **ISOCAISO** responsibilities:

- A description of the installation and point-to-point validation process for telemetry facilities;
- A description of the documentation requirements;
- A description of the testing and completion requirements.

3.1 Overview of **ISOCAISO** Responsibilities

Section 7.6.1(d) of the **ISOCAISO** Tariff gives the **ISOCAISO** the authority to direct operations of **Generating UnitsResources** required to control the **ISOCAISO**-Controlled Grid and to maintain reliability by ensuring that sufficient Energy and Ancillary Services are procured through **ISOCAISO** markets. This provision requires each Participating **Generator-Resource** to take, at the direction of the **ISOCAISO**, actions that the **ISOCAISO** determines are necessary to maintain the reliability of the **ISOCAISO**-Controlled Grid. Such actions include (but are not limited to) the provision of communications, telemetry and direct control requirements, including the establishment of a direct communication link from the control room of the **Generator-Resource** Facility to the **ISOCAISO** in a manner that ensures that the **ISOCAISO** will have the ability to direct the operations of the Generator as necessary to maintain the reliability of the **ISOCAISO**-Controlled Grid, except that a Participating **Generator-Generator** will be exempt from these requirements with regard to any **Generating-Conventional** Unit with a rated capacity of less than ten (10) MW, unless that **Generating** Unit is certified by the CAISO to provide Ancillary Services. Appendix Q of the CAISO Tariff describes the telemetry requirements for Eligible Intermittent Resources (EIR) (i.e. solar and wind) and Hybrid Resources with a renewable component of 1MW or larger. Appendix A of the CAISO Tariff under Participating **GeneratorGenerator** describes the threshold for telemetry being required from 0.5MW or larger (optional) and 1MW or larger..

3.2 Exceptions to Direct Telemetry


A Participating Generator will be exempt from requirements for direct telemetry for any Generating Unit with a rated capacity of less than 10MW, unless that Generating Unit is certified by the **ISOCAISO** to provide Ancillary Services. Appendix Q of the **ISOCAISO** Tariff describes the telemetry requirements for EIRs (solar and wind) and Hybrid Resources with a renewable component of 1MW or larger. Appendix A of the **ISOCAISO** Tariff defines the MW thresholds for a Participating Generator that an EIR resource that is less than 1.0MW and greater than 0.5MW has the option to participate in the **ISOCAISO** markets.


3.3 Direct Telemetry Validation

The ~~ISO~~CAISO has overall responsibility for validating real-time data collected through direct telemetry. The ~~ISO~~CAISO executes this responsibility partially through requirements placed on the Participating Generator (or aggregator), which may include responsibilities satisfied by the Scheduling Coordinator for the resource. This Section ~~3.2~~ summarizes the respective certification responsibilities of the ~~ISO~~CAISO and the Participating Generator (or aggregator, or SC, as applicable).

3.3.1 Overview of Telemetry Installation Validation Process

Exhibit 3-1 illustrates the overall validation process for telemetry facilities.

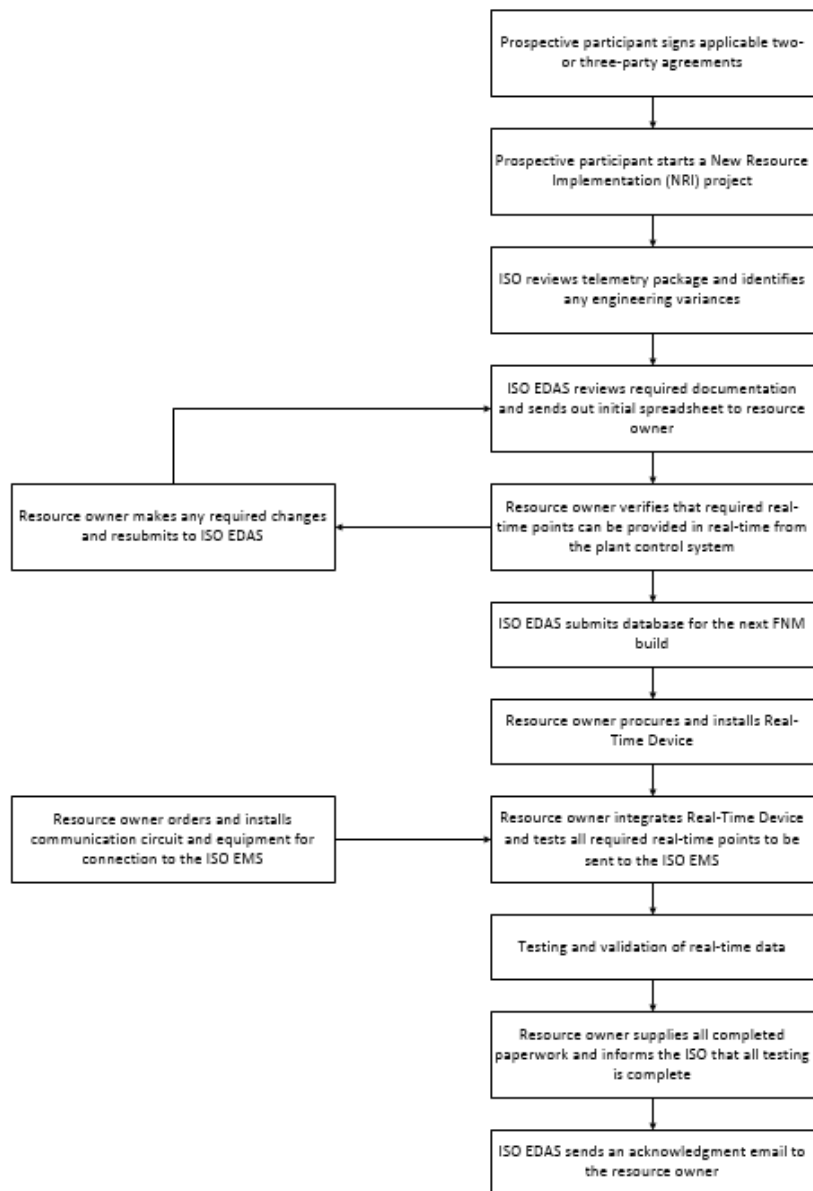Exhibit 3-1: Telemetry Installation Validation Process

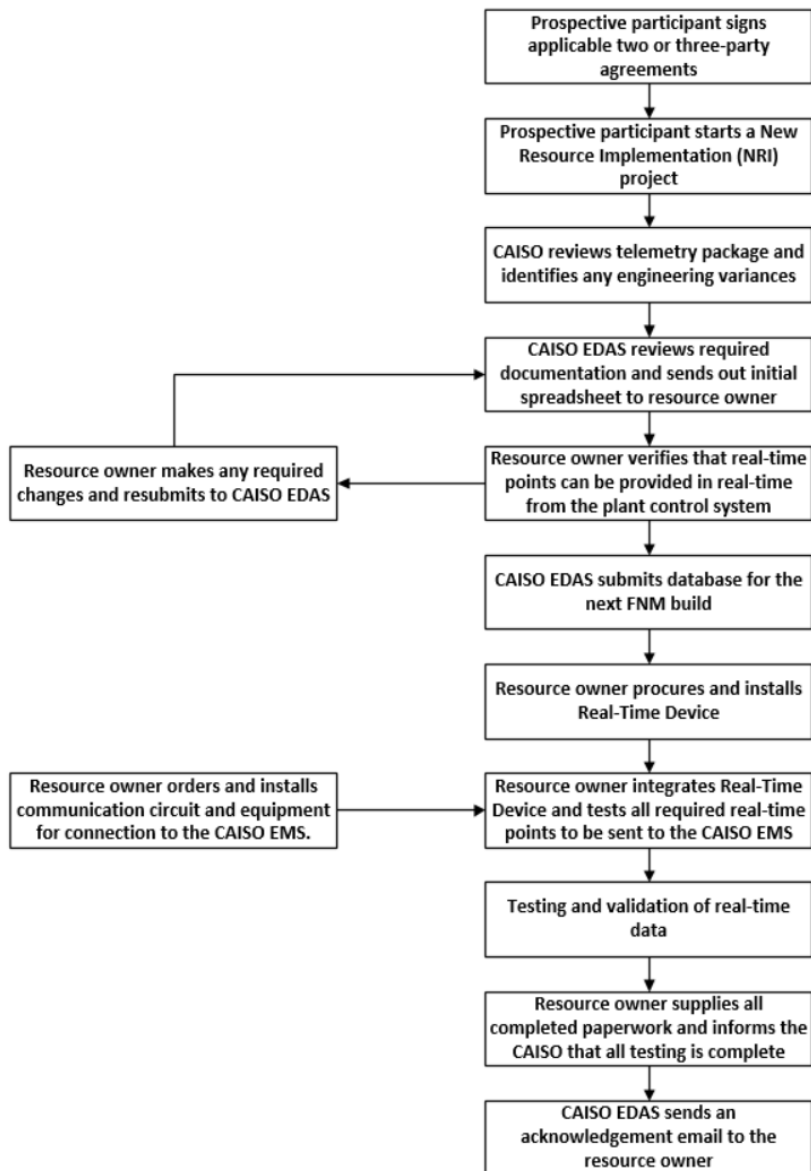

3.3.2 ISOCAISO Certification Responsibilities

The ISOCAISO does not accept real-time telemetry data from a resource unless that telemetry data is produced by telemetry facilities that have been validated in accordance with the ISOCAISO Tariff and this BPM.

3.3.3 Documentation Requirements

To initiate the submission process in the scheduled FNM build and for auditing purposes, the prospective Participating Generator must provide the following information through the NRI process:

Schematics

For Generating Units, the prospective Participating Generator must provide all single-line diagrams that depict the Generating Unit connecting to the ISOCAISO-Controlled Grid. Such drawings must be dated, bear the current drawing revision number, and show all wiring, connections, and generator equipment devices in the circuits.

Schematics requirements

Detailed station single-line drawings should show:

- How generators, transformers, and aux transformers are connected;
- All breaker and disconnect names, collection busses, showing ISOCAISO revenue meter, PT and CT locations;
- How the station is interconnected to the ISOCAISO-Controlled Grid.

These schematics must be of the type released for construction and stamped by an Electrical Professional Engineer; that is, the drawings are of a type used for electrical construction permitting purpose with the local permitting agency.

For existing Generator Units (Qualifying Facilities or conversions), all drawings will be as-built drawings depicting ISOCAISO revenue metering. The Participating Generator can hand-draw the new ISOCAISO revenue meter and any other information covered below for the purpose of fulfilling these requirements. The ISOCAISO cannot accept facsimile representations for revised drawings; the submitted revisions must include the original drawings as well as new as-built drawings with all modifications indicated and including an Electrical Professional Engineer stamp.

Other reference information is required but limited to:

Generator data

- MVA rating

Formatted: Normal, No bullets or numbering

-
- Rated power factor at Pmax
 - Nominal terminal voltage
 - Reactive power capability curve (limits)
 - Terminal voltage control target/range

Transformer Data

- MVA ratings (normal and emergency ratings in different seasons)
- Nominal voltages for all terminal sides
- Impedances (listing voltage base and MVA base where the impedance is calculated)
- LTC data (if applicable):
 - Max TAP and min TAP
 - Voltage control range
 - TAP step size and range
 - Normal TAP position

Generator Tie Data

- Line impedance
- MVA ratings (normal and emergency ratings in different seasons)

Breaker Data

- A breaker that is normally open must be shown in the diagram

Aux Load

- MW and Mvar level

Reactive support devices (shunt capacitor/reactor, SVC, synchronous condenser)

- Rated nominal voltage
- Rated Mvar capacity
- Number of banks and size of each bank if it has multiple banks
- Voltage control target/range
- Database submission process
- FNM build process
- Meter to Point of Delivery (POD), where the POD differs from the meter location

Additional Documentation

- See the NRI process under Resources for all additional document submission required to enter the FNM build.
- [Refer to the Metering and Telemetry webpage for a Checklist of Drawing Requirements.](#)

Formatted: Justified, Space After: 6 pt

3.3.4 ISOCAISO Review of Documentation

The Participating Generator must provide all required documentation for an FNM build.

- A Participating Generator who does not deliver required documentation within the FNM build timeline might have to wait until a future FNM build to participate in ISOCAISO energy markets according to published timeline dates.
- The Participating Generator has a responsibility to notify an ISOCAISO Energy Data Acquisition Specialist within 24 hours of discovery concerning any discrepancies between documentation on file and actual telemetry installation.

4. Communications

4.1 Overview of Communications Objectives

The [ISOCAISO](#) technical operations systems architecture, implemented to carry out resource monitoring and control, incorporates two central systems comprising the [ISOCAISO](#)'s EMS and operating at each [ISOCAISO](#) location. The [ISOCAISO](#)'s EMS has two primary functions:

- Provides AGC and operator dispatch support for monitoring and control of each Participating Generator;
- Provides for the monitoring of the transmission system within the [ISOCAISO](#) Balancing Authority Area.

In order for the [ISOCAISO](#) to comply with its responsibilities, the Participating Generator is required to install a DNP3-capable Real-Time Device (as described in this BPM) that meets [ISOCAISO](#) functionality, reliability, and security objectives. The Real-Time Device establishes a real-time data interface between the Participating Generator's local control systems and the [ISOCAISO](#)'s EMS. The Participating Generator can validate its own control system to interface with the [ISOCAISO](#)'s EMS; see the Real-Time Device Validation Procedure under References.

4.2 Choice of Connection Methods

The [ISOCAISO](#) recognizes that Participating Generators require choice in the technical methods available to them to connect to the [ISOCAISO](#) in order to provide direct telemetry in support of [ISOCAISO](#) reliability and security objectives.

Historically, the [ISOCAISO](#) envisioned and realized an ECN as a SCADA communications network for the Western Interconnection. Over time, the [ISOCAISO](#) has continued to mature the ECN as a reliable digital communications network to support telemetry directly to generators as well as to revenue meters and between SCADA control centers.

The ECN supports the reliability and availability of critical grid operations and mitigates risks associated with public networks by providing more bandwidth assurance and higher service levels. The [ISOCAISO](#) has recognized that the ECN natively does not assure protection against unauthorized access to or modification of customer data; the [ISOCAISO](#) therefore provides an option for encrypting and digitally signing communications between the [ISOCAISO](#) EMS and Real-Time Devices at Participating Generators in the form of SSL/TLS and X.509 digital certificates. The combination of authenticating and digitally signing communications for direct telemetry has provided a kind of non-reputability for instructions that the [ISOCAISO](#) sends to generators – assurance on both sides in the delivery and receipt of critical communications such as AGC.

Over time, the reliability of the public Internet has improved but cyber threat to public networks has increased. Concurrently, the operational cost of leasing use of semi-private networks such as the ECN has increased relative to the cost of employing the various software-defined security overlays now available on public networks for connecting remote locations. Driven by Cloud computing, public networks continue to evolve to support secure and cost-efficient interconnection. The [ISOCAISO](#) continues to adapt to provide increasingly more cost-effective communications options that reduce barriers to participating in [ISOCAISO](#) markets.

Telecommunication options continue to evolve rapidly to meet customer demand and competitive constraints. The same companies that support the retail Internet support the increasingly digitally interconnected North American reliability and energy infrastructure. Digital security continues to evolve to meet higher levels of risk and threat; consequently, communications options available to Participating Generators continue to evolve to include network overlays that assure the confidentiality, integrity, and availability of the information required to secure the market-driven grid.

In 2016, the FERC approved a new type of [ISOCAISO](#) market participant called a Distributed Energy Resource (DER) Aggregate (DERA). The aggregation point is a market resource. Participants in the market asked the [ISOCAISO](#) to evaluate new options for securing DERA telemetry in order to reduce barriers to entering [ISOCAISO](#) markets. Specifically, prospective participants sought to use their existing Internet broadband, instead of the ECN, to the [ISOCAISO](#); these participants also requested an alternative to participant-managed PKI. The [ISOCAISO](#) has responded by adding ~~two a~~ communications options secured on the public Internet which requires the use of a digital certificate, one of which continues to require use of digital certificates.

4.3 Communication Context Diagram


This section describes the main communication options available to Participating Generators in the [ISOCAISO](#) Balancing Authority Area. Participating Generators must choose whether to connect over the ECN or over the public Internet to receive DNP3 polls from the [ISOCAISO](#)'s EMS. For non-ECN connections, Participating Generators can choose between an IPsec connection provided by AT&T or Internet Service Provider with a static IP range.


Exhibit 4-1 depicts the three communication options available to Participating Generators. There is no attempt to depict a complete communication diagram with all network equipment and servers; the purpose of the diagram is only to depict context for use of the ECN or the public Internet as well as where participant-managed digital certificates are required. The four communications options are:

- The Participating Generator leases a T1 connection to the ECN from AT&T and purchases a router with a T1 interface; this option requires an SSL/TLS digital certificate and the participant can optionally contract with AT&T to have the router managed and maintained.

- AT&T installs an ANIRA IPsec VPN gateway at the Participating Generator's site to backhaul data over the public Internet to the ECN; the Participating Generator does not need a T1 connection to the ECN but does need to provide a broadband connection and manage an SSL/TLS digital certificate.
- The Participating Generator leases an Internet Service Provider (ISP) connection to the Internet from any ISP and purchases a router. This option requires an SSL/TLS digital certificate and the participant can optionally contract with the ISP to have the connection managed and maintained.

Exhibit 4-1: Context Diagram for Communications Options for Direct Telemetry

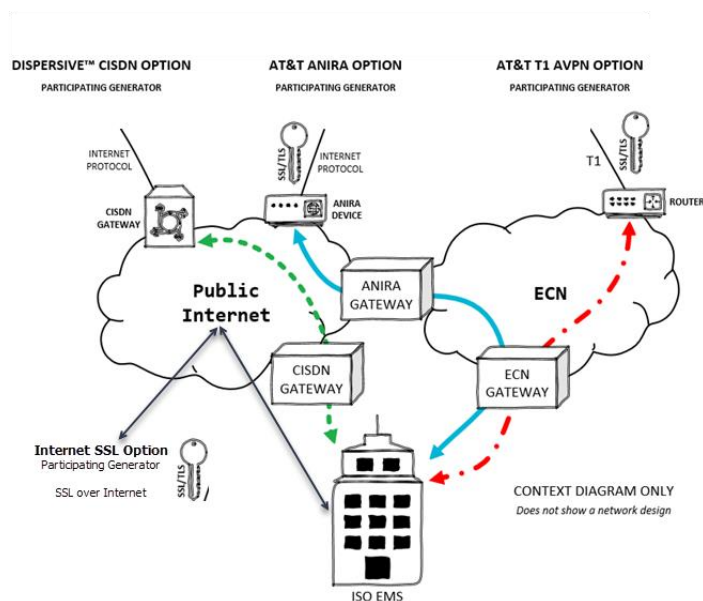

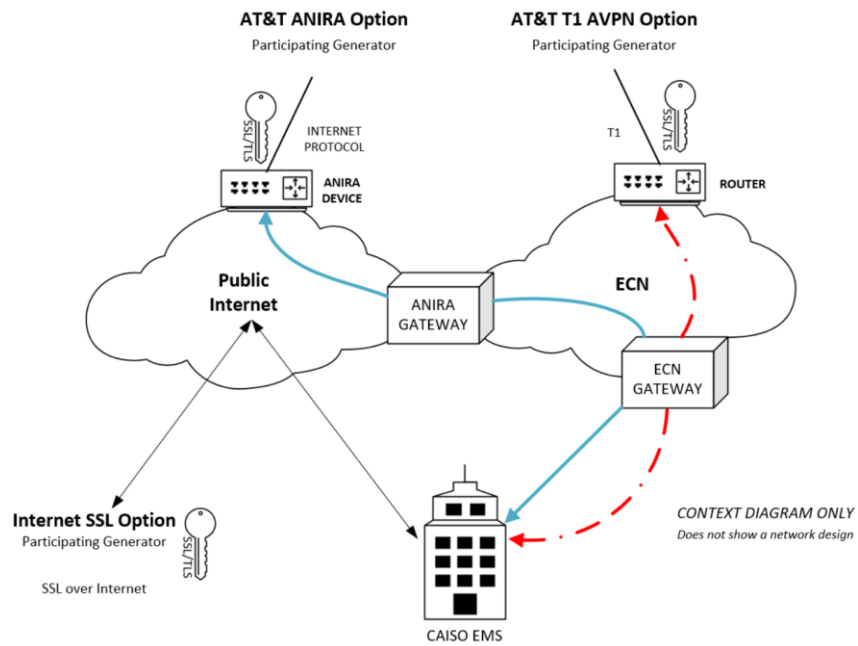

Formatted: Centered

4.4 Main Communication Options

Table 4-2 shows the main requirements for each connectivity/security requirement as Yes (required) or No (not required).

Table 4-2: Main Requirements for Each Communication Option for Direct Telemetry

Connectivity/Security Requirement	AT&T Leased T1 Line	AT&T ANIRA IPsec VPN	Internet Service Provider
Participating Generator Leases ECN Connection	Yes	No	No
Participating Generator Provides Broadband Internet Connection	No	Yes	Yes
Participating Generator Installs an ISO CAISO-Issued Digital Certificate	Yes	Yes	Yes

4.5 Detailed Communication Options

Table 4-3 provides a detailed comparison of communications options.

Table 4-3: Detailed Comparison of Communication Options for Direct Telemetry

Connectivity Option	AT&T Leased T1 Line	AT&T ANIRA IPsec VPN	Internet Service Provider
Connectivity	Participant leases a T1 connection to the ECN and provides a router with a T1 interface; the participant's site must be protected by a firewall	AT&T installs an ANIRA IPsec VPN gateway at the participant's site to backhaul data over the public Internet to the ECN; the participant provides a broadband connection	ISP provides gateway at the participant's site or control room to backhaul data over the public Internet; the participant provides a broadband connection

Formatted Table

Connectivity Option	AT&T Leased T1 Line	AT&T ANIRA IPsec VPN	Internet Service Provider
Encryption	Data encryption provided from the participant's SSL/TLS gateway to the ISOCAISO using a participant-managed, ISOCAISO -provided, periodically expiring X.509 digital certificate	Data encryption provided from the participant's SSL/TLS gateway to the ISOCAISO using a participant-managed, ISOCAISO -provided, periodically expiring X.509 digital certificate; network encryption over the public Internet to the participant's ECN router provided by the ANIRA gateway	Data encryption provided from the participant's SSL/TLS gateway to the ISOCAISO using a participant-managed, ISOCAISO -provided, periodically expiring X.509 digital certificate
Time to Provision	Allow three months	Allow three months	ISP order processing time

Formatted Table

<i>Connectivity Option</i>	<i>AT&T Leased T1 Line</i>	<i>AT&T ANIRA IPsec VPN</i>	<i>Internet Service Provider</i>
<i>Maintenance of Digital Certificates</i>	The participant manages periodic renewal of an ISOCAISO -provided X.509 digital certificate	The participant manages periodic renewal of an ISOCAISO -provided X.509 digital certificate	The participant manages periodic renewal of an ISOCAISO -provided X.509 digital certificate
<i>Router Maintenance</i>	The participant can optionally contract with AT&T to manage the ECN router	Maintenance of the ANIRA gateway is included in the monthly service cost	The participant can optionally contract with ISP for maintenance
<i>Periodic Costs</i>	Monthly cost for T1 service; participant can manage the ECN router or pay AT&T to manage it; possible monthly service costs for a branded Real-Time Device	Monthly cost for ANIRA service; possible monthly service costs for a branded Real-Time Device	Monthly cost for managed ISP service

Formatted Table

Connectivity Option	AT&T Leased T1 Line	AT&T ANIRA IPsec VPN	Internet Service Provider
Additional Costs	One-time costs for a Cisco router, a firewall, and either a participant-managed SSL/TLS gateway or a branded Real-Time Device (with possible associated monthly service costs)	A one-time cost for either a participant-managed SSL/TLS gateway or a branded Real-Time Device (with possible associated monthly service costs)	A one-time cost for ISP hardware
Ruggedized Gateway Available	Yes/No	Yes/No	Yes/No

Formatted Table

4.6 Ruggedized Gateway Available

The ruggedized construction option available for the types of connections in fore mentioned option refers to resistance to shock and vibration as well as a wide range of operating temperatures. The following suggested ruggedized parameters can be found in many network gateways and it is the option of the interconnection customer to determine the need for ruggedized equipment. The [ISO/CAISO](#) does not mandate ruggedized equipment to be installed.

- Temperature range -13°F to 158°F (-25°C to 70°C);
- Resistance to shock (50 G_{rms});
- Resistance to vibration (5 G_{rms});

- Protection against overcurrent, overvoltage, and electrostatic discharge.

4.7 **ISOCAISO** Security for Direct Telemetry

4.7.1 Data Confidentiality

Information transmitted via the Real-Time Device from a Participating Generator to the **ISOCAISO**'s EMS will be treated by the **ISOCAISO** as the Participating Generator's confidential information in accordance with the **ISOCAISO** Tariff.

4.7.2 Network Security Principles and Best Practices

The **ISOCAISO** documents the following principles and best practices as a guideline for Participating Generators and in the spirit of NERC CIP compliance to which they might already be subject.

- Information is a critical asset for the **ISOCAISO**.
- Protecting information assets from unauthorized or incorrect use or modification, destruction, or disclosure requires planning, teamwork, cooperation, and vigilance.
- Network access must be provisioned and maintained in such a way that only authorized users are given access to information and only with the tools required for the job.
- ECN Provider Edge Routers must not peer with Customer Edge Routers managed by Participating Generators.
 - This means that AT&T routers must not share ECN routes with ECN routers managed by Participating Generators.
 - The practical meaning of this best practice is to minimize risk to other Participating Generators on the ECN at large.
- The ECN must not bridge to the public Internet and vice versa.
 - The practical meaning of this best practice is that a device at the Participating Generator's site must not be dual homed, with one network interface connected to the ECN and the other network interface connected to the public Internet.

-
- The reason for this best practice is that a device compromised by malware from a less trusted network can convey the destructive payload of that malware to more trusted network by means of the physical device that bridges the two networks.
 - A firewall that protects the device can securely multi-home the networks that it controls.
 - The Participating Generator owns security at the entities facility where the ECN is installed.
 - Perimeter routers connecting the Participating Generator to the ECN must use ACLs to restrict both ingress (inbound) and egress (outbound) traffic.
 - Ingress ACLs on ECN routers must be designed to allow only trusted devices and protocols.
 - Egress ACLs must be designed to allow only traffic from assigned local IP addresses.
 - Participating Generators are encouraged to review security best practices described in NIST SP 800-82 (see References), particularly in the section called Network Segmentation under ICS Security Architecture.

4.7.3 Communication Security Characteristics

Communication of direct telemetry to the [ISOCAISO](#)'s EMS must be secure. All communication options are acceptable up to 1200MW per connection and 25 aggregated resources per Real-Time Device. Beyond those limits, the [ISOCAISO](#) requires a second network connection.

Security has four main components:

- *Availability* – Refers to reliability and uptime.
- *Data Integrity* – Refers to protection against unauthorized data modification.
- *Data Confidentiality* – Refers to protection against unauthorized access to data.
- *Authenticity* – Refers to the authentication and authorization of business transactions (one example of a business transaction is a SCADA set-point instruction).

The ECN provides a high level of availability, reliability, and uptime, but, without additional security overlays, it does not provide integrity, confidentiality, or authenticity.

As Cloud architecture evolves to support higher levels of availability and reliability, VPN technologies are adapting to provide equivalent uptime over software-defined networks (SDN). Advantages of SDN include real-time response to network congestion or compromise to assure packet flow and enhanced capabilities to aggregate multiple types of broadband links to provide link failover as well as higher throughput. .

4.7.3.1 Data Integrity

Protecting the integrity of SCADA communications against network eavesdropping and MitM attacks helps assure the health of an economy that increasingly depends on highly reliable digital delivery of electricity through markets. This means that cybersecurity protections mitigate the threat of unauthorized modification or interception of SCADA instructions between the authorized sender (the [ISOCAISO](#)'s EMS) and the authorized receiver (the Participating Generator's Real-Time Device). The electric grid cannot be reliable without integrity assurance.

4.7.3.2 Data Confidentiality

Data confidentiality is typically assured by data encryption, an algorithmic process for rendering data undecipherable to users or identities who are not authorized to decrypt it. Confidentiality is broadly important for all data owned by Participating Generators (as protected by the [ISOCAISO](#)'s Tariff), but it is particularly important for data from the revenue meters through which grid reliability is coupled with the mechanisms of deregulated markets. The [ISOCAISO](#) enforces data encryption either through SSL/TLS digital certificates managed in software applications by Participating Generators or directly through network automation as part of a managed service provided to Participating Generators.

4.7.3.3 Authenticity

Authenticity requires some means of proving identity, which could be a machine identity or a human identity and could refer either to the sender or the receiver of a business transaction. In the context of this BPM, identity refers either to the [ISOCAISO](#)'s EMS (sender) or the Participating Generator's Real-Time Device (receiver).

The [ISOCAISO](#) provides two options for assuring the authenticity of business transactions:

- *X.509 digital certificates for sender and receiver form a mutually authenticated and encrypted SSL/TLS network transport channel for SCADA instructions.* [ISOCAISO](#)-issued participant-managed digital certificates provide this option either over leased T1 lines connected to the ECN, ISP or through the managed ANIRA service.
- *Automated just-in-time data encryption authorizes pre-authenticated network identifies to complete a transaction.* The quality of “just in time” refers to encryption keys that change periodically to defeat persistent network eavesdropping.

A combination of authenticity and integrity can provide a level of digital assurance that information has arrived at its intended destination. The relevance of this for direct telemetry is assurance, in the form of non-reputability, that a Participating Generator received an instruction from the [ISOCAISO](#)'s EMS.

4.7.4 Communication Security Protocols

Real-Time Devices may support a number of standard available plant interface protocols. -The Participating Generator has the option of designing its own integration solution for the Real-Time Device or hiring an integrator of its choice. -The encryption options below can be easily achieved by either approach. -Participating Generators should contact an [ISOCAISO](#) Energy Data Acquisition Specialist for consultation before designing or installing a Real-Time Device.

The protocol required between the Participating Generator Real-Time Device and the [ISOCAISO](#)'s EMS is DNP3 with one of the following encryption options:

- **SSL/TLS** *(*At this time SSL/TLS encryption is the only available option)*
 - This option requires that the Participating Generator manage an X.509 digital certificate that is issued by the [ISOCAISO](#) and periodically requires renewal.
 - ~~This option requires network transport provisioned by AT&T; the AT&T connection can be either:~~ The connection from CAISO EMS to the RIG can be one of the following options:
 - A broadband ISP connection secured by an ANIRA IPsec VPN gateway in line with a Participating Generator's existing broadband link; or
 - A broadband ISP connection gateway in line with a Participating Generator's existing broadband link; or
 - An ECN connection ~~with T1 line~~ provisioned by AT&T.

Formatted: Font: Not Bold

Formatted: Font: Not Bold

~~o SSL/TLS provides encryption over the ECN. All connection types require TLS encryption.~~

- o The ~~ISOCAISO~~ supports communications via TLS versions ~~1.0, 1.1 and~~ 1.2.
 - For communications using an internet pathway, Real-Time Devices should utilize the highest TLS version supported by the ~~ISOCAISO~~. Effective 6/30/21, the ~~ISOCAISO~~ will no longer support TLS versions 1.0 or 1.1 for this communication pathway.
 - For communications using the ~~ISOCAISO~~ ECN pathway, Real-Time Devices should utilize the highest TLS version supported by the ~~ISOCAISO~~. Effective 6/30/22, the ~~ISOCAISO~~ will no longer support TLS versions 1.0 or 1.1 for this communication pathway.
 - Effective 6/30/21, the ~~ISOCAISO~~ will no longer accept communications from Real-Time Devices utilizing RC4 or CBC ciphers.

~~*o In the interest of securing communications for the vast majority of participants, CAISO reserves the right to remove broken/legacy TLS options/ciphers/protocols/certificates/etc prior to completion of the BPM Change Management process when such change will only impact a small minority of participants with legacy unsecure implementations and security is deemed to be at risk.~~

Formatted: Font: Italic

Formatted

Formatted: Font: Italic

4.7.5 Communication and ~~Network~~ECN DocumentsAgreements

DNP3 communications from a Real-Time Device to the ~~ISOCAISO~~ must be encrypted using the SSL/TLS digital certificates issued by the ~~ISOCAISO~~ and managed by the Participating Generator;. PKI ~~agreements~~ and ~~ECN-agreements~~External Network Guidelines govern encryption using SSL/TLS over the ECN. PKI agreements also apply to connections of a Real-Time Device over the public Internet. This BPM requires adherence to the following security agreements (see References).

- For AT&T-provisioned connections (ECN, ISP, or ANIRA), the Participating Generator must sign the Certificate Practice Statement for Basic Assurance Certification Authority.
- For all connections, the Participating Generator must sign the ~~Network Connectivity Security Requirements and Agreement~~External Network Guidelines Document.

- The Participating Generator is required to follow policy described in the Information Security Requirements for the Energy Communication Network (ECN).
- Form submission with the proper filename convention is a precursor to opening communication from the [ISOCAISO](#)'s EMS. See New Resource Implementation Contact in References for submission e-mail address.

4.7.6 Connected Entity Service Guides

For connecting to the [ISOCAISO](#) EMS, Participating Generators (as Connected Entities) can choose among two options: AT&T, ISP.

- The ECN connection requires a T1 circuit provisioned by AT&T.
- For connecting to the [ISOCAISO](#) EMS over the public Internet, Participating Generators have two options:
 - AT&T ANIRA
 - ISP
- A connection option above is required for connecting a Real-Time Device to the [ISOCAISO](#) EMS.
- Use of [ISOCAISO](#)-issued digital certificates is required. This BPM references service guides for the AT&T option (see References).
- *AT&T Connected Entity Service Guide*
 - A direct ECN connection requires an AT&T-provisioned T1 circuit.
 - The AT&T ANIRA connection uses a Participating Generator's existing Ethernet or cellular IP broadband link, obtained through the local ISP, to connect to the ECN; there is no requirement for a T1 circuit.
 - Both options require use of an [ISOCAISO](#)-provisioned SSL/TLS digital certificate to establish an encrypted communication channel over the ECN, which natively has no encryption.
 - The ANIRA connection is encrypted between the Participating Generator and the ECN but not over the ECN to the [ISOCAISO](#) EMS; SSL/TLS provides encryption over the ECN.
 - The T1 connection is encrypted between the Participating Generator and the [ISOCAISO](#) EMS over the ECN using SSL/TLS.

- *ISP Connected Entities please refer to their service guide*

4.8 Reliability

4.8.1 Redundant Circuits

The Participating Generator may optionally implement a diversely routed secondary communications circuit. The [ISOCAISO](#) recommends using redundant circuits when feasible. The procurement of redundant circuits and paths is the Participating Generator's responsibility and the redundancy must be managed by the connection service provider.

4.8.2 Data Validation

All telemetry data reported from the Real-Time Device must be within +/-2% of the true value. The [ISOCAISO](#) or its designee may inspect the Participating Generator's Real-Time Device and related facilities to verify the accuracy and validity of all [ISOCAISO](#) telemetry. All data telemetry provided through the Participating Generator's Real-Time Device must be tested by the Participating Generator or Participating Generator's representative for accuracy and validity on a periodic basis as necessary to ensure that accuracy requirements are maintained. The best practice is to test all resource data annually for accuracy.

4.8.3 Voice Communications

Each Participating Generator in the [ISOCAISO](#)'s market model must be able to establish normal voice communication over a dedicated voice communications circuit from the Participating Generator local control center that has immediate remote and manual control of the Generating Unit(s).

A dedicated voice communication circuit is one that is available at all times for communication purposes between the [ISOCAISO](#)'s dispatchers and the Generating Unit's local control center.

4.8.4 Communications During Telemetry Failure

In the case of telemetry failure, a Participating Generator that provides real-time data is responsible for manually communicating generation values to the [ISOCAISO](#) on a 24x7 basis until normal telemetry is restored. See section 8.4 for additional details on this subject.

5. Operational Telemetry Requirements

5.1 Unit Telemetry Visibility

Each resource participating in the [ISOCAISO](#)'s Ancillary Services markets or any Eligible Intermittent Resource or any resource providing Energy with a capacity of 10MW or greater that is not exempt pursuant to the [ISOCAISO](#) Tariff must provide telemetry data according to the point matrix specified in Section 7 of this document and pursuant to [ISOCAISO](#) Tariff Section 7.6.1(d).

5.2 Performance Monitoring


5.2.1 Direct Telemetry Timing Requirements

Exhibit 5-1 shows the performance and timing requirements for a Generating Unit connected to the [ISOCAISO](#) EMS.

- A Participating Generator must be able to **accept** and begin processing direct digital control (DDC) signals (Set Points) within the [ISOCAISO](#) time standard (two-second maximum from [ISOCAISO](#)'s EMS to output of the Real-Time Device). The two-second maximum includes any Generator or third-party communication equipment located between the [ISOCAISO](#) and the Participating Generator.
- A Participating Generator must be able to **send** data to the [ISOCAISO](#) within the [ISOCAISO](#) time standard (two seconds from the input of the Real-Time Device to the [ISOCAISO](#) EMS).
- The plant controller must receive the signal from the Real-Time Device within the [ISOCAISO](#) time standard (an additional two seconds from output of the Real-Time Device to plant controller).
- The time standards also apply in the return direction, resulting in a total maximum of eight seconds, round trip, for the signal to travel from the [ISOCAISO](#) EMS to the plant controller and back.
- The timing requirements from the [ISOCAISO](#) EMS to the plant control system (for example, DCS, RTU) through the use of non-[ISOCAISO](#) communication equipment must meet the [ISOCAISO](#) two-second time standard in one direction.

- The timing requirements from the plant control system back to the [ISO/CAISO](#) EMS through the use of non-[ISO/CAISO](#) communication equipment must meet the [ISO/CAISO](#) two-second time standard in the return direction.

Exhibit 5-1: Timing of Telemetered Real-Time Data for Generators Providing Ancillary Services or Energy Only through a Real-Time Device

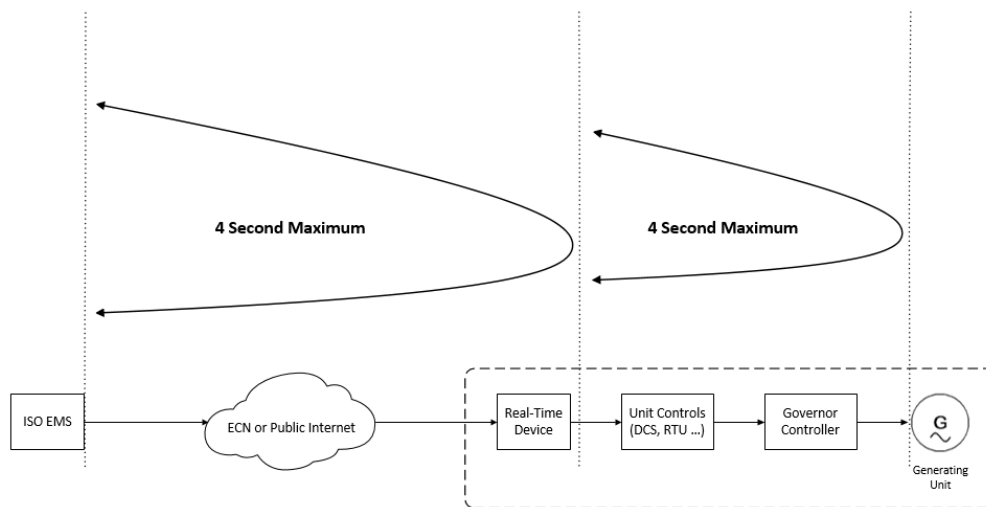


5.2.2 PDR Timing Requirements

The provisions of the section above apply to PDR telemetry, except that the resource telemetry requirement may be expanded to either one (1) minute when participating in the Day-Ahead, Real-Time, and Non-Spinning Reserve markets or five (5) minutes when participating in the Day-Ahead or Real-Time markets. The election for one (1) minute or five (5) minutes is applied to all locations underlying the PDR. The per-location readings that make up the resource-level telemetry will be time-aligned within any PDR resource to within a +/-30 second time

accuracy compared to a resource-specific synchronization time. If a location's telemetry source drifts outside of this band the Participating Generator is responsible for synchronizing the telemetry source. In all cases, the resource-level telemetry points must be available within Real-Time Device for the [ISOCAISO](#)'s 4-second poll with no more than a 1-minute latency. Exhibit 5-2 highlights this timing in the 5-minute case.

Exhibit 5-2: PDR Timing, 5- Minute Case

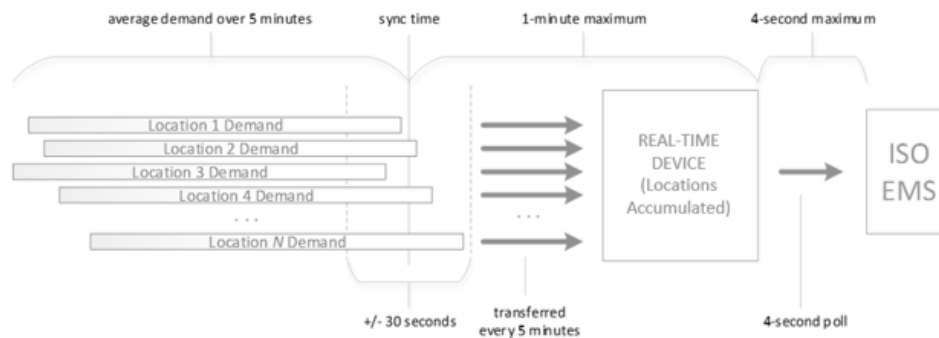

The timing referenced this section also applies to PDR participating in the Spinning Reserve Market.

Real-Time Devices providing telemetry for PDRs must provide valid data points only during the time that the PDR is in a dispatchable state, including one hour leading up to and one hour after that state. Dispatchable is defined as any time the resource has the potential for energy dispatch, specifically during day-ahead award hours and real-time energy bids.

5.2.3 PDR Reading Requirements

The provisions in this document shall apply to PDR telemetry, except that all references to “real-time updated value and not averaged over time” should be taken as “real-time updated value or average reading over the PDR timing interval” for PDRs.

5.3 [ISOCAISO](#) Real-Time Communication Technical Design Options

With the recharacterization of a RIG as any Real-Time Device that meets the security and operational objectives for direct telemetry, the [ISOCAISO](#) now supports both branded (turn-key) and non-branded (build-your-own) technical designs. Hybrid solutions are also possible. Contact an [ISOCAISO](#) Energy Data Acquisition Specialist for consultation using the contact information in the References section of this BPM.

The [ISOCAISO](#) is continually looking for options that will allow Participating Generators to connect to the [ISOCAISO](#)'s EMS in a cost-effective and secure manner. A Real-Time Device can be software running on a Plant Control System or a combination of software optionally hardware on a separate device. Its function as an interface to the [ISOCAISO](#)'s EMS can be either logically or physically segmented at the Participating Generator's site. This section describes multiple secure options that will allow the Participating Generator's control system to connect to the [ISOCAISO](#)'s EMS by means of a Real-Time Device.

The [ISOCAISO](#)'s EMS controls and monitors resource sites from two physical locations with two connections in simultaneous operation. This exchange of data is performed using Real-Time Devices either over the ECN or using a Participating Generator's existing broadband link.

5.3.1 Functional Components of Real-Time Communication Options

The functional components of real-time communication options, without regard to specific implementation, are as follows.

- **Plant Systems:** Each plant providing Ancillary Services or Energy has a control system that obtains telemetry from Generating Units. Various measured values must be available from the Plant Control System as described in this BPM. The Plant Control System constitutes the source of the telemetry necessary to comply with the [ISOCAISO](#)'s standards, pursuant to [ISOCAISO](#) Tariff Section 7.6.1(d).
- **Plant Interface Protocol:** The interface between the Real-Time Device and the plant control system can be any protocol convenient to the control system, according to the relationship between the supplier and the Participating Generator.
- **SSL/TLS Encryption Layer:** With SSL/TLS, the [ISOCAISO](#)'s EMS real-time IP DNP3 poll converts to TCP in-the-clear or serial DNP3 protocol at the resource control system. The SSL/TLS capability may reside on the Plant Control System or on separate hardware.

- **Exemption from Simultaneous Connection:** The [ISOCAISO](#) may grant an exemption from the requirement to establish two simultaneous connections for an intermittent resource with a capacity less than 10MW. For resources with a capacity of 10MW or greater the SSL/TLS option must meet the [ISOCAISO](#) standard for simultaneous connections.
- **ECN Connection:** The Energy Communications Network (ECN) is a semi-private AT&T MPLS communications network option for telemetry from the Real-Time Device to the [ISOCAISO](#)'s EMS. AT&T provisions access to the ECN. The ECN natively has no encryption. . AT&T can provision ECN connectivity either as a T1 circuit with a customer-provisioned router or as an ANIRA IPsec VPN tunnel to the ECN. The ANIRA gateway has Ethernet and cellular IP capability.
- **Internet Connection:** The connection option for the public Internet is for real-time data through an ISP for the purpose of telemetry in the same manner as the ECN. The ANIRA option supports this method.
- **Securing DNP3 over TCP/IP:** The DNP3 protocol communicated over the TCP/IP transport must be secured. The [ISOCAISO](#)'s EMS does not use the DNP3 SA (Secure Authentication) extension but achieves the same, plus encryption, using the following method:
 - SSL/TLS with a customer-managed and periodically expiring digital certificate provisioned by the [ISOCAISO](#)
- **[ISOCAISO](#) EMS:** All telemetry arrives at the [ISOCAISO](#)'s EMS encrypted over TCP/IP via either the ECN or an ISP network.

5.3.2 Transport Options

The [ISOCAISO](#) supports three transport options for direct telemetry:

1. ECN with T1 leased circuit.
2. Public Internet with ANIRA IPsec VPN backhaul to ECN.
3. Public Internet.

Option one requires the Participating Generator to lease a T1 circuit from AT&T to connect to the ECN. This option does not use the public Internet. The Participating Generator must manage an [ISOCAISO](#)-issued digital certificate to secure the communication link.

Option two requires the Participating Generator to provide a broadband circuit and to contract with AT&T to install an ANIRA IPsec VPN gateway to connect to the ECN. The Participating Generator does not need to lease a T1 circuit. The Participating Generator must manage an [ISOCAISO](#)-issued digital certificate to secure the communication link.

Option three requires the Participating Generator to provide a broadband circuit to the Public Internet. The Participating Generator does not need to lease a T1 circuit and but does need to manage an [ISOCAISO](#)-issued digital certificate to secure the communication link.


5.3.3 Transport Conceptual Diagrams

The following diagrams conceptually depict each of the three transport options described above. These diagrams do not depict the requirement for a Real-Time Device to receive two polls simultaneously from each [ISOCAISO](#) EMS.

5.3.3.1 ECN with T1 leased circuit.

In Exhibit 5-3, Customer Edge refers to a router with a T1 interface that a Participating Generator must purchase to connect to the ECN through the AT&T Provider Edge router. The Participating Generator may optionally contract with AT&T for management of the Customer Edge router. The key symbol labeled with SSL/TLS shows use of an [ISOCAISO](#)-issued digital certificate that the Participating Generator must manage on the Real-Time Device.


Exhibit 5-3: Transport Option – ECN with T1 Leased Circuit

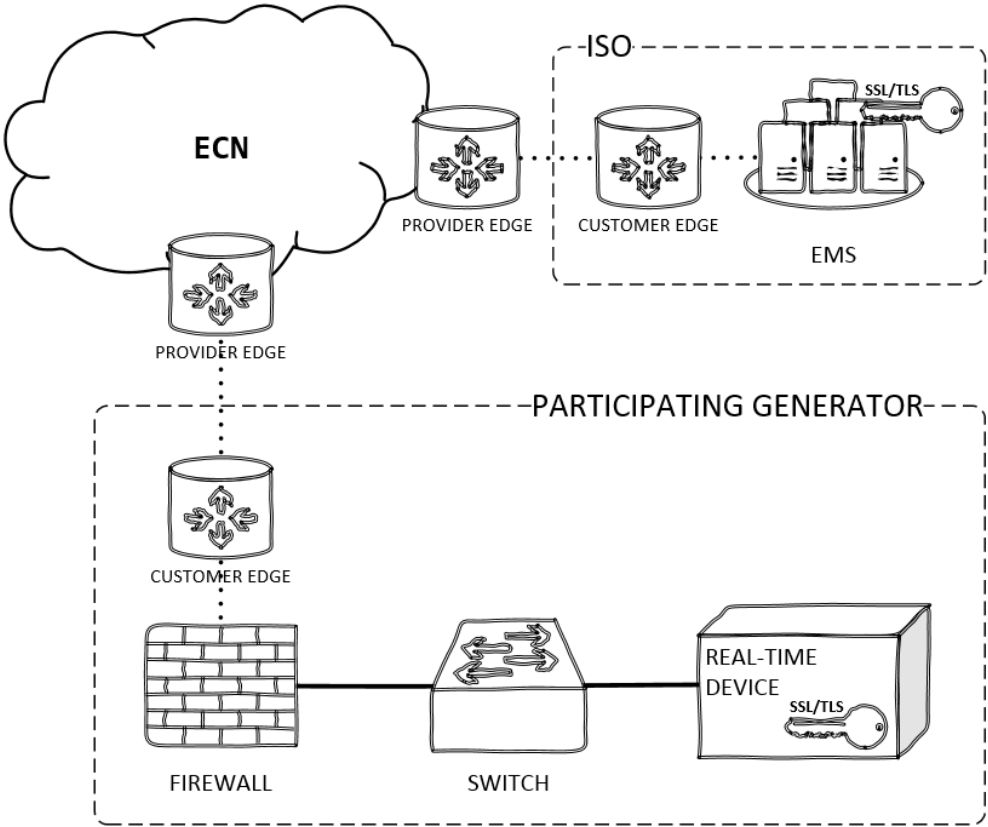

5.3.3.2 Public Internet with ANIRA IPsec VPN backhaul to ECN.

Exhibit 5-4 depicts the IPsec tunnel between the Participating Generator's ANIRA gateway and the ANIRA gateway (or concentrator) on the ECN edge. The Participating Generator provides a broadband connection that serves as the site's gateway for the IPsec tunnel over the public Internet between the generator site and the ECN. The key symbol labeled with SSL/TLS shows use of an [ISOCAISO](#)-issued digital certificate that the Participating Generator must manage on the Real-Time Device. ANIRA supports Ethernet and cellular IP connections.

Exhibit 5-4: Transport Option – Public Internet with ANIRA IPsec VPN Backhaul to ECN

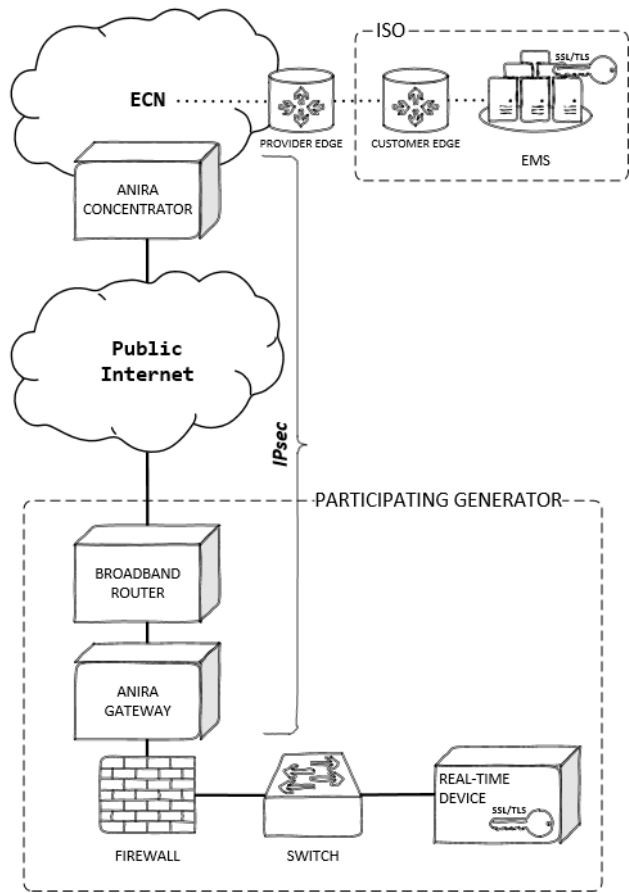

5.3.4 Direct Telemetry Hardware Options

The purpose of this section is to illustrate hardware options for direct telemetry. Participating Generators have the option to build their own Real-Time Devices to interface to plant devices. Unless using the ANIRA transport option, Participating Generators also have the option to install or build their own security devices, as long as those devices meet [ISO/CAISO](#) security objectives. There are two security options: SSL/TLS and IPsec plus SSL/TLS..

5.3.4.1 Plant Control System Hardware Option


In this option, the Plant Control System functions as the Real-Time Device. The software can reside on the Plant Control System. The device performs ~~either an SSL/TLS connection or a CISCN connection~~ for DNP3 data over TCP.

The [ISO/CAISO](#)'s EMS communications with the Plant Control System using the DNP3 protocol. For this option, the Plant Control System must have an outstation DNP3 protocol driver. Real-time data that comes from meters and other plant devices must reside on the Plant Control System. The security gateway handles ~~either an SSL/TLS or CISCN connection~~.

This option must pass security validations as conducted during the [ISO/CAISO](#)'s NRI process. The [ISO/CAISO](#) does not certify Real-Time Devices; Participating Generators may use any Real-Time Device that the [ISO/CAISO](#) has tested for all required functions.

Exhibit 5-7 shows the data flow for this option. A commodity network load balancer may provide the SSL/TLS gateway.

Exhibit 5-7: Plant Control System Hardware Option

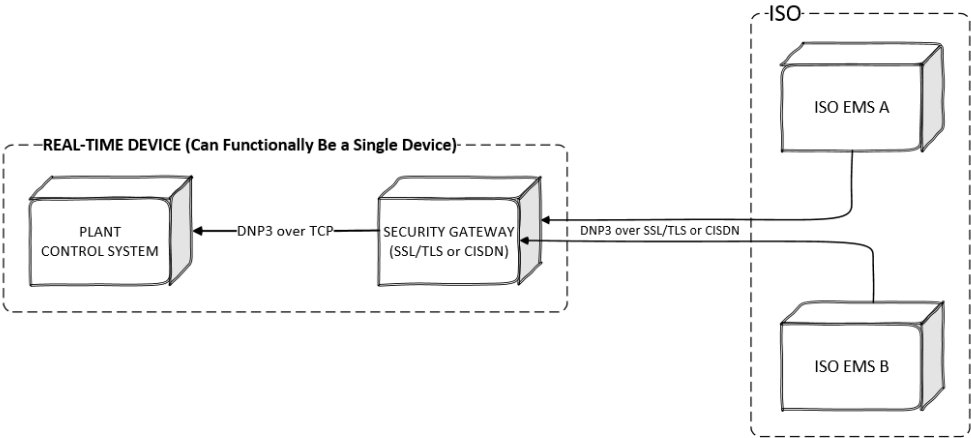



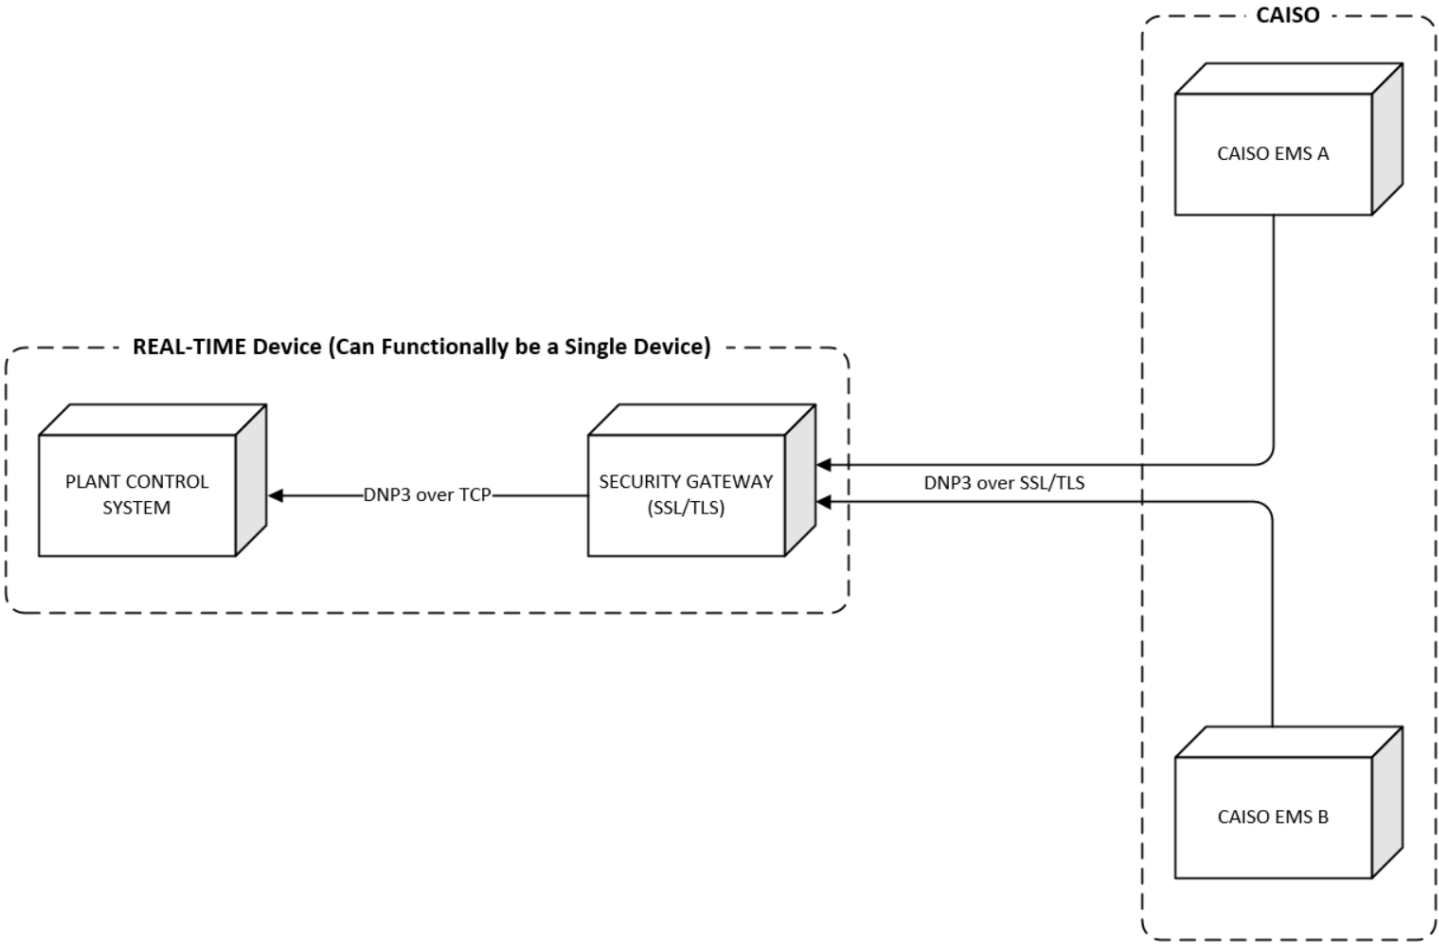


Exhibit 5-8 identifies, by number, the aspects of a serial or TCP clear-text solution. The diagram represents a high-level overview of the perceived functionality of the solution. It is provided for illustration purposes only. The interfaces, envisioned through an abstraction of the internal functionality of the hardware device, are numbered and described below.

Exhibit 5-8: Plant Control System Hardware Option Functional Diagram

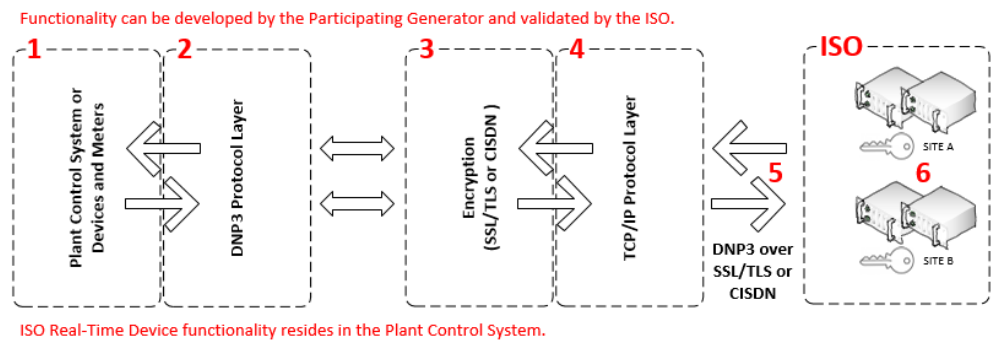

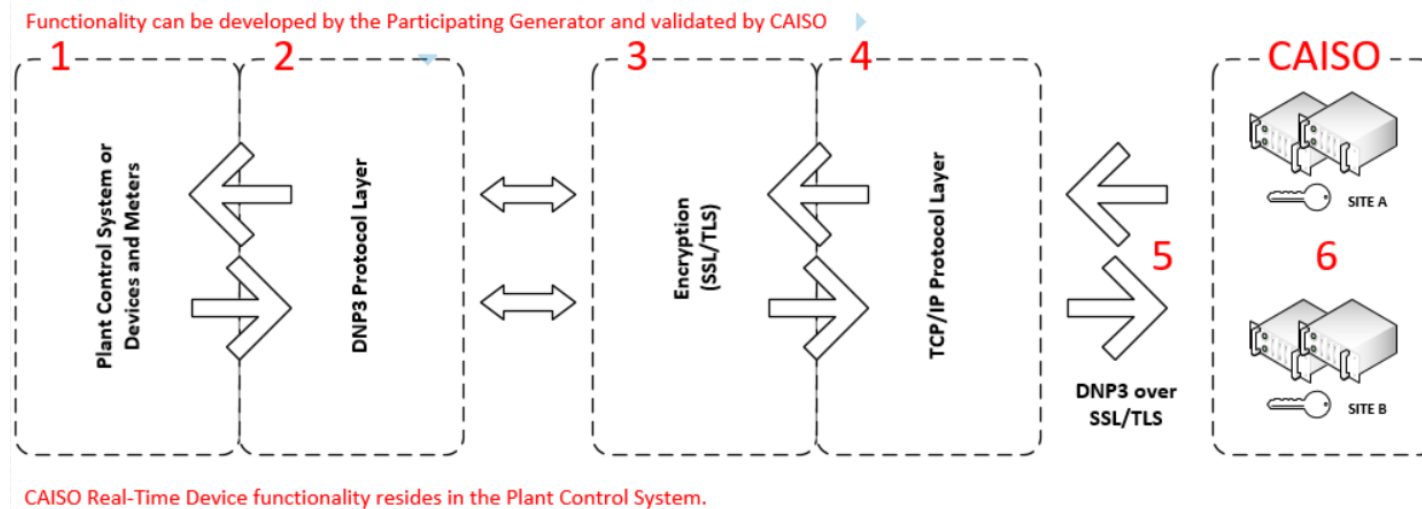


- 1. Plant Control System:** Must perform all Real-Time Device functionality described in this document.
- 2. DNP3 Output Interface Protocol Layer:** The Plant Control System must communicate with the DNP3 subordinate protocol and support the objects and variations described in this document.
- 3. Encryption Layer:** This layer will be an implementation of SSL/TLS using ~~ISO~~CAISO-issued digital certificates..
- 4. TCP/IP Output Interface Layer:** The serial to IP device acts as the TCP server/connection. Once the serial to IP device has requested and established the TCP connection, the encrypted DNP3 compatible data stream passes through a TCP/IP connection over a TCP/IP network.
- 5. DNP3 over TCP/IP over SSL/TLS or DNP3 over CSDN:** Secure DNP3 data over TCP/IP is achieved when the encrypted DNP3 compatible data stream is transported onto the TCP/IP network. Encryption is provided by SSL/TLS.

6. **ISOCAISO Multi-Porting Capability:** The security device must have one IP address with the ability to communicate with two simultaneous TCP/IP connections sourced from the **ISOCAISO's** EMS. ~~For resources with a capacity of less than 10 MW and for intermittent resources, the ISOCAISO may grant an exemption from the requirement for multiple simultaneous connections.~~

5.3.4.2 Real-Time-Device Hardware Option

This options consists of a Real-Time Device that functions as a protocol interface to the Plant Control System and an SSL/TLS interface to the **ISOCAISO's** EMS. The **ISOCAISO's** EMS communications with the Real-Time Device using the DNP3 protocol. This option may be used when a Participating Generator's control system cannot communicate DNP3 protocol. The Real-Time Device provides SSL/TLS security. The **ISOCAISO** does not certify Real-Time Devices; Participating Generators may use any Real-Time Device that the **ISOCAISO** has tested for all required functions. Exhibit 5-9 shows the data flow for this option.

Exhibit 5-9: Real-Time Device Hardware Option

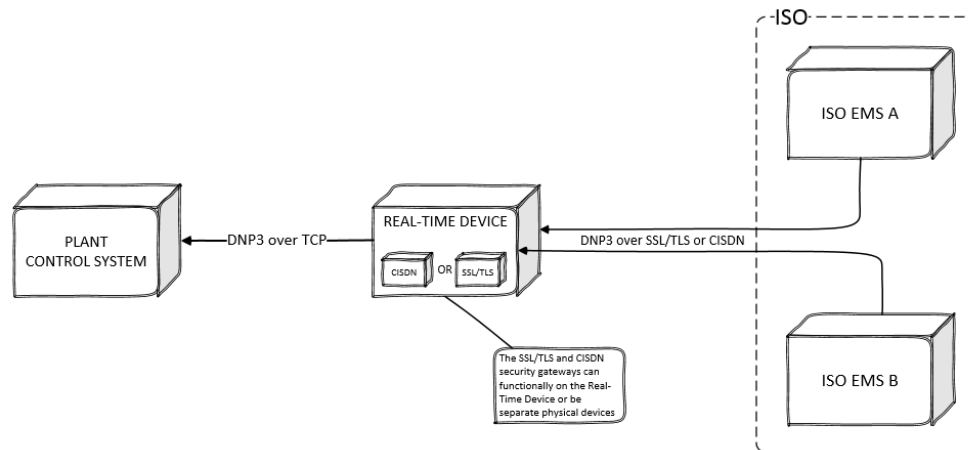



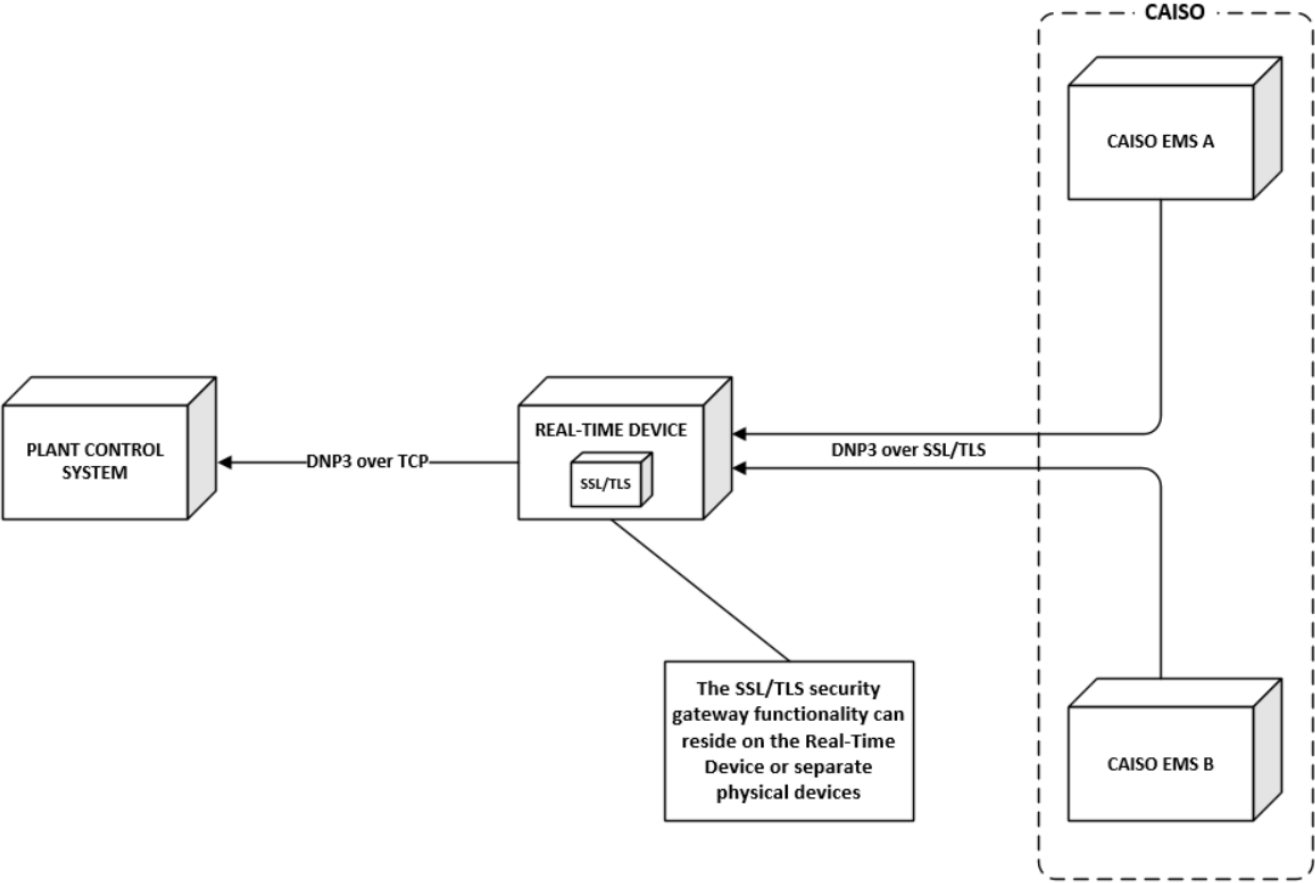


Exhibit 5-10 identifies, by number, the critical aspects of the [ISO/CAISO](#) Real-Time Device. The diagram represents a high-level overview of the perceived functionality of an acceptable Real-Time Device in a single hardware device. This diagram is an illustration only. The interfaces, envisioned through an abstraction of the internal functionality of the hardware device, are numbered and described below.

Exhibit 5-10: Real-Time Device Hardware Option Functional Diagram

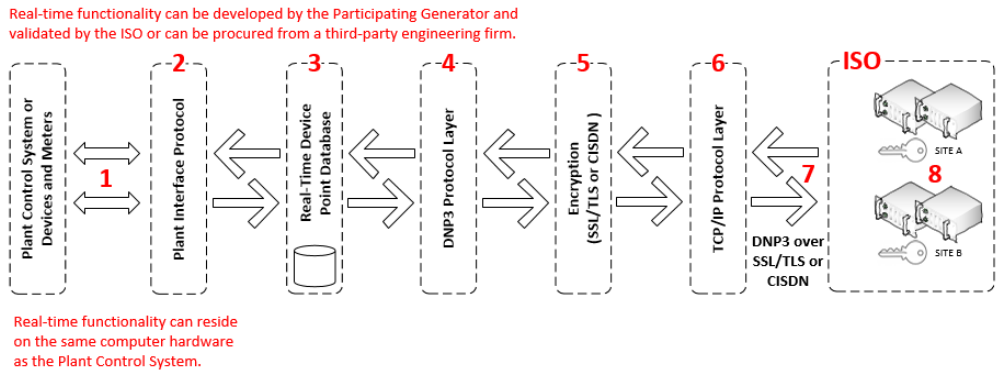

Real-time functionality can be developed by the Participating Generator and validated by CAISO or can be procured from a third-party engineering firm.

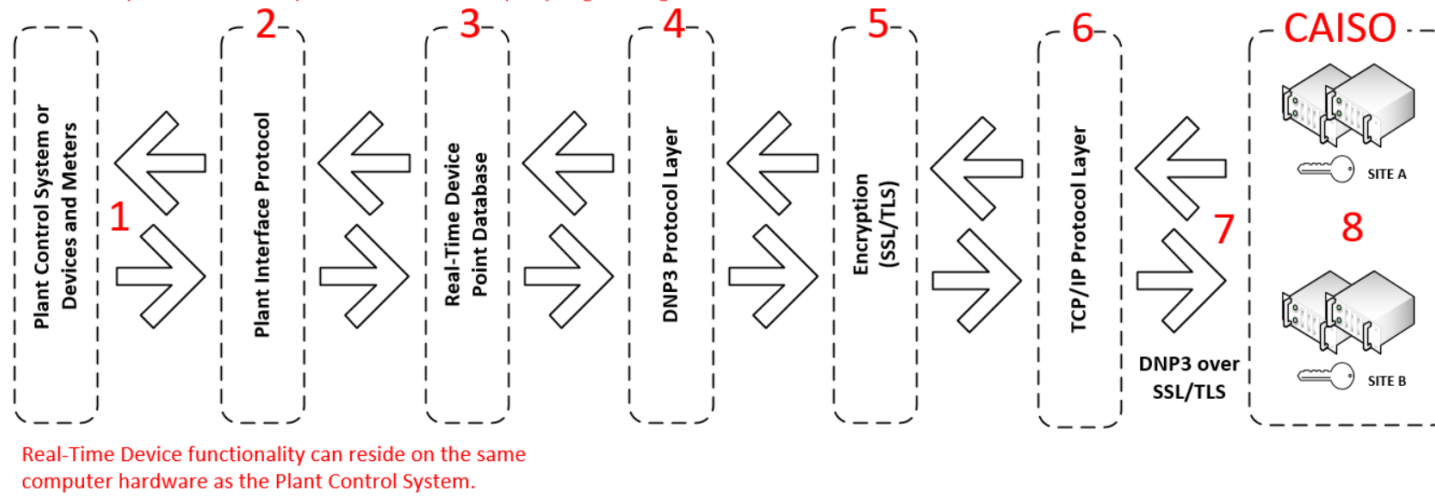

1. **Plant Interface Protocol:** The input to the Real-Time Device is a data stream compatible with the plant systems. This may also be individual hardwired inputs.
2. **Internal Plant Interface Protocol Layer:** The input data stream is received internally by an interface layer compatible with the plant systems.
3. **Real-Time Device Point Database / DNP3 Database Profile Specifics:** The input data is processed internally in the Real-Time Device as data points in a DNP3-compatible database structure. Since the real-time data must be compliant with DNP3 Level 1 protocol, and can contain a database large enough to require more than a single datalink frame for a Class 1 data response, the Real-Time Device must support both static and event-type data points. The Real-Time Device is required to support polling by class.

4. **DNP3 Output Interface Protocol Layer:** As the DNP3 server, the Real-Time Device will parse all client requests and supply the appropriate data designated in the Real-Time Device Point Database. This is typical of a DNP3 driver storing data into the real-Time database.
5. **SSL/TLS Encryption Layer:** In transferring the data from the Real-Time Device to a DNP3-compatible destination, elements are encrypted by a SSL/TLS encryption interface layer using [ISO/CAISO](#)-issued basic-assurance digital certificates implemented either in the ECN or the public Internet.
6. **TCP/IP Output Interface Layer:** The Real-Time Device is to act as the TCP server/connection. Once the client device has requested and established the TCP connection, the encrypted DNP3-compatible data stream passes through an interface layer over a TCP/IP network.
7. **DNP3 over TCP/IP over SSL/TLS:** The DNP3 data stream is secured over TCP/IP using SSL/TLS encryption and transported over a TCP/IP network.
8. **[ISO/CAISO](#) Multi-Porting Capability:** The Real-Time Device must have one IP address that has the ability to communicate with two simultaneously connections sourced from the [ISO/CAISO](#)'s EMS.

5.4 [ISO/CAISO](#) EMS Interrogations

The [ISO/CAISO](#)'s EMS DNP3 front-end processors interrogate each Real-Time Device with DNP3 Object 60, Variations 2 for event data polling ([Class 1 data](#)). Responses shall be the event objects and variations listed below. If there is no points designated as class 1 then the [ISO/CAISO](#) will be instructed by the DNP3 Real-Time Device that protocol driver of data in another class, this is handled and inherent to the DNP3 driver.

The [ISO/CAISO](#)'s EMS DNP3 front-end processors interrogate each Real-Time Device with DNP3 Object 01 Variation 00 "digital static updates" and Object 30 Variation 00 for "analog static updates." The Real-Time Device response must be among the Static Objects and Variations.

5.5 DNP3 Object and Variation Types for Real-Time Device Responses

Objects and Variations supported by the Real-Time Device must include, but are not limited to:

- Static: Object 1 Variation 2 (Digital)
 Object 30 Variation 2 (Analog)
- Event: Object 2 Variation 1 (Digital)
 Object 32 Variation 2 (Analog)
- Time: Object 50 Variation 1 (Read and Write)

- Control: Object Type 41 (Analog Setpoint) Variation 2

Important

The [ISOCAISO](#)'s EMS DNP3 front-end processors will may use DNP3 group and variations other than those listed above. All Real-Time Device solutions must be DNP3 Level 1 certified.

Deadband: ~~Analog events should be set to .5 Engineering Units.~~ The deadband must be configurable on a point-by-point basis. Below is a table of telemetry points along with their respective deadband setting. If you have any questions or a point is not reflected below, please - Exception for the analog deadband is analog points associated with wind, solar, and PDR resources. ~~These types of resources have a much smaller deadband requirement and higher resolution.~~ Consult [ISOCAISO](#) EDAS for proper deadband settings.

<u>Telemetry Point</u>	<u>Deadband Setting</u>
<u>UPMW (and all MW points as well as MXENERGY)</u>	<u>0.01</u>
<u>SPD</u>	<u>0.1</u>
<u>TEMP</u>	<u>1</u>

Formatted: Font: (Default) Arial

Formatted Table

Formatted: Font: (Default) Arial


BPTMP	0.1
PAIRD	0.1
PRES	0.1
DIR	1
KV	0.1

5.6 Quality Flag Propagation to DNP3

When a Participating Generator installs a Real-Time Device and it communicates to downstream devices that are not directly connected to the Real-Time Device, the *originating* device(s) shall propagate a data quality communication flag for each point to the Real-Time Device through each *non-originating device*. A data port alarm point may not be required; however, this will be determined by [ISO/CAISO](#) Energy Data Acquisition Specialist. Other protocols with data quality flags maybe used to propagate flags into DNP3 flags (OPC).

An *originating device* is one that gathers field data directly (for inputs) or issues controls directly to the field (for outputs). A *non-originating device* is one that obtains input data or issues control commands via a communications link from *originating* or *non-originating devices*. A *reporting device* is a device that acts as a DNP3 outstation, sending DNP3 messages to an upstream device.

Data from an originating device may arrive at the master via one or more data concentrator devices. In this case, each device in the communications chain, other than the master, is a reporting device. Exhibit 5-11 illustrates device identification. The terms “upstream” and “downstream” that indicate relative device hierarchy are also shown in this diagram.

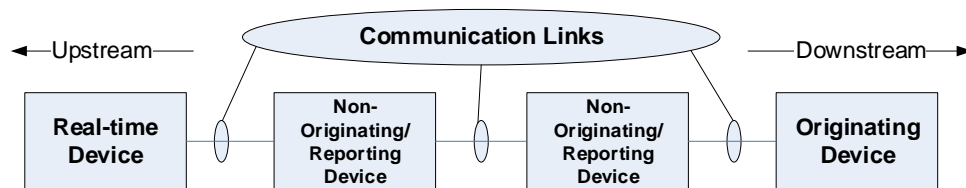Exhibit 5-11: Upstream and Downstream Device Identification

A COMM_LOST indicator indicates that there is a communication failure in the path between the device where the data originates and the reporting device on a point to point basis. This flag indicates that the value reported for the object may be stale or in bad quality. If set, the data value reported shall be the last value available from the originating device before communications were lost.

An *originating device* never sets this flag. A *non-originating or master device* sets this flag if it loses communication with the adjacent downstream device; otherwise it propagates the state of COMM_LOST flag as received from the downstream device. Once set, this flag may only be cleared when data for this point is received from the adjacent downstream device and the COMM_LOST flag received with that data is cleared.

5.7 Maximum MW Real-Time Device Limitation

The [ISOCAISO](#)'s grid and market operations depend on data from a Real-Time Device to reliably run real-time operations, the Full Network Model, and the State Estimator. To minimize potential impact to the [ISOCAISO](#)'s grid and market operations, the [ISOCAISO](#) sets a maximum MW limitation. The limitation is set to protect the [ISOCAISO](#)'s markets and grid, should a Real-Time Device failure occur.

The maximum generation that can be put on a single Real-Time Device cannot exceed 1200 MW from a physical location. This includes the ECN circuit and router. The [ISOCAISO](#) reserves the right to review all proposed telemetry systems for compliance with this and other Real-Time Device limitations.

For Eligible Intermittent Resources and real-time Aggregators, the maximum combined generation for a single device, including the communication circuit and router, is 1200 MW.

5.8 Real-Time Device Location Requirements

The purpose of a real-time location requirement is to limit the impact of possible real-time failures to a smaller geographical area. Location limits are defined by the standard 23 Sub-LAPs within the [ISOCAISO](#) Balancing Authority Area. The location limitation provides that only resources within a Sub-LAP can be aggregated within a Real-Time Device. The Real-Time Device shall reside within the Sub-LAP for the resources it is aggregating.

The [ISOCAISO](#) can make an exception to the location limits for aggregating resources within a Real-Time Device if a resource is located in an adjacent Sub-LAP that does not have a Real-Time Device.

A Real-Time Device Aggregator can combine multiple physical resource locations within a Sub-LAP. The MW limitation and limitation of aggregation location to Sub-LAPs is due to the unpredictable nature of these resource types (that is, solar and wind). Only a [ISOCAISO](#) Energy Data Acquisition Specialist may authorize an exception to location limits. The list of the Sub-LAPs is set forth in Section 19.

These limitations do not apply if a Real-Time Device Aggregator desires to transmit real-time data to the [ISOCAISO](#) for information only. The Real-Time Device location limitations do not apply to Real-Time Devices used in the transmission of real-time data by Demand Response Providers (DRP) to the [ISOCAISO](#) for Proxy Demand Resources.

5.9 Real-Time Device Market Resource Limitation

The purpose of a resource limit is to mitigate the impact of a Real-Time Device failure on the [ISOCAISO](#)'s market Model State Estimator. If the [ISOCAISO](#) loses communication with many resources at once, it may impact the [ISOCAISO](#)'s modeling calculations. To mitigate this risk, the [ISOCAISO](#) has set the resource limit for a single Real-Time Device to 25 Resource IDs, subject to defined MW limits.

5.10 Cost Responsibility

Each Participating Generator will be responsible for all costs incurred for Real-Time Device procurement and installation for the purpose of meeting its obligations under this [ISOCAISO](#) BPM, notwithstanding other [ISOCAISO](#) policies, procedures, and contracts that may affect the distribution of costs to participating parties.

6. Telemetry Data Points List

The following values are the minimum requirements for real-time visibility of each resource. The [ISOCAISO](#)'s Operations & Engineering groups have approved these requirements. They are the minimum standards that will allow the [ISOCAISO](#) to manage effectively the reliability of the grid. At any time, the [ISOCAISO](#) may require additional points to be added to meet real-time requirements. The following points must be provided for each resource in the specified category. The Participating Generator must obtain the required point list from ~~an~~ [ISOCAISO](#) Energy Data Acquisition Specialists.

6.1 Point Matrix

The following pages represent the minimum point requirement matrix for each type of Real-Time Device configuration that the [ISOCAISO](#) requires for real-time control or monitoring. The matrix specifies the telemetry points required for the following categories of resources:

AGC: Resources certified to provide Regulation in the [ISOCAISO](#) Markets.

Spinning Reserve: Resources certified to provide Spinning Reserve in the [ISOCAISO](#) Markets.

Non-Spinning Reserve: Resources certified to provide Non-Spinning Reserve in the [ISOCAISO](#) Markets.

QF Conversion: Resources that are Qualifying Facilities not exempt from [ISOCAISO](#) Tariff telemetry requirements pursuant to pre-existing agreements. Note that MW, MVAR, and voltage values are measured based on the Point of Demarcation for a Net Scheduled [Resource](#) subject to a NS-PGA.

Energy Only: Resources that provide Energy only.

PDR: Proxy Demand Resources.

Solar: Solar resources.

Wind: Wind resources.

NGR: [Resources that operate](#) ~~ion~~ as either generation or load.

If a resource falls within more than one category, the Participating Generator or Real-Time Aggregator must provide the telemetry points specified for each applicable category.

Formatted: Font: Not Bold

Pseudo ties of Shared resources:

- Each share will be modeled as a simple generator.
- The Protocol Administrator, on behalf of the Pseudo-Tie PGA owners, will provide CAISO with separate telemetry data for the entire resource and for each share of the resource, in addition to any other telemetry data that may be required for CAISO market participation.
- The host entity will directly report its telemetry data along with the telemetry data for other shared resource owners.
- The Protocol Administrator's scheduling coordinator will be responsible for Telemetry compliance. Please refer to section 8.4.2 for more information on Telemetry Non-Compliance process.

Real-Time Point Definitions in this document has the detailed definitions in Table 6-1.

Table 6-1: Required Real-Time Points by Technology or Service

Notes to Analog and Digital Notes in the next section.

Analog	Point Label	AGC	Spinning Reserve	Non-Spinning Reserve	QF Conversion	Energy Only	PDR	Solar	Wind	Solar/Wind less than 10MW	Battery	Hybrid Resource
Unit-Gross MW	UGMW	X	X	X	X -Note 9	X	X -Note 10	X	X		X	X
Unit-Net MW	UNMW	X -Note 1	X -Note 1	X -Note 1	X -Note 1 & 9	X -Note 1		X -Note 1	X Note 1		X Note 1	X -Note 1
Unit-Point of delivery MW	UPMW	X	X	X	X	X		X	X	X	X	X

Formatted Table

Analog	Point Label	AGC	Spinning Reserve	Non-Spinning Reserve	QF Conversion	Energy Only	PDR	Solar	Wind	Solar/Wind less than 10MW	Battery	Hybrid Resource
Unit-Auxiliary MW	UAMW	X -Note 2	X -Note 2	X -Note 2	X -Note 2 & 9	X -Note 2		X -Note 42	X Note 2		X Note 2	X -Note 1
Pseudo Gen MW	PSDO- UPMW- MW						X					
Bias Load MW	BIAS -LOAD- MW						X					
Real Load MW	LOAD MW						X					
Unit-Generator Terminal Voltage	GEN KV	X	X	X	X	X		X	X	X -Note 12	X	X
Unit-Gross MVAR	UGMV	X	X	X	X Note 9	X		X	X		X	X
Unit-Net MVAR	UNMV	X -Note 3	X -Note 3	X -Note 3	X -Note 3 & 9	X -Note 3		X -Note 3	X Note 3		X Note 3	X -Note 3
Point of delivery MVAR	UPMV	X	X	X	X	X		X	X	X	X	X
Auxiliary MVAR	UAMV	X -Note 4	X -Note 4	X -Note 4	X -Note 4 & 9	X -Note 4		X -Note 43	X Note 4		X Note 4	X -Note 3
Capacitor Bank VAR	BNK- MVAR							X -Note 17	X -Note 17X		X Note 17	X -Note 17X
High/Line Side Bank MW	HSIDE MW	X -Note 5	X -Note 5	X -Note 5	X -Note 5	X -Note 5		X -Note 5	X -Note 5X		X -Note 5	X -Note 5X
High/Line Side Bank MVAR	HSIDE MVAR	X -Note 5	X -Note 5	X -Note 5	X -Note 5	X -Note 5		X -Note 5X	X -Note 5X		X -Note 5	X -Note 5X

Formatted Table

Analog	Point Label	AGC	Spinning Reserve	Non-Spinning Reserve	QF Conversion	Energy Only	PDR	Solar	Wind	Solar/Wind less than 10MW	Battery	Hybrid Resource
High/Line Side Bank Voltage	HSIDE KV	X -Note 5	X -Note 5	X -Note 5	X -Note 5	X -Note 5		X -Note 5	X -Note 5		X -Note 5	X -Note 5
Aggregated Gross MW	AGG UGMW	X -Note 6	X -Note 6	X -Note 6	X -Note 9	X -Note 6	X -Note 10	X -Note 6	X -Note 6		X -Note 6	X -Note 6
Aggregated Net MW	AGG UNMW	X -Note 6	X -Note 6	X -Note 6	X -Note 9	X -Note 6						
Aggregated Point of delivery MW	AGG UPMW	X -Note 6	X -Note 6	X -Note 6	X -Note 6	X -Note 6		X -Note 6	X -Note 6	X -Note 6	X -Note 6	X -Note 6
Aggregated Gross MVAR	AGG UGMV	X -Note 6	X -Note 6	X -Note 6	X -Note 6	X -Note 6		X -Note 6	X -Note 6	X -Note 6	X -Note 6	X -Note 6
Resource ID Setpoint Feedback	CTLFDBK	X										
RIG Heart Beat	HRT BT CTR	X	X	X	X	X	X	X	X	X	X	X
Aggregate/Unit Operating High Limit	UOHL	X										
Aggregate/Unit Operating Low Limit	UOLL	X										
Wind Speed (Meter / Second)	SPD							X	X	X		X

Analogs	Point Label	AGC	Spinning Reserve	Non-Spinning Reserve	QF Conversion	Energy Only	PDR	Solar	Wind	Solar/Wind less than 10MW	Battery	Hybrid Resource
Wind Direction (Degrees - Zero North 90CW)	<u>DIR</u>							X	X	X		X
Air Temperature (Degrees Celsius)	<u>TEMP</u>							X	X	X		X
Barometric Pressure (HPA)	<u>PRES</u>							X	X	X		X
Back Panel Temperature (Degree C)	<u>BPTMP</u>							X -Note 11		X -Note 11		X -Note 11
Plane Of Array Irradiance (Watts/Meter Sq.)	<u>PAIRD</u>							X -Note 11		X -Note 11		X -Note 11
Global Horizontal Irradiance (Watts/Meter Sq.)	<u>GHIRD</u>							X -Note 11		X -Note 11		X -Note 11

Formatted: Centered

Formatted: Centered

Formatted: Centered

Formatted: Centered

Analogs	Point Label	AGC	Spinning Reserve	Non-Spinning Reserve	QF Conversion	Energy Only	PDR	Solar	Wind	Solar/Wind less than 10MW	Battery	Hybrid Resource
Direct Irradiance (Watts/Meter Sq.)	<u>DIRD</u>							X -Note 11		X -Note 11		X -Note 11
Diffused Plane Of Array Irradiance (Watts/Meter Sq.)	<u>DIFPA</u>							X -Note 11		X -Note 11		X -Note 11
Diffused Global Horizontal Irradiance (Watts/Meter Sq.)	<u>DIRD</u>							X -Note 11		X -Note 11		X -Note 11
Reference Cell (MW @ .001 resolution)								X Note 44		X Note 44		X Note 44
Instantaneous State of charge	<u>SOC</u>										X	X -Note 15
Maximum Continuous Energy limit	<u>MXENERGY</u>										X	X -Note 15
VER Component Unit Point of Delivery: MW	<u>VERMW</u>											X -Note 14

Formatted: Centered

Formatted: Centered

Formatted: Centered

Formatted: Centered

Formatted: Centered

Formatted: Centered

Formatted: Centered

Formatted: Centered

Formatted: Centered

Formatted: Centered

Formatted: Centered

Formatted: Centered

Formatted: Centered

Formatted: Centered

Analog	Point Label	AGC	Spinning Reserve	Non-Spinning Reserve	QF Conversion	Energy Only	PDR	Solar	Wind	Solar/Wind less than 10MW	Battery	Hybrid Resource
<u>BESS Component MW</u>	<u>BESSMW</u>											<u>X</u> <u>-Note 19</u>
Droop Setting	<u>GOV DRP</u>	X	X	X	<u>X</u> <u>-Note 18</u>	<u>X</u> <u>-Note 18X</u>		<u>X</u> <u>-Note 18X</u>	<u>X</u> <u>-Note 18X</u>	<u>X</u> <u>-Note 18X</u>	<u>X</u> <u>-Note 18X</u>	<u>X</u> <u>-Note 18X</u>
Governor Dead band	<u>GOV DB</u>	X	X	X	<u>X</u> <u>-Note 18X</u>	<u>X</u> <u>-Note 18X</u>		<u>X</u> <u>-Note 18X</u>	<u>X</u> <u>-Note 18X</u>	<u>X</u> <u>-Note 18X</u>	<u>X</u> <u>-Note 18X</u>	<u>X</u> <u>-Note 18X</u>
Operational Unit Ramp rate	<u>OPER RR</u>	X	X	X	<u>X</u> <u>-Note 18X</u>	<u>X</u> <u>-Note 18X</u>		<u>X</u> <u>-Note 18X</u>	<u>X</u> <u>-Note 18X</u>	<u>X</u> <u>-Note 18X</u>	<u>X</u> <u>-Note 18X</u>	<u>X</u> <u>-Note 18</u>
High Sustainable Limit	<u>HSLMW</u>							X <u>-Note 16</u>	X <u>-Note 16</u>	X <u>-Note 16</u>		X

Formatted: Centered

Formatted: Centered

Formatted: Centered

Formatted: Centered

Formatted: Centered

Formatted: Centered

Formatted: Centered

Formatted: Centered

Formatted: Centered

Formatted: Centered

Digital	Point Label	AGC	Spinning Reserve	Non-Spinning Reserve	QF Conversion	Energy Only	PDR	Solar	Wind	Solar/Wind Less Than 10MW	Battery	Hybrid Resource
Unit Resource Connect <u>(UCON)</u>	<u>UCON</u>	X	X	X	X	X		X	X	X	X	X
PDR Resource Connect <u>(PDR UCON)</u>	<u>PDR UCON</u>						X					
Load Connection Status <u>(LOAD UCON)</u>	<u>LOAD UCON</u>						<u>X</u>					

Formatted Table

Digitals	Point Label	AGC	Spinning Reserve	Non-Spinning Reserve	QF Conversion	Energy Only	PDR	Solar	Wind	Solar/Wind Less Than 10MW	Battery	Hybrid Resource
Power System Stabilizer	<u>PSS</u>	X -Note 7	X -Note 7	X -Note 7	X -Note 7	X -Note 7		X Note 7				X Note 7
Automatic Voltage Regulator	<u>AVR</u>	X -Note 7	X -Note 7	X -Note 7	X -Note 7	X -Note 7		X Note 7				X Note 7
Capacitor Bank Breakers	<u>CB</u>							X -Note 17	X -Note 17		X -Note 17	X -Note 17
Unit Low Side Breaker	<u>CB</u>	X	X	X	X	X		X	X	X -Note 13	X	X
Related Unit Breakers	<u>CB</u>	X	X	X	X	X		X	X		X	X
Related Unit MOD's Disconnects	<u>MOD</u>	X	X	X	X	X		X	X		X	X
Switchyard Line Breakers (if Generator Owned)	<u>CB</u>	X	X	X	X	X		X	X		X	X
Switchyard Line MOD (if Generator Owned)	<u>MOD</u>	X	X	X	X	X		X	X		X	X
Aggregated Unit Connection Status (UCON)	<u>AGG UCON</u>	X -Note 6	X -Note 6	X -Note 6	X -Note 6	X -Note 6	X -Note 6	X -Note 6	X -Note 6		X -Note 6	X -Note 6
Aggregated Unit Authority Switch	<u>UASW</u>	X -Note 8										
Aggregated Unit Control Switch	<u>UCTL</u>	X -Note 8										
Aggregated Unit Automatic Generation Control	<u>UAGC</u>	X -Note 8										
Governor Block Status	<u>GOV BLK</u>	X	X	X	X	X		X	X	X	X	X X

Formatted Table

Formatted: Centered

6.2 Analog and Digital Notes

1. If Aux MW are over 1 MW then Net MW are required.
2. ~~Required~~ If Aux MW are over 1 MW then Aux MW is required.
3. If Aux MW are over 1 MW then Net MVR are required.
4. ~~Required~~ If Aux MW are over 1 MW then Aux MVAR is required.
5. Transformer High Side or Line values required depending on meter location.
6. Provide Unit Connected and Gross MW for each unit and aggregated values if Resource ID is an aggregate. ~~Individual POD not required if the Resource ID is an aggregate.~~
7. PSS / AVR indication is needed if plant is required to install these devices.
8. Required point for each Resource ID.
9. Required if the QF is not subject to a QF Participating Generator Agreement.
10. Resolution @ .001 Gross MW = POD.
11. ~~See Refer~~ the Solar Meteorological Data Tables in CAISO Tariff Appendix Q, Section 13.5 and definitions of data points in Section 17.4. Note that some data points are not required from solar thermal facilities.
12. Voltage from ~~ISO~~ CAISO meter at metering point
13. This does not have to be an actual circuit breaker but an indication from some device within the system showing when the resource is physically connected or disconnected to the grid. One point only per resource.
14. Variable Energy Resource (VER) ~~Component Unit Point of Delivery~~ MW is required for all Hybrid resources.
15. SOC and Max Energy is required for the hybrid resource, if the resource has a Battery component. Not required if battery component is non-dispatchable auxiliary equipment used only for startup processes.
16. HSL is required for VER components of Hybrid Resources, ~~and~~ VER Co-Located Resources, and VERs providing AS.
17. Upon Request from CAISO.
18. Governor Settings required as per IA, if Resource is capable of Primary Frequency Response or as required by other directives, i.e. providing Spinning Reserve.

Formatted: Tab stops: Not at 0.75"

Formatted: Indent: Left: 0.56", Hanging: 0.31", Tab stops: Not at 0.69" + 0.88"

Formatted: Tab stops: Not at 0.69" + 0.88"

~~46.~~19. Battery Energy Storage System (BESS) MW is required for all Hybrid resources with a battery component.

7. Availability and Maintenance

7.1 ISOCAISO Reliability Requirements

The Participating Generator shall be responsible for maintaining the availability of the Real-Time Device, all Real-Time Device interface systems, and Real-Time Device communications access to the communication network either to the ISP or ECN.

Risk of loss, theft, or damage of the Real-Time Device will be the responsibility of the Participating Generator.

A Participating Generator will be solely responsible, at the Participating Generator's cost, for preparing and maintaining the site at which a Real-Time Device will be installed, and for engineering, installation, operation, and maintenance of that Real-Time Device and all other activities associated with the installation, operation, and maintenance of that Real-Time Device; except that this provision does not supersede agreements addressing responsibility for costs of engineering, design, installation, and testing set forth in any agreement for the installation of a Real-Time Device. The ISOCAISO will provide support as described herein to ensure that the Real-Time Device properly interfaces with the ISOCAISO's EMS.

The local communications access circuit generally represents the highest risk to plant interface availability. Proper engineering of circuit pathways with alternate paths and redundancy wherever feasible is recommended. In all cases, the ISOCAISO recommends that the Participating Generator consider implementing a backup circuit to maintain communications.

A Participating Generator of a Real-Time Device is responsible for:

- Meeting the ISOCAISO network security requirements of using SSL/TLS
- Acting as the main point of contact for any data quality issue.
- Ensuring the accuracy of the data transmitted to the ISOCAISO.
- Resolving any data quality issues identified by the ISOCAISO.
- For a Real-Time Device Aggregator, see Section 15.

7.2 ISOCAISO-Controlled Grid Operation and Market Availability Requirement

A Participating Generator is solely responsible for all costs and other consequences associated with the unavailability of the Real-Time Device and the inability of the Real-Time Device to communicate with the ISOCAISO's EMS, including any financial consequences pursuant to the terms of the ISOCAISO Tariff. Such failure may result in penalties for failure to perform in accordance with the terms of the ISOCAISO Tariff. Additionally, the Participating Generator's

certification to provide Ancillary Services may be affected in accordance with the provisions of Sections 8.9 and 8.10 and other provisions of the [ISOCAISO](#) Tariff.


7.3 Real-Time Device Operation and Maintenance

This section describes the notification and interface requirements for the following activities:

- Software upgrades
- Database revisions
- Routine testing and maintenance

The Participating Generator is responsible for all activities associated with the operation and maintenance (O&M) of the Real-Time Device. Exhibit 7-1 illustrates the boundaries of O&M responsibility for system maintenance for the [ISOCAISO](#), the Participating Generator, and a telecommunications provider. The [ISOCAISO](#) is responsible for the O&M of [ISOCAISO](#) systems such as the EMS and the SCADA equipment connecting to the ECN or to the public Internet. The telecommunications provider is responsible for O&M of the WAN links between the [ISOCAISO](#) and the Participating Generator. The Participating Generator is responsible for O&M of plant systems of operating and maintaining the plant systems, the Real-Time Device, and the network connection to the ECN or to public Internet.

Exhibit 7-1: Operation and Maintenance Boundaries

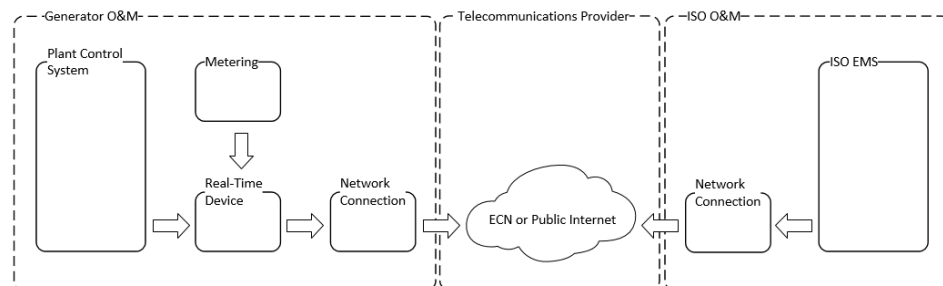

7.3.1 Coordination of Changes to the Real-Time Device

The intent of this section is to provide a process for notification and approval for installation of upgrades to the Real-Time Device as requested by a Participating Generator or required by the [ISOCAISO](#), based on the understanding that the overall functionality of the system must be ensured during upgrades without adversely affecting the [ISOCAISO](#)'s EMS.

The Participating Generator must safeguard and protect the Real-Time Device (hardware or software or both) and must treat the Real-Time Device as its own confidential business property. The Participating Generator must ensure that no person having access to the Real-Time Device

attempts to modify or reverse engineer the Real-Time Device software. The Participating Generator must also take reasonable steps to ensure that all persons having access to the Real-Time Device observe the Participating Generator's obligations relating to the Real-Time Device.

The [ISOCAISO](#) maintains a database that contains, for each Real-Time Device, the data points required from the Real-Time Point Definitions contained in this document. This Real-Time Device database may also contain additional data as required for mapping to the [ISOCAISO](#)'s EMS. In order to maintain operation of the EMS, the [ISOCAISO](#) requires prior notification and approval of all revisions to this Real-Time Device database.

A Participating Generator may make modifications to its Real-Time Device to support its operations, including the addition of data input/output points (which may or may not be made available to the [ISOCAISO](#)) and the addition or replacement of hardware, as required to accomplish the Participating Generator's purposes, provided that:

- The Participating Generator coordinates such changes with the [ISOCAISO](#) and first obtains from an [ISOCAISO](#) Energy Data Acquisition Specialist the relevant information from the latest revision of the [ISOCAISO](#) database of Real-Time Devices.
- The Participating Generator remains solely responsible for all costs and other consequences associated with any interruption, as a result of such changes or modifications, in the ability of the Real-Time Device to communicate with the [ISOCAISO](#)'s EMS, including financial consequences, according to the [ISOCAISO](#) Tariff.
- The Participating Generator notifies the [ISOCAISO](#) at least seven days prior to any revision.
- The Participating Generator submits a database revision for review by an [ISOCAISO](#) Energy Data Acquisition Specialist and clearly states the proposed database changes, including the new revision, the installation date, and a valid OMS outage number.
- Following [ISOCAISO](#) approval of the database revision request, the Participating Generator adheres to the requirements contained in this document during the installation of the changes.
- The Participating Generator notifies the [ISOCAISO](#) before installation of the changes and participates with the [ISOCAISO](#) in joint testing prior to placing the Real-Time Device back in service.

The [ISOCAISO](#) requires prior notification and approval of all vendor software upgrades to the Real-Time Device in order to assure that the changes do not have an adverse impact on the [ISOCAISO](#)'s EMS. The Participating Generator's obligations are as follows:

- The Participating Generator must notify the [ISOCAISO](#) at least seven days prior to any software upgrade installation.
- The Participating Generator must provide a valid OMS outage number that clearly covers the software upgrade. (For more information outage coordination, see [ISOCAISO](#) documentation on Outage Coordination under References.)
- Upon the [ISOCAISO](#)'s approval of the software upgrade installation request, and during installation of the upgrade, the Participating Generator must adhere to all requirements contained in this document and must follow all Outage Coordination process in accordance with the [ISOCAISO](#) Tariff.
- The Participating Generator must notify an [ISOCAISO](#) Energy Data Acquisition Specialist before installation of any software upgrade affecting a Real-Time Device.

7.3.2 Database Configuration and Management Affecting the [ISOCAISO](#)'s EMS

The intent of this section is to provide a process for changes to a Real-Time Device database in the event of modifications, either by the [ISOCAISO](#) or by the Participating Generator, that affect the functionality of the [ISOCAISO](#)'s EMS software or database.

- In the event that the [ISOCAISO](#) requires changes, the [ISOCAISO](#) will notify each affected Participating Generator 120 days in advance of such changes and will provide a detailed explanation of the changes to be made.
- In the event that the Participating Generator requires changes to the Real-Time Device database that affect the [ISOCAISO](#)'s EMS software or database, the Participating Generator must contact a [ISOCAISO](#) Energy Data Acquisition Specialist 120 days in advance of the requested change.
 - In this case, the Participating Generator is responsible for making any necessary conforming changes to the Real-Time Device to maintain the interface with the [ISOCAISO](#)'s EMS.
 - The [ISOCAISO](#) will work with Participating Generators to stage the work so that no Generating Unit will be adversely affected in its ability to provide Regulation due to the unavailability of the human resources required to accomplish the changes.
- Any such modifications or changes must not compromise the Participating Generator's right or ability to restrict access to information associated with the Participating Generator's resources by any party.

7.3.3 Routine Testing and Maintenance of Real-Time Devices

The Participating Generator is solely responsible for the completeness and accuracy of all information transmitted by a resource to the Real-Time Device. The ~~ISO~~CAISO will not be responsible for the quality of the data transmitted through the Real-Time Device; the ~~ISO~~CAISO will only validate this information for accuracy. The ~~ISO~~CAISO and the Participating Generator must monitor the Participating Generator's data transmitted through the Real-Time Device and, upon observation of any problems with that data, either party must provide the other party notice of the problem and both must work together to correct the problem.

The Participating Generator is responsible for all routine testing and maintenance of the real-time devices RIGs. The intent is to provide resource owners with the process to follow in order to maximize RIG operation while periodic maintenance and/or testing is performed. Minimizing the loss of real-time device RIG communication, and thereby minimizing the period when a resource is unavailable for bidding in the Ancillary Services markets, is in the best interest of both the resource owner and the CAISO. The resource owner must also avoid sending spurious or inaccurate data through the RIG real-time device as a result of testing and maintenance activities without first coordinating test plans and actions with the CAISO. Spurious and inaccurate data sent through a real-time device RIG to the CAISO and which the CAISO is not expecting to receive will impact the CAISO's real time Balancing Authority Area load and reserve requirements calculations and its markets.

- Planned periodic maintenance and testing of the Real-Time Devices should be performed during scheduled resource outages.
- The Participating Generator understands that loss of Real-Time Device communication will result in the inability of the resource to participate in Ancillary Services markets.
- ~~• In the event that a resource has failed to communicate or provide telemetry for seven calendar days (consecutive or nonconsecutive), the ISO will send a letter to the Scheduling Coordinator. If compliance issue are not resolved within 30 days, the ISO will send an additional letter to inform the Participating Generator and Scheduling Coordinator that the resource's ability to participate in Energy or Ancillary Services markets may be removed.~~
- Outages must be requested through the resource's Scheduling Coordinator. Planned work on Real-Time Devices should take place only between the hours of 8:00 am and 4:00 pm Pacific time, Monday through Friday, excluding ~~ISO~~CAISO holidays. (For more information, see ~~ISO~~CAISO documentation on Outage Coordination under References.)

8. Real-Time Device Implementation

8.1 Engineering and Deployment

The Participating Generator is responsible for all procurement, engineering services, and maintenance with regard to the installation of the Real-Time Device. The [ISOCAISO](#) suggests that the first step in the installation process be that the resource coordinates a “kick off” meeting.

8.2 Real-Time Device Database Development

The [ISOCAISO](#)'s Real-Time Device Engineer will provide technical assistance as required to the Participating Generator during the Real-Time Device hardware selection process. [ISOCAISO](#) EDAS will also provide assistance during the development of the Real-Time Device database.

8.3 Telecommunication Circuit Installation and Power Requirements

The Participating Generator may obtain communication access circuit(s) from the ECN provider or an ISP provider. The LEC is responsible to provide the circuit to the plant main point of entry (MPOE) only. It is the Participating Generator's responsibility to provide for, or contract services for, the implementation of high voltage protection (HVP) for these circuits where required. It is also the Participating Generator's responsibility to provide on-site extension of the communication network circuit(s) to the actual Real-Time Device cabinet location on-site.

All service power to communication equipment and the Real-Time Device must be powered by an uninterruptable power supply (UPS) for the same amount of time the LEC is providing. This is not limited to Real-Time Device router, fiber optic power on both ends of the cabling, and Channel Service Unit/Data Service Unit (DSUCSU). Any communication equipment and device providing communications to the Real-Time Device must install a UPS or equivalent. For Eligible Intermittent Resources, see *Power Reliability Requirements* in this document.

8.4 Temporary Telemetry Exemptions

The [ISOCAISO](#) may grant a temporary telemetry exemption for a resource that is new to participation in the [ISOCAISO](#)'s markets or that currently exists in the [ISOCAISO](#)'s markets, but an exemption is not guaranteed. –The exemption is used for a Participating [ResourceGenerator](#) that is unable to comply with applicable telemetry requirements prior to the transition of its resource to commercial operations in the [ISOCAISO](#)'s markets, or for which telemetry is lost or not in good quality during participation in the [ISOCAISO](#)'s markets. –Temporary telemetry exemptions are focused on particular data. –A Participating [ResourceGenerator](#) must provide all required documentation in order to submit a request for a telemetry exemption.

8.4.1 – Pre-Commercial Units

Units that are working to complete the process to begin operating commercially in the CAISO's markets, but have not completed all aspects of the project to provide required telemetry to the CAISO, may request a temporary exemption from the CAISO Tariff section 7.6.1(d). The temporary telemetry exemption form can be found on the CAISO website under Participate > Metering and Telemetry, and should be submitted to the CAISO as per the instructions on the form. The CAISO may accept, not accept, or alter the requested end date on the temporary telemetry exemption request as noted in the Telemetry Requirements Exemption Policy included as Attachment 1 to the form.

~~Pre-Commercial units experiencing a total loss of telemetry or telemetry failure of any of the critical points listed in 8.4.2 must stop testing until telemetry is restored.~~

Formatted: Not Highlight

8.4.2 – Commercial Units

Upon notification from the ISO that either a telemetry failure has occurred or telemetry is in bad quality that impacts the following points, a resource owner is responsible for expeditiously investigating and resolving the issue to remain compliant with ISO Tariff section 7.6.1(d). Detailed information about telemetry points can be found in Section 14 of this BPM. The following points are to be considered critical:

- Generation Points – All resources
 - UPMW - Unit Point of Delivery MW
 - UGMW – Unit Gross MW*
 - UNMW – Unit Net MW*
 - UAMW – Unit Auxiliary MW*
 - UCON – Unit Resource Connect
- *~~As CAISO EDAS and/or Operations deems critical~~ If applicable for the resource
- Meteorological Points - Solar and Wind Resources
 - BPTMP - Back Panel Temperature
 - PAIRD – Irradiance
 - SPD - Wind Speed
 - DIR - Wind Direction
- Battery Specific Points
 - SOC – Instantaneous State of Charge in MWh
 - MXENERGY – Maximum Continuous Energy Limit in MWh
- Ancillary Service Specific Points – for units providing Regulation AS
 - UOHL - Unit Operating High Limit
 - UOLL - Unit Operating Lower Limit
 - ~~UASW – ISO Unit Authority Switch~~
 - ~~UCTL – Unit Control Status~~
 - UAGC - Unit Automatic Generation Control

Formatted: Not Highlight

Formatted: Indent: Left: 1", No bullets or numbering

Formatted: Not Highlight

Formatted: Not Highlight

- Co-Located, and Hybrid, and VERs Providing AS Resource Specific Points
 - HSL – High Sustainability Limit
- Any future telemetry points that are direct inputs into the IFM/RTN Software, AGC, Load Calculation/Forecast

A telemetry failure is defined as having occurred when the data for any of the above points have been unavailable or in bad quality for 30-minutes, or when frequent yet shorter drops in data or quality have been noticed (intermittent issues). Upon notification to the resource owner and its Scheduling Coordinator of the telemetry issue, the Scheduling Coordinator will create a telemetry outage using the Outage Management System^{Δ*} (OMS) and will contact the resource owner to resolve the issue or request an exemption from the CAISO for providing the telemetry data by the following deadlines:

- (5) business days after notification of the telemetry issue for resources whose range of operation or Pmax is \leq 45 MWs, whichever is more.⁴
- (140) business days after notification of the telemetry issue for resources whose range of operation or Pmax is \geq 45 MWs, whichever is more.⁴

Note: These MW thresholds will also apply to failures associated with an aggregated RTU where multiple smaller resources submit telemetry data to CAISO via a singular RTU.

Example: IRGXXX contains 5 resources, which are each 10 MW PMax each. Each resource under IRGXXX is subject to the 5 business day requirement above since the total resource PMax under IRGXXX is 50 MW.

^{Δ*} OMS cards are optional for Meterological Points

During the time that good quality telemetry data is not being automatically provided to CAISO through the RTU, telemetry value updates will be expected to be verbally provided to CAISO by the Scheduling Coordinator as follows:

- For resources with a total capacity or range < 25 MW, no reports of generation or charging/discharging are required, other than the status of resolution of the telemetry issue, unless specifically requested.
- For resources with a total capacity or range of 25 – 150 MW, report every 25 MW change of generation or charging/discharging and report plant status changes (online, offline, configuration change).
- For resources with a total capacity or range of > 150 MW, report every 50 MW change of generation or charging/discharging and report plant status changes (online, offline, configuration change).
- For NGR resource only with total range \leq 50 MWs, report changes every 25 MWH in SOC and MXENERGY

Formatted: Indent: Left: 0.5", First line: 0"

Formatted: Not Highlight

Formatted: Not Highlight

Formatted: Not Highlight

Formatted: Indent: Left: 0.5", First line: 0"

Formatted: Font: Italic

Formatted: Indent: Left: 0.5", First line: 0"

Formatted: Not Highlight

Formatted: Not Highlight

Formatted: Not Highlight

Formatted: Not Highlight

- For NGR resource only with total range > 50 MWs, report changes every 50 MWH in SOC and MXENERGY

Please note that the updates are required only for the data point(s) that have a Telemetry issue.

Formatted: Normal, No bullets or numbering

Formatted: Indent: Left: 0.5", No bullets or numbering

If a resource is certified to provide Ancillary Services, the resource shall not bid into the Ancillary Service market or self-provide Ancillary Services ~~anymore~~ until telemetry is restored. Any awards or self provision already in place at the time of the telemetry failure would be subject to buy-back and possibly other settlement consequences. The temporary telemetry exemption form can be found on the CAISO website under Participate > Metering and Telemetry and should be submitted to CAISO as per the instructions on the form. Information required to be provided to CAISO on the form includes a detailed description of the issue, the steps being taken to resolve it, and the expected date of resolution of the issue. The CAISO will review the submitted telemetry exemption request and respond back to the resource owner and its Scheduling Coordinator as follows:

- If a telemetry exemption request is not accepted by CAISO, it will notify the resource owner and its Scheduling Coordinator, and provide guidance regarding what aspect of the request was not acceptable to CAISO. A new telemetry exemption request addressing the unacceptable aspect of the previous submission must be submitted to CAISO within (5) business days of the deficiency notification from CAISO.
- If the telemetry exemption request is accepted by CAISO, it will notify the resource owner and its Scheduling Coordinator, and will expect the issue to be resolved no later than the time identified in the accepted telemetry exemption request.
- If the telemetry issue cannot be resolved by the date committed to in the accepted telemetry exemption request, another telemetry exemption request must be submitted prior to the expiration of any existing accepted telemetry exemption that explains the delay and provides a new date for resolution of the issue.
- For telemetry issues impacting grid reliability, resources may be ordered offline by the CAISO Operators, ~~Generation Desk~~ at any time. Telemetry Exemption status has no bearing on this decision.
- If CAISO deems that issue is not being appropriately addressed in a timely manner and/or not providing timely updates for MW changes, the resource may be denied a current or future exemptions, and even be issued an Operating Instruction to come offline by the CAISO Operators.

Formatted: Not Highlight

Formatted: Not Highlight

Formatted: Not Highlight

Note: The CAISO may accept, not accept, or alter the requested end date on the telemetry exemption request as noted in the Telemetry Requirements Exemption Policy included as Attachment 1 to the form. ~~CAISO will make every effort to respond to telemetry exemption requests within 5 business days.~~

Formatted: Not Highlight

An initial telemetry exemption will typically be granted ~~for 154 calendar days~~ in good faith assuming a reasonable plan for resolution is included in the telemetry exemption request. Any

Formatted: Font: (Default) Arial, Not Highlight

subsequent exemption renewal requests ~~will require~~ should include two forms of additional documentation from the following list:

Formatted: Font: (Default) Arial, Not Highlight

- Purchase order for parts needed for repairs
- Signed agreements for contractors hired to complete troubleshooting
- Service tickets with communication service providers
- Emails that show substantial progress on telemetry restoration
- Other documentation as approved by CAISO on a case by case basis

Any and all exemption requests extending beyond 30 days will require documentation supporting the extenuating circumstances preventing telemetry from being restored. Exemptions beyond 30 days will be granted on a case by case basis and are not guaranteed. Telemetry has a direct impact on CAISO Real-Time Operations and Grid Reliability, and all efforts are needed to expedite resolution of the telemetry issues are expected by CAISO.

Formatted: Font: (Default) Arial

Failure to resolve the telemetry issue by the end of an accepted telemetry exemption period, or to submit a telemetry exemption request or telemetry data as per the guidelines documented in this BPM section will result in a Rules of Conduct violation as per ISO Tariff section 37.6, and penalties will be assessed accordingly to the Scheduling Coordinator of the resource.

Resolution of the telemetry issue will be considered complete when the telemetry data in question has been received in good quality for (72) consecutive hours. ~~OMS cards for telemetry issues may be end as soon as real-time telemetry is restored, but may wait for 72 hours of stable telemetry.~~ For the purposes of penalties assessed as per ISO Tariff section 37.6, the days associated with the (72) consecutive hours of good quality data will not be considered. ~~as~~ The resolution of the issue will be deemed to have occurred at the beginning of the (72) hour period. If the resource owner fails to work diligently to resolve the telemetry issue, the ISO will provide formal notification to the resource owner and its Scheduling Coordinator that the resource is not compliant with the ISO Tariff section 7.6.1(d) and therefore in breach of their contract with the ISO. The ISO will then proceed as per the parameters outlined in their contract with the ISO to have the resource associated with the telemetry failure removed from the Schedule 1 of their contract with the ISO. Upon removal from the Schedule 1 of their contract with the ISO, the Scheduling Coordinator association for the resource will also be terminated.

8.4.1—Pre-Commercial Units

Units that are working to complete the process to begin operating commercially in the ~~ISO/CAISO's~~ markets, but have not completed all aspects of the project to provide required telemetry to the ~~ISO/CAISO~~, may request a temporary exemption from the ~~ISO/CAISO~~ Tariff section 7.6.1(d).

The temporary telemetry exemption form can be found on the ~~ISO/CAISO~~ website under Participate\Metering and Telemetry, and should be submitted to the ~~ISO/CAISO~~ as per the instructions on the form.

The ISOCAISO may accept or not accept the temporary telemetry exemption request as noted in the Telemetry Requirements Exemption Policy included as Attachment 1 to the form.

8.4.2—Commercial Units

Upon notification from the ISOCAISO that either a telemetry failure has occurred or telemetry is in bad quality that impacts the following points (Unit Point of Delivery MW, Unit\Resource Connect, Back Panel Temperature, Irradiance, Wind Speed or Wind Direction, High Sustainable Limit), a resource owner is responsible for expeditiously investigating and resolving the issue to remain compliant with ISOCAISO Tariff section 7.6.1(d).

A telemetry failure is defined as having occurred when the data for either the Unit Point of Delivery MW or the Unit\Resource Connection point has not been provided for 30 minutes for resources ≥ 45 MWs and 60 minutes for resources < 45 MWs. For the Back Panel Temperature, Irradiance, Wind Speed or Wind Direction points, a telemetry failure is defined as having occurred when the data for these points has not been provided for 24 hours.

Upon notification to the resource owner and its Scheduling Coordinator of the telemetry issue, the Scheduling Coordinator will create a telemetry outage using the Outage Management System (OMS) and will contact the resource owner to resolve the issue or request an exemption from the ISOCAISO for providing the telemetry data by the following deadlines:

- (5) Business days after notification of the telemetry issue for resources ≥ 45 MW's.
- (14) Business days after notification of the telemetry issue for resources < 45 MW's.

Note: These MW thresholds will also apply to failures associated with an aggregated RTU where multiple smaller resources submit telemetry data to the ISOCAISO via one RTU.

During the time that good quality telemetry data is not being automatically provided to the ISOCAISO through the RTU, telemetry value updates will be expected to be verbally provided to the ISOCAISO by the Scheduling Coordinator as follows:

- For plants with a total capacity < 10 MW, no reports of changes are required, other than the status of resolution of the telemetry issue.
- For plants with a total capacity of 10—500 MW, report every 25 MW change and report plant status changes (online, offline, configuration change).
- For plants with a total capacity of > 500 MW, report every 50 MW change and report plant status changes (online, offline, configuration change).

If a resource is certified to provide Ancillary Services, the resource shall not bid into the Ancillary Service market or self-provide Ancillary Services. Any awards or self-provision already in place at the time of the telemetry failure would be subject to buy-back and possibly other settlement consequences.

The temporary telemetry exemption form can be found on the ISOCAISO website under Participate/Metering and Telemetry, and should be submitted to the ISOCAISO as per the instructions on the form. Information required to be provided to the ISOCAISO on the form includes a detailed description of the issue, the steps being taken to resolve it and the expected date of resolution of the issue.

The ISOCAISO will review the submitted telemetry exemption request and respond back to the resource owner and its Scheduling Coordinator as follows:

- If a telemetry exemption request is not accepted by the ISOCAISO, the ISOCAISO will notify the resource owner and its Scheduling Coordinator, and provide guidance regarding what aspect of the request was not acceptable to the ISOCAISO. A new telemetry exemption request addressing the unacceptable aspect of the previous submission must be submitted to the ISOCAISO within (5) business days of the deficiency notification from the ISOCAISO.
- If the telemetry exemption request is accepted by the ISOCAISO, the ISOCAISO will notify the resource owner and its Scheduling Coordinator, and will expect the issue to be resolved no later than the time identified in the accepted telemetry exemption request.
- If the telemetry issue cannot be resolved by the date committed to in the accepted telemetry exemption request, another telemetry exemption request must be submitted prior to the expiration of any existing accepted telemetry exemption that explains the delay and provides a new date for resolution of the issue.

Note: The ISOCAISO may accept or not accept the new telemetry exemption request as noted in the Telemetry Requirements Exemption Policy included as Attachment 1 to the form.

Failure to resolve the telemetry issue by the end of an accepted telemetry exemption period, or to submit a telemetry exemption request or telemetry data as per the guidelines documented in this BPM section will result in a Rules of Conduct violation as per ISOCAISO Tariff section 37.6, and penalties will be assessed accordingly to the Scheduling Coordinator of the resource.

- Resolution of the telemetry issue will be considered complete when the telemetry data in question has been received in good quality for (72) consecutive hours.
- For the purposes of penalties assessed as per ISOCAISO Tariff section 37.6, the days associated with the (72) consecutive hours of good quality data will not be considered as the resolution of the issue will be deemed to have occurred at the beginning of the (72) hour period.

If the resource owner fails to work diligently to resolve the telemetry issue, the ISOCAISO will provide formal notification to the resource owner and its Scheduling Coordinator that the resource is not compliant with the ISOCAISO Tariff section 7.6.1(d) and therefore in breach of their contract with the ISOCAISO. The ISOCAISO will then proceed as per the parameters outlined in their contract with the ISOCAISO to have the resource associated with the telemetry failure removed from the Schedule 1 of their contract with the ISOCAISO. Upon removal from

~~the Schedule 1 of their contract with the ISCAISO, the Scheduling Coordinator association for the resource will also be terminated.~~

9. FNM Database Process and Real-Time Installation

The FNM database process and Real-Time Device installation for real-time telemetry data section references the required steps for new and existing Real-Time Devices entering or maintaining the installation.

9.1 ~~ISO~~CAISO FNM Database Process

Section deprecated. See New Resource Implementation Timeline in References.

9.2 New Database Submission

9.2.1 Standards to Submit Real-Time Device Database for ~~ISO~~CAISO Database Build

Section deprecated. See New Resource Implementation Timeline in References.

9.3 Real-Time Database Submittal Timeline

Section deprecated. See New Resource Implementation Timeline in References.

9.4 Network Physical Circuit Protection to the Resource

- Copper installation at the de-marc,
 - High-Voltage Protection (HVP) may be required by the Local Exchange Carrier (LEC)
 - Longer lead time (up to 90 days)
- Fiber optic installation at the demarc
 - Shorter lead time (30 to 60 days)
 - No HVP required in most cases

9.5 Network Circuit Provisioning and Monitoring

9.5.1 AT&T ECN or ANIRA IPsec VPN

- For the ECN option, the Participating Generator provides a router from an approved list of routers and contacts with AT&T to provision a T1 circuit.
- Alternatively, for the ANIRA option, the Participating Generator provides a broadband connection (Ethernet or cellular IP) to establish an Internet Protocol Security (IPsec) connection to the ECN; there is no need for the Participating Generator to provide an ECN router or a T1 circuit.

- For either option, the Participating Generator maintains an ~~ISO~~[ISO](#)CAISO-provisioned digital certificate to provide encryption over the ECN.
- AT&T optionally provides 24x7 router and circuit monitoring with same-day technician dispatch.
- The Participating Generator optionally contracts with a third-party integrator.

9.5.2 Self-Maintained Network and Circuit Monitoring

- With this option, Participating Generators would provide or contract their own network and circuit monitoring and would be responsible for resolving any problems with the network circuit.

9.6 Standards for Point-to-Point Testing with the ~~ISO~~[ISO](#)CAISO

Before a Participating Generator submits a request to test its Real-Time Device installation, the Participating Generator must pretest all data points to a DNP3 master simulating the ~~ISO~~[ISO](#)CAISO connection without security prior to the scheduled test date. This pretest is to assure quick testing with the ~~ISO~~[ISO](#)CAISO.

The Participating Generator has the responsibility to validate and notify the ~~ISO~~[ISO](#)CAISO that the DNP3 point-to-point pretesting is complete. Use the ~~ISO~~[ISO](#)CAISO Energy Data Acquisition Specialist E-mail Address in References to submit the notification. Without this notice, the schedule test date may be canceled.

Methods of pretesting

- DNP3 master emulator
- DNP3 master test set
- Other DNP3 software capable of polling the Real-Time Device

Additional Real-Time Device configuration needed before final testing can be performed

- Device PKI certificates installed
- Review documentation provided by ~~ISO~~[ISO](#)CAISO

Important: It is essential that the Participating Generator perform pretesting with the Plant Control System and Revenue Meter through to a DNP3 master simulation before testing with the ~~ISO~~[ISO](#)CAISO. Manipulation of real-time data at the ~~Real-Time Device~~ ~~real-time~~ is not an acceptable method of testing unless the Real-Time Device is the resource's control system.

Testing of points

See the procedure for Acceptance Testing for Real-Time Devices under References for more information on the following. Each analog point must be tested to full, mid, and low scale. The [ISOCAISO](#) may, at its discretion, optionally allow other values.

- The On and Off state for each digital point must be verified.
- Calculated points must be tested by changing inputs to the calculation.
- Set Points will be tested to full, mid, and low scale.

Revenue meter real-time point testing for a new real-time Installation

- An [ISOCAISO](#) revenue meter used for any analog points must be tested by injecting voltage and current into the meter. Other types of transducers can be used in lieu of an [ISOCAISO](#) revenue meter.

Revenue meter real-time point testing for an existing Real-Time Device installation

- In this case, the Participating Generator may use a synced resource or a meter test to verify the real-time values.

Point testing with the [ISOCAISO](#) shall be undertaken as the last part of the testing and installation phase.

The Participating Generator has the responsibility to complete all pretesting before scheduling CAISO testing. If not, a delay or rescheduling of CAISO testing may be required.

9.7 Required Personnel for Point testing

- At the scheduled RIG real-time device testing date, the following personnel are needed for testing:
 - Resource personnel capable of exercising each real-time point required to be sent to the CAISO's EMS from the resource control system through the RIGreal-time device.
 - Integrator responsible for the RIG real-time device installation.
 - Revenue meter personnel who can inject test values into the meter to verify real-time data going to the CAISO's EMS through the real-time device. The CAISO may make an exception to this requirement for an operating resource if it does not include new generation.

- Testing from the RIG real-time device to the CAISO's EMS alone is not considered sufficient for a CAISO point test (i.e., plant control system to RIG real-time device to CAISO's EMS).
- The final CAISO test will be complete at the time the resource is in Trial Operations or is an existing resource and it is running and synced to the grid.

9.8 Real-Time Device Data Validation

- After the Real-Time Device has passed the point to point testing and the resource has synced to the CAISO grid a 72 hour data test is performed. During this test, CAISO shall test the following examples:
 - Un-interrupted communication connection to CAISO
 - Un-interrupted Real-Time Device connection to downstream devices such as Revenue meter, Met station and SCADA systems.
 - All Analog and Digital data in good quality
 - All logics working as expected.

9.9 Upgrade or Replacement of a Real-Time Device

- Standards of replacing, upgrading, or modifying an existing Real-Time Device:
 - The Participating Generator must submit an OMS Outage for some time during the period Monday-Friday between 8:00 a.m. and 4:00 pm only. The existing Real-Time Device must be returned to service after 4:00 pm daily.
 - The Participating Generator must provide 72 hours lead time for scheduled testing times.
 - A third-party engineering firm may not request the existing CAISO spreadsheet directly from the CAISO. The CAISO must receive an e-mail from the Participating Generator granting permission for the CAISO to provide the spreadsheet to the third party.
 - The CAISO will verify the request with the Participating Generator.
 - The CAISO will only give IP addresses to the Participating Generator, unless directed differently.
 - All other point testing discussed previously is required.
 - If the resource is operating, generally, calculated points (UCON) cannot be tested. These points will be verified when the resource shuts down.

9.10 Outage Management for Meter or Real-Time Device work

The [ISOCAISO](#) Energy Data Acquisition Specialist group will not approve any work on a Real-Time Device or [ISOCAISO](#) revenue meter without an approved outage and a fieldwork appointment on the EDAS calendar.

Plant personnel will need to call an [ISOCAISO](#) Energy Data Acquisition Specialist at 916-608-5826 or have an EDAS member included in a conference call group before work can begin.

- Before the plant personnel calls, they must verify that:
 - The outage has a valid outage number.
 - The outage number is for the **actual** times, work, and equipment being performed.
 - The outage number has been **started** and the **OUT** (Active) state.
- The call is made to [ISOCAISO](#) Energy Data Acquisition Specialist, 916-608-5826 Plant/Generator personnel coordinates all work for:
 - Third Party Meter Engineers: They are to call the [ISOCAISO](#) Energy Data Acquisition Specialist group at the number above before removing a meter out of service.
- Real-time Integrators: They are to call the [ISOCAISO](#) Energy Data Acquisition Specialist group at the number above before starting work on a real-time. What [ISOCAISO](#) Real-Time Device Engineering is not responsible for:
 - Submitting the outage.
 - Starting the outage.
 - Obtaining the outage number.
 - Calling all the parties responsible.
- Taking the resource to the OUT (active) state. [ISOCAISO](#) Energy Data Acquisition Specialist Action with an outage.
 - Call the [ISOCAISO](#) Real-Time Operator before work starts.
 - Call the [ISOCAISO](#)'s service center (SMSC) about the pending work.
 - Manually Replace the resource's current MW output for the FNM and EMS load calculation, and coordinate with the plant personnel to keep values current during the outage.

9.11 Digital Certificates

The Participating Generator must meet the following requirements to obtain an [ISOCAISO](#)-provisioned SSL/TLS digital certificate to secure Real-Time Device communications. See References for [ISOCAISO](#) Energy Data Acquisition Specialist e-mail address and phone number.

- Copy [ISOCAISO](#) EDAS on all certificate requests or correspondence.
- If the request is for a new installation, obtain the Common Name value for the Real-Time Device from [ISOCAISO](#) EDAS either by e-mail or phone.
- The [ISOCAISO](#) will ask if the Participating Generator intends to work with a third party to request, install, or renew a digital certificate.
- There is a ten-day lead time to provision digital certificates.
- All certificate requests must include a completed request with an attached Certificate Signing Request (CSR); see *Request Form for Digital Certificate for Real-Time Device* in References for the request form.
 - Indicate on the form whether the request is for a new installation.
 - The Participating Generator must e-mail the completed certificate request using the e-mail addresses listed in References under *E-mail Addresses for Submitting a Certificate Signing Request*.
- The Participating Generator must obtain an approved outage for the installation of the new digital certificate.
- At least two weeks prior to the expiration of an existing digital certificate, the Participating Generator must inform [ISOCAISO](#) EDAS of the outage scheduled to replace the certificate.
- [ISOCAISO](#) Energy Data Acquisition Specialist is not responsible for the timing of the renewal request sent by the Participating Generator.
- The Participating Generator can install the digital certificate on the Real-Time Device during the scheduled outage.
- The [ISOCAISO](#) will inform each Participating Generator of pending expiration of digital certificates at least two months prior to expiration. It is the responsibility of Participating Generators to remain aware of pending expiration of digital certificates and to watch for notices.

9.12 Wind and Solar FNM Documentation Required

The additional requirements are covered in the Tariff Appendix Q must be provided by the Participating Generator for wind and solar resources, including Hybrid resources with a VER component and VER Co-Located Resources

10. AGC Operational Requirements for Generating Units

10.1 Required DNP3 and Telemetry Data Points for AGC

To meet the minimum requirement of real-time visibility for Generating Units providing Automatic Generation Control (AGC) to the [ISOCAISO](#), each Real-Time Device must be capable of communicating the following types of values to/from the [ISOCAISO](#)'s EMS:

- Analog input values to the [ISOCAISO](#)
- Digital input values to the [ISOCAISO](#)
- Analog output (Set Points) from the [ISOCAISO](#)

To meet the minimum requirement of real-time visibility for Generating Units providing Automatic Generation Control (AGC) to the [ISOCAISO](#), each Real-Time Device must be capable of communicating the following telemetry data points to/from the [ISOCAISO](#)'s EMS:

- Unit Control Switch (UCTL)
- Unit Authority Switch (UASW)
- Automatic generation control (UAGC)
- Automatic generation control Set Point
- Automatic generation control feedback
- Unit Operating High Limit (UOHL)
- Unit Operating Low Limit (UOLL)

For a detailed description of the minimum data point requirements for Generating Units providing AGC Regulation to the [ISOCAISO](#) please refer to Section [6.1 Point Matrix](#)⁴⁷.

The [ISOCAISO](#) Operations and Engineering groups have approved the list of data point requirements described herein. They are the minimum data point standards that will allow the [ISOCAISO](#) to manage effectively the reliability of the grid. **At any time, the [ISOCAISO](#) may require additional telemetry values to meet real-time operational requirements.**

10.2 AGC Control (Bumpless Transfer)

For resources providing AGC, the Real-Time Device may have the option to set up a bump-less transfer method for AGC control, to track Set Point when resources are off AGC control. A calculated Set Point will be stored in the Real-Time Device, continually updating with the current Point of Delivery MW value of the resource or aggregate resource. When the resource transfers

to AGC control, and starts accepting valid Set Points, the calculation will deactivate. The calculation should only reactivate when AGC control is disengaged.

11. Eligible Intermittent Resources (EIR)

11.1 Applicability

The Eligible Intermittent Resources Protocol (EIRP) in Appendix Q of the [ISO-CAISO](#) Tariff imposes various communication and forecasting equipment and forecasting data requirements on EIRs and Hybrid Resources with a VER component with PGAs as well as additional requirements on such EIRs electing certification as a Participating Intermittent Resource (PIR). Section A13 of Appendix A of the *BPM for Market Operations* contains additional requirements for EIRs and PIRs that do not pertain to direct telemetry.

11.2 Power Reliability Requirements

The wind and solar EIR or Hybrid Resource with a VER component owner must provide a backup power source for the Real-Time Device, meteorological station equipment, revenue meter, and essential communication equipment (not limited to the router, network switch, fiber optic transceiver, and 120V plug-in power supplies), the backup power source shall be sized accordingly to carry that equipment load. A backup power supply may include, but is not limited to, uninterruptable power source (UPS), battery bank with solar panel charger, or dedicated wind turbine charging a backup battery bank with inverter. Whichever backup power source is installed, it shall be sized and provide power until the primary power source is restored.

11.3 Basic Meteorological Data

The [ISO-CAISO](#) required meteorological data points for EIRs and Hybrid Resources with a VER component participating in [ISO-CAISO](#) markets as a VER is covered in the [ISO-CAISO](#) tariff appendix Q section 3.

11.3.1 Meteorological Wind Speed

The unit of measurement for wind speed will be in meters per seconds (m/s) with a precision of one m/s.

11.3.2 Meteorological Wind Direction

The unit of measurement for wind direction will be in angular degrees from true north with a precision of five degrees.

11.3.3 Meteorological Barometric Pressure

The unit of measurement for barometric pressure will be in Hecto Pascal with a precision of 60 Hecto Pascal.

11.3.4 Meteorological Ambient Temperature

The unit of measurement for ambient temperature will be in degrees Celsius with a precision of 1 degree Celsius.

11.4 Wind Generation

11.4.1 Meteorological Station Requirements

Each Participating Generator with a wind EIR or Hybrid Resource with a VER component must install and maintain equipment required by the [ISOCAISO](#) to support accurate power generation forecasting and the communication of such forecast, meteorological, and other required data in accordance to [ISOCAISO](#) New Resource Implementation process timeframe and the tariff appendix Q. The use of SODAR and/or LIDAR equipment may be an acceptable substitute for wind direction and velocity based on consultation and agreement with the forecast service provider and the [ISOCAISO](#).

11.4.2 Designated Turbines

Designated Turbines are required to improve forecast accuracy within a wind Generator Facility.

Definitions:

Designated Turbine - A turbine designated by the [ISOCAISO](#), in which nacelle wind speed and wind direction is required.

Wind Site Information Form and Topographical Map

A wind EIR or Hybrid Resource with a VER component must submit in accordance to the New Resource Implementation process time frame and [ISOCAISO](#) Tariff Appendix Q, the topographical map and the Wind Site Information Spreadsheet (see References) that has all the locations and heights for each wind turbine within a wind Generator Facility with latitude and longitude and shall be in degrees/decimals using WGS84 geodetic datum only. Note: "See topographical map" is not an acceptable input on the Wind Site Information form.

11.5 Solar Generation

11.5.1 Meteorological Station Requirements

Each EIR or Hybrid Resource with a VER component Generator Facility shall provide meteorological station(s) in accordance to the [ISOCAISO](#) tariff appendix Q. ~~The meteorological real-time data requirements are set forth in Section 13.4.1.~~

Solar Generating Facilities that require direct normal irradiance (DNI) and global horizontal irradiance (GHI) measurements may provide alternate radiometry meteorological station data. For example, meteorological station one may report DNI where meteorological station 2 may report GHI. All other meteorological data reporting requirements shall remain the same.

Solar Generating Facilities' meteorological stations shall cover 90% of the facility's footprint for each Resource ID. Each meteorological station shall have a coverage radius of 7 miles.

11.5.2 Basic Solar Meteorological Data

Table 11-1 has been removed and Tariff Appendix Q Section 3.2.2 has the devices list, Units of measure, and Accuracy.

11.5.3 Participating Generator Irradiance Component Requirements

Table 11-2 has been removed and Tariff Appendix Q Section 3.2.2 has the technology component requirements,

11.5.4 Solar Technology Definitions

The technology definition are now covered in Tariff Appendix Q section 3 - TBD

11.5.4.1 Flat Plate Solar Photovoltaic

Photovoltaic power generation employs solar panels comprising a number of cells containing a photovoltaic material.

- **Fixed horizontal / flat roof:** The panels are mounted parallel to the sky and the roof top.
- **Fixed angle:** The panel is statically fixed to an angle that optimizes its exposure to the sun year around.
- **Azimuth tracking:** A panel is attached to a device that tracks the horizontal movement of the sun to optimize solar production.
- **DNI:** Direct Normal Irradiance (DNI) is a measure of the solar irradiation striking a surface held normal to line of sight to the sun.
- **Solar zenith angle:** Zenith angle is the angle from the zenith (point directly overhead) to the sun's position in the sky. The zenith angle is dependent upon latitude, solar declination angle, and time of day.

11.5.4.2 Flat Panel Solar Collector

A typical flat-plate collector is a metal box with a glass or plastic cover (called glazing) on top and a dark-colored absorber plate on the bottom. The sides and bottom of the collector are usually insulated to minimize heat loss. Sunlight passes through the glazing and strikes the absorber plate, which heats up, changing solar energy into heat energy. The heat is transferred to liquid passing through pipes attached to the absorber plate.

11.5.4.3 Low Concentration Solar Photovoltaic

Low concentration solar photovoltaic is a system that has a solar concentration of 2-100 magnification of the suns. This is normally performed with the use of mirror or other material or devices that concentrate the suns irradiance.

11.5.4.4 High Concentration Solar Photovoltaic

High concentration solar photovoltaic is a system that has a solar concentration of 300 magnification of the suns or greater. This is normally performed with the use of mirror or other material or devices that concentrate the suns irradiance.

11.5.4.5 Concentrated Solar Thermal

Concentrated solar thermal systems use lenses or mirrors and tracking systems to focus a large area of sunlight onto a small area. The concentrated light is then used as heat or as a heat source for a conventional power plant such as a steam turbine.

11.5.4.6 Heliostat Power

Heliostat power plants or power towers are a type of solar furnace using a tower to receive the focused sunlight. They use an array of flat, movable mirrors called heliostats to focus the sun's rays upon a collector tower.

11.5.4.7 Greenhouse Power Tower

The greenhouse power tower combines the chimney effect, the greenhouse effect, and wind turbines to produce power. Air is heated by sunshine and contained in a very large greenhouse-like structure around the base of a tall chimney, and the resulting convection causes air to rise up the updraft tower. This airflow drives turbines, which produce electricity.

11.5.4.8 Sterling Engine

Sterling engine use the expansion or hot gasses and contraction of cool gasses to produce mechanical work. The engine is designed so that the working gas is generally compressed in the colder portion of the engine and expanded in the hotter portion resulting in a net conversion of heat into work. The cooler part of the engine at times has compressors to cool the gases, and the hotter part, uses mirrors to concentrate the heat from the sun.

11.5.5 Solar Site Information Form and Topographical Map

A Participating Generator solar EIR or Hybrid Resource with a solar component must submit in accordance to the New Resource Implementation process time frame and [ISOCAISO](#) Tariff Appendix Q, the topographical map and the Solar Site Information Spreadsheet (see References) for locations and heights for each wind turbine within a wind Generator Facility with latitude and longitude and shall be in degrees/decimals using WGS84 geodetic datum only.

12. Proxy Demand Resource (PDR)

Proxy Demand Resources shall follow the direct telemetry standards defined in this BPM.
Check section: Refer to Section 6.2.2 for telemetry timing requirements.

12.1 PDR Point Requirements

12.1.1 Real Load MW

Each PDR shall be required to provide real-time load values. The load is the total real-time load or the power consumed by the resource; it can be a directly measured or calculated. Load data can be provided directly from a field device, such as a revenue meter, or indirectly by interfacing to a PDR EMS. It can also be derived by statistical sampling of a resource's underlying load. This data point is used to help establish a baseline and calculate the load reduction of a resource when the resource is dispatched. A method for calculating load is not valid unless approved by the [ISOCAISO](#).

12.1.2 PDR Unit Connectivity Status (PDR UCON)

The PDR UCON can be manually set by an operator or programmed to change status based on an ADS Dispatch. The PDR UCON represents connection of the resource to the grid.

12.1.3 Bias Load MW

Bias load is a calculated value that stores the initial real load of a resource when the PDR unit connectivity status (UCON) is initially set to ON (HIGH). The bias load is used to establish a resource's baseline load.

~~12.1.4 PDR Unit Ready to Start and Start Status~~

~~The PDR Ready to Start and Start statuses are required only if a PDR is participating in the Spinning or Non-Spinning Reserve market. The Ready to Start status should be set to ON (HIGH) if the resource has been awarded Spinning or Non-Spinning Reserve by the market and is available for dispatches. The Start status should be set to ON (HIGH) when the PDR UCON is ON (HIGH). Both status points can be linked to the PDR UCON status.~~

~~12.1.5~~12.1.4 Pseudo Generation MW

PDR will be required to provide a pseudo generation point. The pseudo generation point calculates the real load, bias load, and the PDR UCON points. The pseudo generation point calculation can be performed within a control system, EMS, or Real-Time Device.

The pseudo generation point allows the [ISOCAISO](#) to model the PDR resources like a participating generator.

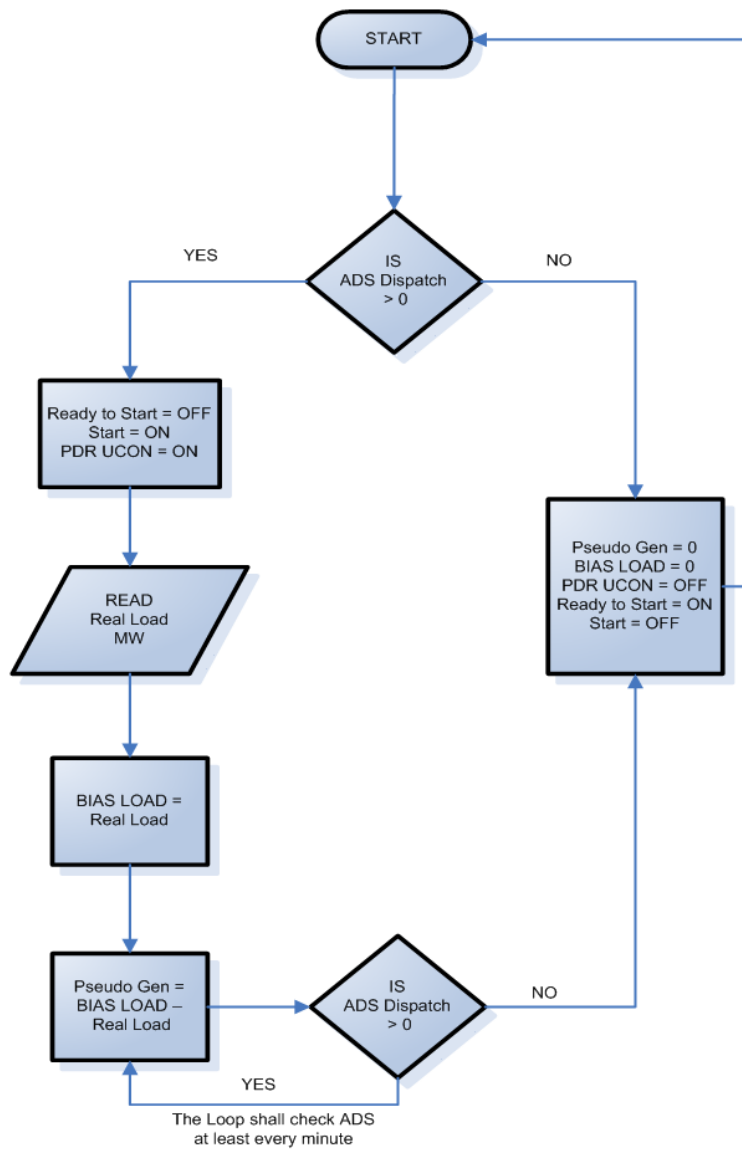
12.1.612.1.5 Statuses and Pseudo Generation Flow

Table 12-1 shows the sequence of the ADS signal when it changes for a PDR. (The ISOCAISO's ADS dispatches to non-regulation resources.)

Table 12-1: Sequence of ADS Signal for PDR

1A	If ADS Dispatch Signal > 0	1B	If ADS Dispatch Signal = Zero
	Read to Start status = 0		Read to Start status = 1
	Start status = 1		Start status = 0
	PDR UCON = 1		PDR UCON = 0
	Real Load = Feeder Actual MW		Bias Load = 0
	Set Bias Load = Real Load		Pseudo Gen = 0
	Pseudo Gen = Bias Load - Real Load		Goto 1B
2A	Loop checks the ADS dispatch every minute. if ADS dispatch > 0 then next step else go to 1B		
	Reset Real Load = Feeder Actual MW		
	Perform Pseudo Gen = Bias Load - Real Load		
	Go to 2A		

Exhibit 12-2 illustrates the flow of PDR status and Pseudo Generation MW.

Exhibit 12-2: Calculations for Pseudo Generation

12.2 Timing and Configuration Requirements

Demand Response Provider (DRP) who have PDR resources greater than 10 MW or participate in the Ancillary Service market are responsible for adhering to all the current [ISO-CAISO](#), DNP3 configuration, and security standards telemetry standards located on the [ISO-CAISO](#)'s Direct Telemetry Web page (see References).

PDR resources are not required to send updated load or generation values to the Real-Time Device every 4 seconds, PDR timing requirement has been extended per provisions set in section 6.2.2 of this BPM. However the Real-Time Device is still required to scan every 4 seconds.

12.3 Analog Data Requirements

12.3.1 [Instantaneous-Real](#) Load (MW)

Definition

Each PDR resource will be required to provide the instantaneous load of each resource. The instantaneous load value is the compensated real-time megawatt load as seen at the [ISO-CAISO](#) grid. This value is either the actual or calculated value of the load where the resource connects to the [ISO-CAISO](#)-Controlled Grid. The value is compensated for losses typically arising from the difference between the measured point and the delivery point (such as transformer losses, and radial line losses). The value should align with the Point-of-Delivery (POD) megawatts calculated or measured by the [ISO-CAISO](#) revenue meters.

Purpose

The purpose of providing this data point is to validate that there is load at the resource. It is also essential in providing a baseline point that is used to calculate the pseudo generation point.

Methods of providing this value

Instantaneous Load data can be gathered from a revenue meter. The individual sites are aggregated up to the resource level. (It can also be gathered from a resources EMS system that tracks electricity consumption at each load point.) All methods for deriving instantaneous load must first be reviewed by [ISO-CAISO](#) engineers before being accepted as a credible load measurement.

12.3.2 Pseudo Generation (MW)

Definition:

Each PDR resource will be required to provide the pseudo generation of each resource. The pseudo generation will be calculated from the Instantaneous load MW and the PDR UCON points,


this is a digital calculated point and is discussed in more detail in section titled “PDR Unit Connectivity Status (PDR UCON)


This pseudo generation calculation must be done in parallel with the PDR UCON calculation. This program contains two independent loops and is configured as follows:

- Validate that the current status of the **PDR UCON** is set to **ON**.
- If the **PDR UCON** is set to **OFF**, then the **Pseudo Gen** point will be set to **0** and the program will look back to **START**.
- If the **PDR UCON** is set to **ON**, then the **BIAS LOAD** point will hold the current value of the Instantaneous Load and keep that value until the program re-executes from **START**.
- Next, the **Pseudo Gen** will be calculated ($\text{Pseudo Gen} = \text{BIAS LOAD} - \text{Instantaneous Load}$)
- Each time the **Pseudo Gen** is calculated, the program must then validate the current status of the **PDR UCON**.
- If the **PDR UCON** is set to **ON**, then the **Pseudo Gen** will be calculated ($\text{Pseudo Gen} = \text{BIAS LOAD} - \text{Instantaneous Load}$) and the loop will continue.
- If the PDR UCON is set to OFF, then the Pseudo Gen point will be set to 0 and the program will look back to START.

For example, if the Instantaneous Load at a resource is 100 MW at the instant the PDR UCON is set to ON, then the BIAS point will store the 100 MW in its register. As the load drops to 95 MW, the pseudo generation will be $\text{BIAS} - \text{Instantaneous Load}$ or $100 - 95 = 5$ MW. When the PDR UCON is switched to the OFF status, the pseudo generation resets to 0 MW.

Exhibit 12-3: PDR UCON Status Flowchart

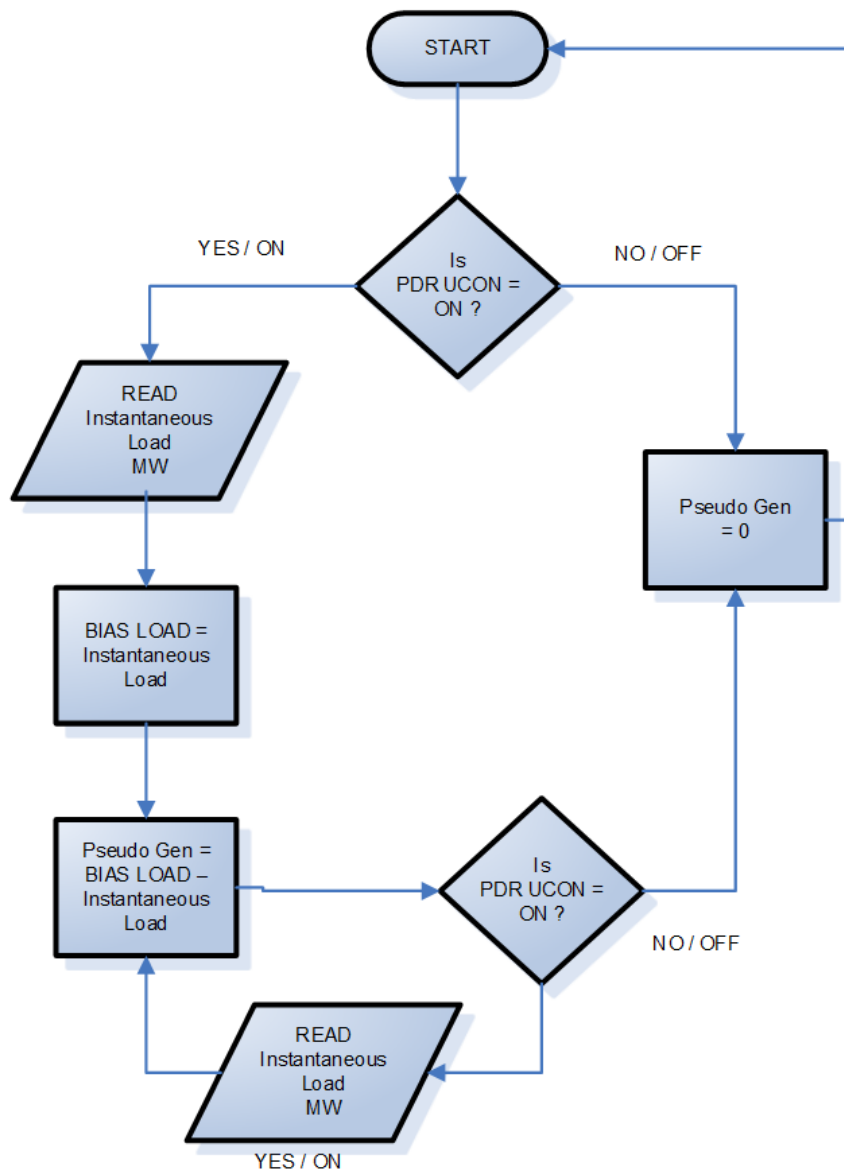

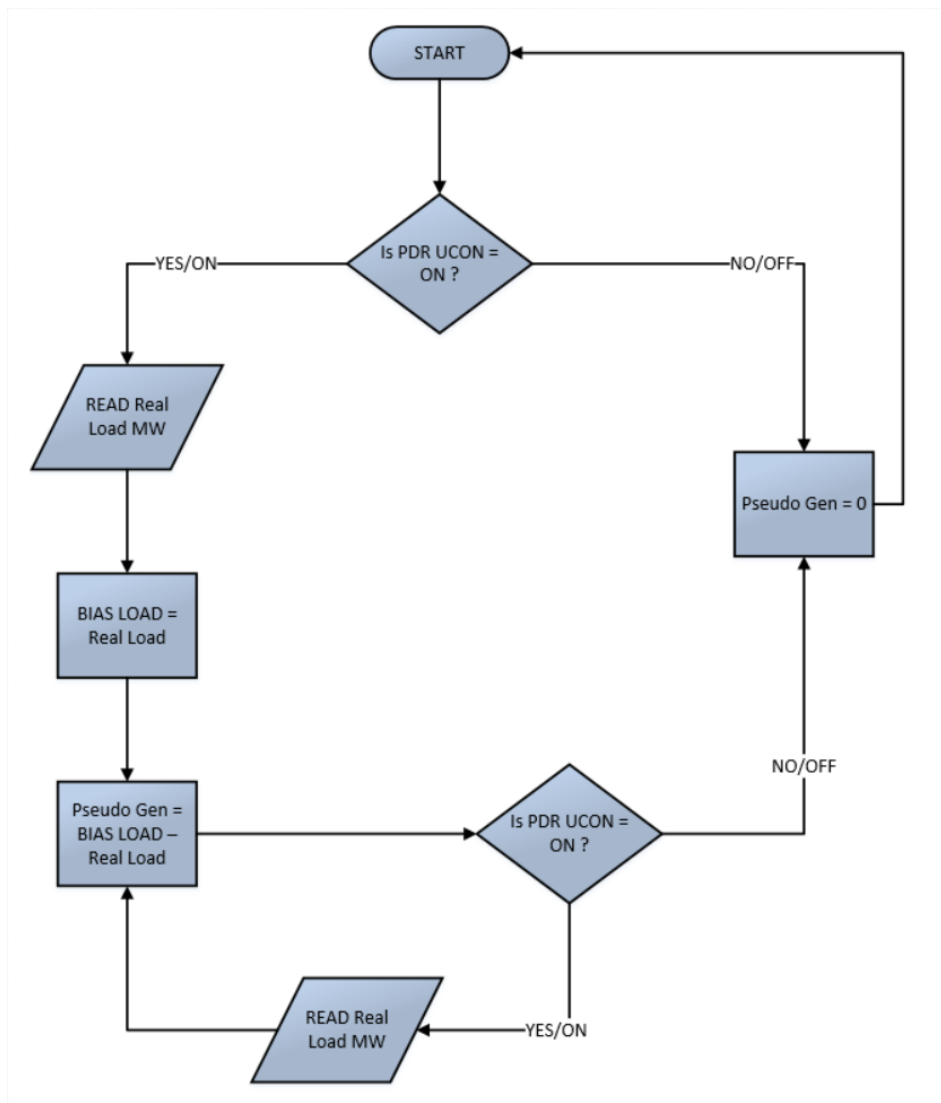

Purpose

It will allow [ISOCAISO](#) to treat the PDR like an ordinary generator and allow the PDR to participate in Spin and Non Spin ancillary service markets.

Methods of providing this value

This calculation can be performed within a control system, SCADA, EMS, or within a certified Real-Time Device that has been re-certified for inclusion of this calculation.


12.4 Digital Data Requirements

12.4.1 Load Unit Connectivity Status (LOAD UCON)

Definition

The Load Unit Connectivity Status represents that the PDR has enough load to be dispatched. ON status means that the resource has load greater than 0 MW to be dispatched by the [ISOCAISO](#) ADS as a pseudo generator. For example if a resource currently has a load of 10 MW, then the LOAD UCON bit will be set to ON. An OFF status means the PDR is at 0 MW of load. Exhibit 12-4 provides a program flowchart.

Exhibit 12-4: Load UCON Status Flowchart

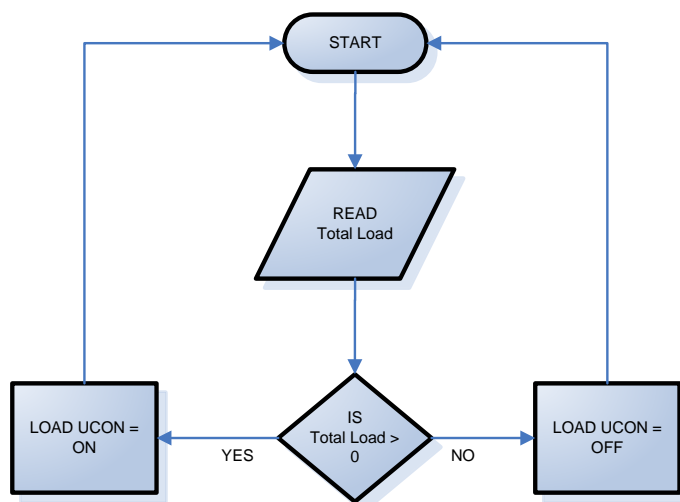

Purpose

The LOAD UCON value is used to determine if the load is available, as a pseudo generator, and can be counted towards Spinning or Non-Spinning Operating Reserve contribution. It provides a

check and balance in the state estimator network topology and data quality work. The UCON also provides an indication if the pseudo generator is available for dispatch.

Methods of providing this value:

The UCON status can be programmed within a Real-Time Device, PLC, or a control system.


12.5 PDR Unit Connectivity Status (PDR UCON)

Definition

The PDR UCON in ON status is an indication that the PDR has been dispatched. [ISOCAISO](#) dispatches for non-regulation resources are normally performed through the Automated Dispatch System (ADS). The PDR UCON can be manually set by an operator based off of an ADS signal. It can also be tied to an application programming interface (API) which automatically sends the ADS dispatch to the Real-Time Device to perform the calculation for the PDR UCON.

1. If the LOAD UCON is set to ON and the resource receives an ADS dispatch greater than 0 MW, then the PDR UCON is set to ON.
2. If the LOAD UCON is set to OFF and the resource receives an ADS dispatch greater than 0 MW, then the PDR UCON is set to OFF.
3. If the LOAD UCON is set to OFF and the resource receives an ADS dispatch of 0 MW, then the PDR UCON is set to OFF.
4. If the LOAD UCON is set to ON and the resource receives an ADS dispatch of 0 MW, then the PDR UCON is set to OFF.
5. In all of these cases, the Program should loop back to Start and re-execute.

Exhibit 13-4 illustrates the flow of this program.

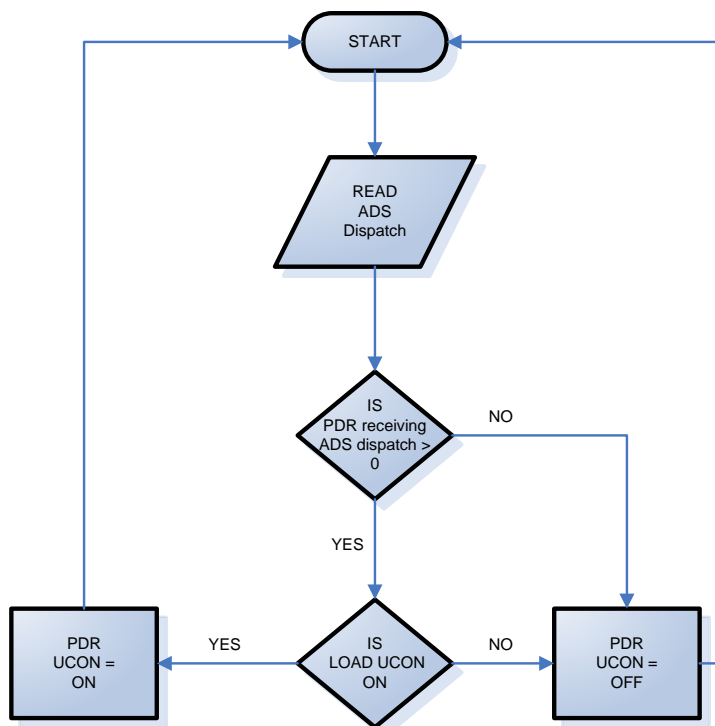Exhibit 12-5: PDR UCON Status Flowchart**Purpose**

The LOAD UCON value is used to determine if the load is available, as a pseudo generator, and can be counted towards Spinning or Non-Spinning Operating Reserve contribution. The PDR UCON value is used as a validity check when counting Operating Reserve contribution. The PDR UCON also provides an indication if the pseudo generator is currently being dispatched. It is also an important point in calculating the pseudo generation MW point.

Methods of providing this value

The UCON status can be programmed within a Real-Time Device, PLC, or a control system.

13. Real-Time Device Aggregator

Check sections: Refer to Sections [5.76-9](#), [5.86-10](#) and [5.96-11](#) for other direct telemetry requirements.

13.1 Applicability

The Real-Time Device Aggregator standards in this Section 15 apply to Participating Generators who plan to use a single Real-Time Device to provide direct telemetry for multiple resources. To optimize the data gathering process, resources may use a Real-Time Device Aggregator to meet the [ISOCAISO](#)'s telemetry requirements instead of installing a Real-Time Device for each facility. The Real-Time Device Aggregator must be a Participating Generator that can enter into agreements with other Participating Generators to provide direct telemetry through its Real-Time Device.

13.2 Real-Time Device Aggregator Responsibility

The Real-Time Device Aggregator is responsible for the real-time telemetry data aggregation and is the main contact for data quality issues, accuracy, and communication.

The Real-Time Device Aggregator will be responsible for coordinating required data points telemetered to the [ISOCAISO](#) EMS.

In addition to meeting the requirements of Section 5.8 for its own resources, the Real-Time Device Aggregator has the obligation to maintain direct contact with the [ISOCAISO](#) for all other resources that it is aggregating.

13.3 Real-Time Device Aggregator Authorization

The Real-Time Device Aggregator shall provide a letter on the Real-Time Device Aggregator's letterhead setting forth a list of all resources that are being aggregated. The letter shall state that the Real-Time Device Aggregator accepts all responsibilities detailed in this BPM. The Real-Time Device Aggregator shall provide accompanying letters from each Participating Generator granting authorization to the Real-Time Device Aggregator to telemeter data on their behalf to the [ISOCAISO](#).

14. Real-Time Point Definitions

The Participating Generator is responsible for correctly providing all required points at the accuracy herein.

14.1 Analog Values

14.1.1 Unit Gross Megawatts (Gross MW)

Definition

This quantity is defined as the resource's real power output, before subtracting the auxiliary real power load or step-up transformer real power losses.

Purpose

Gross MW is used to determine the Balancing Authority Area's generation pattern in the network model.

Methods of providing this value:

This value can be provided from instrument devices at the resource site (accurate transducers), at the Generating Unit terminals/low side of the step-up transformer, before any generation is intermingled with auxiliary load. It may be calculated from other measured points as agreed to by the CAISO ~~EDAS -RIG Engineer~~ (i.e., Net MW plus Aux MW = Gross MW).

14.1.2 Unit Net Megawatts (Net MW)

Definition:

This quantity is defined as the resource's real power output measured at the low side of the step up transformer after the auxiliary transformer if applicable. Or the quantity available after subtracting the unit auxiliary real power load, but before subtracting the unit step-up transformer real power losses.

Purpose:

Net MW is used to determine the CAISO Balancing Authority Area's generation pattern used in the network model.

Methods of providing this value:

This value can be provided from instrument devices at the resource site or it may be calculated from other measured points as agreed to by the CAISO RIG Engineer (i.e., Gross MW minus Aux MW = Net MW).

If Gross MW is equal to Net MW then Net MW is not required.

14.1.3 Unit Point of ~~D~~elivery Megawatts (POD MW)

Definition:

This quantity is defined as the compensated, real-time value of the resource's real power output at the point the resource connects to the electric grid to the CAISO Controlled Grid. It should align with the Point-of-delivery (POD) MW calculated or measured by the CAISO revenue meters. This value is either the actual or calculated value of the unit's output at the point where the Generating Unit connects to the electric grid into the CAISO Controlled Grid. It must be a real time updated value and not averaged over time. This value is compensated for losses typically arising from the difference between the measured point and the delivery point (such as transformer losses, line losses, etc.). This value should include the Distribution compensation factor (DCF) if the resource has an executed WDAT agreement. For more information on DCF, refer to Metering BPM Attachment B, Section E.

Purpose:

POD MW is used to certify Ancillary Services and represents the Generating Unit's real power delivery to the system. It is used to validate Ancillary Services Bids (scheduled versus actual) and to calculate accurate Operating Reserves. This point is also used as an input to the real-time network model used for system reliability monitoring.

Methods of providing this value

This value may be obtained by installing instrument devices at the POD. This value may also be calculated by providing an accurate conversion of existing Net MW values to point of delivery values within the existing control system or external system. The value must represent an accuracy of +/-2% of the true value of POD MW represented in the ~~ISO~~CAISO revenue meter.

14.1.4 Unit Auxiliary Load Megawatts (Aux MW)

Definition

Aux MW is defined as the real power load the Generating Unit provides to maintain its station service power. This point is required where a unit's maximum auxiliary load is 1 MW or greater. Aux MW cannot represent other loads between the Generating Unit and the POD.

Purpose

The ~~ISO~~CAISO uses this value to determine the amount of replacement power required by each Generating Unit based on unit trips, and startups. This value is used to properly model the Generating Unit's operating condition.

Methods of providing this value

Aux MW can be provided from instrument devices at the auxiliary transformer. It may be calculated from other measured points as agreed to by the [ISOCAISO](#) Energy Data Acquisition Specialist (that is, Gross MW minus Net MW = Aux MW).

14.1.5 Gross Reactive Power or Gross Mega VAR (MVAR)

Definition

This quantity is defined as the unit's reactive power output, before subtracting the unit auxiliary reactive power load or unit step-up transformer reactive power losses.

Purpose

Gross MVAR is used to determine the [ISOCAISO](#) Balancing Authority Area's MVAR generation pattern in the network model.

Methods of providing this value

This value can be provided from instrument devices at the generating site (accurate transducers), at the Generating Unit terminals/low side of the step-up transformer, before any generation is intermingled with auxiliary MVAR. It may be calculated from other measured points as agreed to by the [ISOCAISO](#) Energy Data Acquisition Specialist (that is, Net MVAR + Aux MVAR = Gross MVAR).

14.1.6 Point of Delivery Mega VAR (POD MVAR)

Definition

This quantity is defined as the compensated, real-time value of the reactive power (MVAR) at the point the Generating Unit connects to the [ISOCAISO](#)-Controlled Grid. It should align with the Point-of-delivery (POD) MVAR calculated or measured by the [ISOCAISO](#) revenue meters. This value is either the actual or calculated value of the unit's output at the point where the Generating Unit connects into the [ISOCAISO](#)-Controlled Grid. It must be a real-time updated value and not averaged over time. This value is compensated for losses typically arising from the difference between the measured point and the delivery point (such as transformer losses, and line losses).

Purpose

POD MVAR is used to establish a generating site's reactive power delivery to the system and the impact of the generating site on system voltage. It is used to verify the generating site's operation within [ISOCAISO](#) Tariff requirements for reactive power, and is used as an input to real-time network model used for system reliability monitoring.

Methods of providing this value

This value may be obtained by installing instrument devices at the POD. This value may also be calculated by providing an accurate conversion of another data point measured at the same

voltage level as the POD. The value must represent an accuracy of +/-2% of the true value of POD MVAR represented in the [ISOCAISO](#) revenue meter.

14.1.7 Net Reactive Power (Net MVAR)

Definition

This quantity is defined as the unit's reactive power output after subtracting the unit auxiliary reactive power load, but before subtracting the unit step-up transformer reactive power losses.

Purpose

Net MVAR is used to determine the [ISOCAISO](#) Balancing Authority Area's generation pattern used in the network model.

Methods of providing this value

This value can be provided from instrument devices at the generating site or it may be calculated from other measured points as agreed to by the [ISOCAISO](#) Real-Time Device Engineer (that is, Gross MVAR minus Aux MVAR = Net MVAR). If Gross MVAR is equal to Net MVAR then Net MVAR is not required.

14.1.8 Auxiliary Load Reactive Power (Aux MVAR)

Definition

Aux MVAR is defined as the reactive power load the Generating Unit provides to maintain station service power. This point is required where a unit's maximum auxiliary load is one MW or greater. Aux MVAR cannot represent other loads between the Generating Unit and the POD.

Purpose

The [ISOCAISO](#) uses this value to determine the amount of replacement MVAR required by each Generating Unit based on unit trips, and startups. This value is used to properly model the Generating Unit's operating condition.

Methods of providing this value

Aux MVAR can be provided from instrument devices at the auxiliary transformer. It may be calculated from other measured points as agreed to by the [ISOCAISO](#) Real-Time Device Engineer (that is, Gross MVAR minus Net MVAR = Aux MVAR).

14.1.9 Generating Unit Terminal Voltage (KV)

Definition

This quantity is defined as the terminal voltage of the Generating Unit, before the unit step-up transformer. It may be phase to phase or a calculated value of phase to ground multiplied by the

square root of three. For a Net Scheduled QF subject to a QF PGA, this quantity is the voltage at the Point of Demarcation.

Purpose

The ~~ISO~~CAISO uses generator terminal voltage to determine each Generating Unit's contribution to system voltage support. Terminal voltage is critical to proper network modeling. This value is useful in identifying voltage control issues, and MVAR circulation problems.

Methods of providing this value

This value can be provided from instrument devices at the Generating Unit terminals (accurate transducers), or, for a Net Scheduled subject to a NSPGA, at the Point of Demarcation.

14.1.10 Unit Operating High Limit (UOHL) [AGC Units Only]

Definition

The UOHL represents the maximum physical operating limit of the Generating Unit. The plant control room operator typically sets this limit to prevent the unit MW output from exceeding an upper plant operating limitation.

Purpose

The ~~ISO~~CAISO uses this value to set the maximum boundary for AGC calculations and unit availability at the POD.

Method of providing this value

The real-time UOHL value is typically provided directly from the device that the plant control room operator uses to manually set the operating limits.

14.1.11 Unit Operating Lower Limit (UOLL) [AGC Units Only]

Definition

The UOLL represents the minimum physical operating limit of the Generating Unit that participates in ACG. The plant control room operator typically sets this limit to prevent the unit MW output from exceeding a lower plant operating limitation.

Purpose

The ~~ISO~~CAISO uses this value to set the minimum boundary for AGC calculations and unit availability at the POD.

Method of providing this value

The real-time UOLL value is typically provided directly from the device that the plant control room operator uses to manually set the operating limits.

14.1.12 Governor Droop Setting

Definition

Droop is the amount of speed (or frequency) change that is necessary to cause the main prime mover control mechanism to move from fully closed to fully open. A governor tuned with speed droop will open its control valve a specified amount for a given frequency deviation. It is the change in steady state rotor speed, expressed in percent of rated speed, when power output is gradually reduced from rated to zero power. Applicable droop settings are set forth in CAISO tariff section 4.6.5.1 and in resources' interconnection agreements.

Purpose

Primary Frequency Control is the first stage of overall frequency control and is the response of resources to arrest the locally measured or sensed changes in frequency. Telemetered Droop settings will assist the ~~ISO~~CAISO to compare and evaluate effective frequency response during disturbance, and to address techniques of measuring frequency response at the resource level.

Method of providing this value

Droop settings can be provided by the resource manufacturer or plant controller based on tested results. Direct telemetry will reflect any dynamic change in droop setting based on different constraints and types of resources. Data representation for 5% Droop should be 0.05.

14.1.13 Governor Dead band

Definition

The range of deviations of system frequency (+/-) that produces no turbine Governor response, and therefore, no frequency (speed) regulation. Dead band settings should not be exceed +/- 0.036 Hz (59.964 Hz to 60.036 Hz).

Purpose

Telemetered dead band will be used to measure response from resources during disturbances. This will also allow the CAISO to analyze the expected response and actual response to support interconnection reliability using the telemetered governor settings.

Method of providing this value

Direct telemetry from the plant controller. Data representation should be in Hz (Example: 0.036 Hz for 36 millihertz)

14.1.14 Operating Ramp Rates

Definition

The rate, expressed in megawatts per minute, that a generator changes its output. The maximum ramp rate of a resource should be reflected in the Master File.

Purpose

Telemetered ramp rate will provide the CAISO with information needed to validate the actual response of the unit during grid disturbances.

Method of providing this value

Direct telemetry from plant DCS in MW/Min

14.1.15 High Sustainable Limit (HSL)

Definition

The instantaneous generating capability of a variable or intermittent Generating Unit (or component thereof), provided to the CAISO through telemetry at the Generating Unit. ~~The High Sustainable Limit may not exceed the Generating Unit's P_{Max}.~~ HSL can exceed the P_{Max} of the resource and should reflect the true generation capability of the resource without any limitations. HSL must be provided for each VER component of the hybrid resource, ~~or~~ VER co-located resource, or any VER that is providing AS. The HSL requirements are further defined by CAISO Tariff sections 4.18, 34.1.6.3, and Appendix A and Q.

Purpose

The HSL telemetry will be used primarily for forecasting. It will also be used to assist with renewable resources that are providing AS, including regulation, in addition to assessing the capability of a Hybrid Resource and for operational awareness.

Method of providing this value

HSL is a calculated value that comes directly from the site. When there is no supplemental dispatch or AS in place, the HSL is the generation capacity. When there is supplemental dispatch or another market instruction in place, the HSL is the generation capacity without the supplemental dispatch or AS signal. The generation capacity is calculated based upon known weather information and characteristics of the resource, such as: wind speed, wind direction and number of turbines for wind resources, and solar irradiance and available inverters from a solar

resource. This information can be applied to a known power curve for the site to determine the sites generation capacity.

Following calculations can be used to determine HSL:

Wind: Site Output number of turbines available–electrical losses*

Formatted: No underline

Solar: Site Output number of inverters available–electrical losses*

Formatted: No underline

Where *Site Output* refers to a solar site's average irradiance or a wind site's average wind speed.

Formatted: No underline

Formatted: No underline

The HSL must be greater than or equal to the actual VER component production. The HSL must propagate bad quality if the source irradiance or wind speed devices are in bad quality. If the VER has two or more weather stations, averaging or redundancy logic may be implemented. In this configuration, bad quality must be reported if all of the weather stations inputs are in bad quality.

Formatted: No underline

The HSL may be updated every 12 seconds. HSL can be set to update as frequently as the CAISO EMS polling rate of the RIG (every 1 or 4 seconds); however, Appendix Q of the CAISO Tariff specifies that the HSL shall update at a minimum every 12 seconds.

14.2 Digital Values

14.2.1 Unit Generator Breaker

Definition

The generator breaker is the breaker that closes when the unit is synchronized to the grid.

Purpose

The generator breaker positions are needed to determine the unit synchronization status.

Method of providing this value

The plant or resource control system can provide the status of the breaker.

The following three digital points are required for resources providing AGC.

14.2.2 Unit Connectivity Status (UCON)

Definition

The UCON status is an indication that a unit is synchronized to the grid.

Purpose

The UCON value is used as a validity check when counting Operating Reserve contribution. It provides a check and balance in the FNM and provides an indication of the number of Generating Units connected to the system.

Method of providing this value

This value is determined from the actual breaker status points of each Generating Unit and the pre-determined value of Gross MW, point of delivery MW, or the measurement of voltage is greater than a small percentage of Terminal Voltage and the High side breaker closed. If a line breaker exists then it should be included in the UCON calculation as well. Consult with the [ISO/CAISO](#) Energy Data Acquisition Specialist to determine the best solution.

Method of providing this value for Storage Devices

This value is determined from the actual breaker status points of each resource and the inverter ready status. UCON should be ON when the battery is both charging and discharging. Consult with the [ISO/CAISO](#) Energy Data Acquisition Specialist to determine the best solution.

14.2.3 Unit Control Status (UCTL)

Definition

The UCTL represents a software or hardware switch position that the resource is controlling remotely or locally. The On (High) indicates when the resource is available for remote supervisory control. The Off (Low) indicates the resource is controlled locally.

Purpose

The purpose of the UCTL is to validate whether the resource is providing remote control to supervised control operators.

Method of providing this value:

The resource operator selects the UCTL value through an operator interface display or physical toggle switches. Whichever method is used to select remote or local control, the indication will come from the resource control system.

14.2.4 [ISO/CAISO](#) Unit Authority Switch (UASW)

Definition

The Real-Time Device unit authority logic dictates which entity (the Generator, the [ISO/CAISO](#), or other EMS system) has control over a Generating Unit at any given time. When sharing control of equipment, it is usually necessary to designate and report who has supervisory control of a specific Generating Unit at any given moment. This is done to prevent conflicting commands from being issued to the equipment. Unit authority switching is the means by which control of specific

equipment is passed among the various control groups. Any logic or operator action that prevents or acts against the [ISOCAISO](#)'s direct control will result in this status changing to Off (Low).

Purpose

When UASW is On (High) the resource will only be available for [ISOCAISO](#) AGC Set Point and no other.

Method of providing this value

The UASW may be defined as a hardware or software switch. In either case, the switch must be available to the resource operator through the plant control system.

14.2.5 Unit Automatic Generation Control (UAGC)

Definition

The UAGC is the final indication that the resource is ready for the [ISOCAISO](#) to send AGC Set Points. The AGC resource requires an AGC certification in order to participate in the [ISOCAISO](#) Regulation market.

There is one UAGC digital point for each Resource ID.

Purpose

This point is used for Settlement purposes to determine that the intended resource met the scheduled generation expectation. When this point is ON (High), the [ISOCAISO](#) EMS AGC control has authority to send MW Set Points to the Real-Time Device.

Method of providing the value

~~The UAGC status is a digital "AND" operand calculation of UCON, UCTL, and UASW points. The UAGC status is a calculation result that is made of digital point operand of AND points UCON, UCTL and UASW.~~ The Set Point shall move the unit within the timing parameters outlined [herein](#).

14.2.6 Automatic Voltage Regulator (AVR) / Power System Stabilizer (PSS) Status

Definition

The AVR is used to automatically control Generating Unit terminal voltage. The status must be represented as ON (in automatic control) or OFF (off-line).

The PSS is the system that works with the AVR to respond to frequency excursions. The status shall be represented as On (in service) or Off (out of service).

Purpose

AVR and PSS device status points are required to assess system reliability. The AVR and PSS status points are required from all Generating Units subject to WECC requirements. These points are also used in post-event analysis and for system stability simulations.

Method of providing this value

These values must represent the ON (high) status from the AVR and PSS devices and may not come from a calculation or user entered value. Data points for AVR and PSS status are not required for units that do not have these devices installed.

14.2.7 Governor Blocking statusDefinition

Blocking the governor or governor-like control device of a resource essentially bypasses the governing feedback mechanisms and maintains the generator at a fixed output level. If the flag is set to ON then the resource is not expected to respond to frequency deviations.

Purpose

It is important to monitor resources that are capable of responding to frequency deviations. If telemetered governor status is set to ON due to physical operational constraints then the resource is not expected to respond to frequency deviations.

Method of providing this value

Plant load controller can provide telemetry to report if resources are capable and ready to respond to frequency deviations. Telemetry will have two states. ON = 1 and OFF = 0

The [ISOCAISO](#) has developed the following implementation schedule for resources to implement the new telemetry requirements.

Resource MW size	Implementation date
>500MW	6/15/2021
>400MW <=500MW	7/31/2021
>300MW <= 400MW	8/31/2021
>200MW <= 300MW	10/30/2021
>100MW <=200MW	1/30/2022

0.5MW <= 100MW	5/31/2022
----------------	-----------

14.3 Switchyard Values

The Participating Generator may own some or all of the equipment associated with the connected switchyard. All switchyard values must meet telemetry timing requirements. If the Participating Generator owns switchyard breakers, it must provide, through the Real-Time Device, the status retransmitted.

The Participating Generator may own some or all of the equipment associated with the high voltage switchyard interconnecting the resource to the grid. The telemetry of all switchyard equipment (for example, circuit breakers, circuit switchers, motor operated disconnects, transformers, and transmission lines) directly associated with connecting the resource to the grid must be communicated through the Real-Time Device regardless of the interconnecting equipment's ownership. If the switchyard directly connects to the [ISOCAISO](#)-Controlled Grid and the Participating Generator owns the other switchyard equipment, the real-time telemetry of all switchyard equipment must be communicated through the Real-Time Device. Where existing telemetry to the [ISOCAISO](#) is available for this switchyard equipment (that is, provided through the UDC), the [ISOCAISO](#) will not require the telemetry of this other switchyard equipment to be provided through the Real-Time Device, provided the Participating Generator has arranged and can provide the [ISOCAISO](#) with evidence of a formal agreement with the UDC to continue to deliver real-time switchyard telemetry values on behalf of the Participating Generator. However, the [ISOCAISO](#) Energy Data Acquisition Specialist must agree with the specific methods used to provide the real-time telemetry.

14.3.1 Switchyard Line and Transformer MW and MVAR Values

Definition

The MW and MVAR quantities for the switchyard's transmission lines and transformers.

Purpose

These values allow for proper network state estimation and assessment of network topology and assist in troubleshooting data quality problems (that is, sum of flows into and out of a bus). The MW and MVAR values are essential for modeling system restoration scenarios.

Method of providing this value

These values are obtained through devices connecting to the line CTs and PTs.

14.3.2 Switchyard Bus Voltage

Definition

This value is the voltage at the Generating Unit's switchyard bus. It may be phase to phase or a calculated value of phase to ground multiplied by the square root of three.

Purpose

The switchyard bus voltage is used in determining network state estimation. It identifies voltage concerns and/or system-imposed limitations on reactive support.

Method of providing this value

This value is provided from bus PTs.

14.3.3 Switchyard Device Status

Definition

The breakers, circuit switchers, and/or motor operated disconnects (MOD) status for each Generating Unit, line, bus, and transformer breakers in the Generating Unit's switchyard are required.

Purpose:

These values are used in determining network topology for state estimation. They are required for system restoration and outage information. In some arrangements, they may be the basis for forming the UCON status.

Method of providing this value

These values are direct measurements from switchyard devices and/or device auxiliary contacts.

14.3.4 Aggregated Units

In certain situations, the [ISOCAISO](#) allows aggregation of Generating Units and the associated telemetry. This is typically done where Generating Units are operated in an interrelated manner (such as through use of a common watershed, and operation in combined cycle configuration). In these situations it is important to work with the [ISOCAISO](#) Energy Data Acquisition Specialist to determine the required data points. The following provides a guideline to help determine the necessary and correct data points for Aggregated Units.

14.3.5 Aggregated Gross MW and MVAR

This is a calculation of the sum of the individual unit Gross MW and Gross MVAR values. When applicable, Gross MW and MVAR are still required for the individual Generating Units. Requirements will vary on a case-by-case basis.

14.3.6 Aggregated Net MW and MVAR

This is a calculation of the sum of the individual unit Net MW and Net MVAR values. When applicable, Net MW and MVAR are still required for the individual Generating Units. Requirements will vary on a case-by-case basis.

14.3.7 Aggregated Aux MW and MVAR

This is a calculation of the sum of the individual unit Aux MW and Aux MVAR values. When applicable, Aux MW and MVAR are still required for the individual Generating Units. Requirements will vary on a case-by-case basis.

14.3.8 Aggregated Point of Delivery MW

Aggregated Point of Delivery (POD) MW is a required point and is typically the value of the MW at the point of interconnection to the ~~ISO~~CAISO-Controlled Grid. In this case, individual Generating Unit POD MW and MVAR are not required.

14.3.9 Aggregated Point of Delivery MVAR

This point requirement has been removed from this BPM

14.3.10 Aggregated Unit Connectivity (UCON)

Aggregated UCON is calculated from the status of all individual Generating Unit UCONs. For example, Aggregated UCON = Unit 1 UCON OR Unit 2 UCON. Individual Generating Unit UCON is based on a determination that at least one of the individual units' breakers is closed and that a minimum threshold of unit Terminal Voltage or Gross MW is exceeded. Coordinate with a ~~ISO~~CAISO Energy Data Acquisition Specialist for calculation.

14.3.11 Aggregated Peaking Unit Start and Ready to Start

This point requirement has been removed from this BPM

14.4 Wind and Solar Point Definitions

The EIR owner or Hybrid Resource with a VER component owner must provide the following applicable real-time data points for the technology used. Reference appendix Q section 3 of the ~~ISO~~CAISO tariff for the additional required real-time points for a VER resource.

14.4.1 Direct Irradiance (DIRD)

Direct Irradiance can be measured with a pyranometer or equivalent equipment which measures solar irradiance in watts per meter (W/m^2). All equipment used to measure solar irradiance must have an accuracy of $\pm 25 W/m^2$. Direct solar irradiance is a measure of the rate of solar energy arriving at the earth's surface from the sun's direct beam, on a plane perpendicular to the beam,

and is usually measured by a sensor mounted on a solar tracker. The tracker ensures that the sun's beam is always directed into the instrument's field of view during the day.

14.4.2 Global Horizontal Irradiance (GHIRD/GHI)

Global Horizontal Irradiance can be measured with a pyranometer or equivalent equipment which measures solar irradiance in watts per meter (W/m^2). All equipment used to measure solar irradiance must have an accuracy of $\pm 25 \text{ W/m}^2$. The GHIRD/GHI is the total solar radiation (direct, diffuse, and ground-reflected irradiance) hitting the horizontal surface of the earth. The sensor shall be mounted on a meteorological station, set at the global horizontal angle of the earth in reference to the sun solar radiation.

14.4.3 Global Irradiance / Plane of Array Irradiance (PAIRD)

Plane of array irradiance can be measured with a pyranometer or equivalent equipment which measures solar irradiance in watts per meter (W/m^2). All equipment used to measure solar irradiance must have an accuracy of $\pm 25 \text{ W/m}^2$. The sensor shall be mounted on a meteorological station, facing the same angle and direction as all other solar photovoltaic panels at the site.

14.4.4 Diffused Irradiance

Diffuse irradiance refers to all the solar radiation coming from the sky and other reflected surfaces except for solar radiation coming directly from the sun and the circumsolar irradiance within approximately three degrees of the sun.

- **Diffused Plane of Array Irradiance (DPOA):** Diffused plan of array irradiance sensors follow the same accuracy and mounting requirements as the GPOA sensors but shall be designed to measure diffused irradiance.
- **Global Diffused Irradiance (DIFGH):** Global diffused irradiance sensors follow the same accuracy and mounting requirements as the GHI sensors but shall be designed to measure diffused irradiance.

14.4.5 Back Panel Temperature (BPT~~EMP~~)

Back panel temperature is measured in degrees Celsius, with an accuracy of one degree. The temperature sensor should be mounted behind a solar photovoltaic panel.

14.4.6 VER ~~Unit Point of delivery~~ Megawatts (VER-~~POD~~-MW)

Definition:

This quantity is defined as the compensated, real-time value of the resource's real power VER output. ~~It should be measured by the revenue meter.~~ It must be a real time updated value and not averaged over time. This value is compensated for losses typically arising from the difference between the measured point and the delivery point (such as transformer losses, line losses, etc.). In cases where a Hybrid Resource has a VER and storage component, the VERMW must reflect

the total VER generation output regardless of where energy is being delivered. Simplified Examples:

1. VER = 100MW and POD = 100MW, VERMW should be 100MW.

2. VER = 100MW, BESS = -100MW, POD = 0MW, VERMW should still reflect 100MW.

Purpose:

VER-~~POD~~-MW is used for~~te~~ purposes of forecasting and reliability and represents the Generating Unit's real power delivery ~~of the Resource's VER component~~~~resource~~.

Methods of providing this value

This value may be obtained by installing instrument devices at the POD ~~that measure only the VER part of the a hybrid resource~~. The value must represent an accuracy of +/-2% of the true value of VER-~~POD~~-MW output represented in the ISO revenue meter.

14.5 Battery Point Definitions

All Battery resources must provide the following applicable real-time data points for the technology used. Section 6.1 provides a table of the required real-time points for each type of technology.

14.5.1 Instantaneous State Of Charge (SOC)

The Instantaneous SOC is the amount of energy in MWh that the battery, in real time, has available for ISOCAISO participation. The SOC will be maintained within energy limit constraints (minimum and maximum) defined in the ISOCAISO Master File. Data should be updated every four seconds and should vary from zero to maximum energy limit.

14.5.2 Maximum Continuous Energy limit

The Maximum Continuous Energy Limit is the maximum energy in MWh that can be stored in the battery for ISOCAISO participation. ~~When the Participating Generator provides this value through telemetry, Market dispatch will respect the energy limit.~~ This value cannot be above the maximum energy limit defined in the ISOCAISO Master File. ~~The derate should be reflected, when applicable, in real time.~~

14.5.3 Battery Energy Storage System (BESS) MW

The Battery Energy Storage System MW is the MW value being imported or exported from the Battery component of a Hybrid Resource. BESS MW should reflect actual uncompensated MW consumed or produced by the BESS component.

~~15.~~ Sub-LAP Resource Names

Formatted: Heading 3, Left

Formatted: Normal, Justified

Table 15-1: Sub-LAP Resource Names

DESCRIPTION	RESOURCE NAMES
PGCC Central Coast	SUB-LAP_PGCC
PGEB East Bay (Bay Area)	SUB-LAP_PGEB
PGF1 Fresno	SUB-LAP_PGF1
PGFG Geysers	SUB-LAP_PGFG
PGHB Humboldt	SUB-LAP_PGHB
PGLP Los Padres	SUB-LAP_PGLP
PGNB North Bay	SUB-LAP_PGNB
PGNC North Coast	SUB-LAP_PGNC
PGNV North Valley	SUB-LAP_PGNV
PGP2 Peninsula (Bay Area)	SUB-LAP_PGP2
PGSA Sacramento Valley	SUB-LAP_PGSA
PGSB South Bay (Bay Area)	SUB-LAP_PGSB
PGSF San Francisco (Bay Area)	SUB-LAP_PGSF
PGSI Sierra	SUB-LAP_PGSI
PGSN San Joaquin	SUB-LAP_PGSN
PGST Stockton	SUB-LAP_PGST
SCE Core (LA BASIN)	SUB-LAP_SCEC
SCNO SCE North	SUB-LAP_SCEN
SCEW SCE West	SUB-LAP_SCEW

Formatted: Normal

DESCRIPTION	RESOURCE NAMES
SCHD High Desert	SUB-LAP_SCHD
SCLD Low Desert	SUB-LAP_SCLD
SCNW SCE Northwest	SUB-LAP_SCNW
SDG1 San Diego	SUB-LAP_SDG1